

Preliminary Stormwater Management Plan

Tudor Road Multi-Family

818 Ne Douglas Street
Section: SE ¼ Sec. 31-48N-31W
Lee's Summit, Missouri

Prepared By:



PHELPS ENGINEERING, INC
1270 N. Winchester
Olathe, KS 66061
(913) 393-1155

PEI #220231
August 9, 2022

TABLE OF CONTENTS

1.0	Introduction	1
2.0	Existing Conditions and Drainage Computations	1
3.0	Proposed Drainage System.....	2
4.0	Stormwater Detention Requirements	2
5.0	Permitting Requirements	3
5.1	FEMA/DWR	3
5.2	Stream Buffer.....	3
6.0	Conclusion	4

LIST OF TABLES & FIGURES

Appendix "A"	Project Location Aerial Map
Appendix "B"	NRCS Johnson County Soils Map
Appendix "C"	Existing Conditions/Drainage Plan
Appendix "D"	Proposed Conditions/Drainage Plan
Appendix "E"	FEMA FIRM Panel #20091C0098G

1.0 Introduction

Phelps Engineering, Inc. (PEI) is pleased to submit this Preliminary Stormwater Management Plan for Tudor Road Multi-Family development located southwest of the intersection of Douglas Street and Tudor Road in the City of Lee's Summit, Jackson County, Missouri. The proposed site is 13.03 acres, and the property is planned to be developed as a multi-family development. The property is bound by Douglas Street to the east, Tudor Road to the north, Commerce Drive to the west, and unplatted land to the south. See Appendix "A" for the project aerial map.

2.0 Existing Conditions and Drainage Computations

The project site is located in the Blue River watershed. The existing site is broken up into two drainage areas. These areas are the north and south watersheds.

The north watershed consists of an area of 3.54 acres in size and is in the northern portion of the site. It is created by existing ridge which divides the site. Water within the north watershed will sheet flow across the site until it reaches Tudor Road. Once within the roadway water is picked up by existing curb inlets and routed away from the site.

The south watershed will consist of an area of 9.49 acres in size and makes up the remainder of the site area. Water within the south watershed sheet flows across the site until it is either picked up an existing area inlet located on the site or sheet flows into Commerce Drive where it is picked up by existing curb inlets within the roadway and routed away from the site. See Appendix "C" for the Existing Conditions Drainage Map.

Soils data for the site watershed was determined using the NRCS Web Soil Survey for Jackson County. There are four different soil types located on the site. This first soil is Arisburg-Urban land complex, 1-5% slopes this soil is classified as Hydrologic Soil Group (HSG) Type "C". The second soil is Sharpsburg-Urban land complex, 2-5% slopes this soil is classified as HSG Type "D". The third soil is Sharpsburg-Urban land complex, 5-9% slopes this soil is classified as HSG Type "D". The final soil is Udarents-Urban land-sampsel complex, 2-5% slopes this soil is classified as HSG Type "D".

The existing onsite land cover type is a combination of grassland in fair condition and woods/grass in good condition. See Appendix "A" of this report for aerial imagery exhibits and Appendix "B" for the NRCS Web Soil Survey.

Lee's Summit follows the "Comprehensive Control" method of mitigating additional runoff from a proposed development. Due to this the allowable release rate for each watershed is as follows. During the 2-year storm event the proposed site may release 0.5 CFS of water per acre. The 10-year event allows 2.0 CFS per acre, and the 100-year event allows 3.0 CFS per acre. Therefore, the allowable release rates for each watershed can be seen in Table 1 below.

Table 1 – Allowable Runoff Conditions

Watershed Area	Curve Number (CN)	Drainage Area (acres)	2-Year Peak Flow (cfs)	10-Year Peak Flow (cfs)	100-Year Peak Flow (cfs)
North	77	3.54	1.77	7.08	10.62
South	77	9.49	4.74	18.98	28.47
Total	77	13.03	6.52	26.06	39.09

3.0 Proposed Drainage System

The development of the site will result in a shift in the drainage patterns. The north watershed will see a reduction in area, resulting in a proposed area of 0.51 acres. The south watershed will see an increase in area, resulting in a proposed area of 12.52 acres. Water in the north watershed will sheet flow off the site and into Tudor Road, where it will follow the existing drainage patterns. Water within the south watershed will be captured by proposed inlets and will be routed to the proposed detention basin via a private enclosed storm system. Detention has been proposed within the south watershed. This will be provided by an above ground basin as well as some underground chambers. The bottom elevation of these two features will be set at the same elevation and will be connected by a flat pipe. Thus, allowing the two storage areas to work in unison to provide adequate volume for detention. Additional information regarding the basins will be provided in the next section. See Appendix “D” for the proposed drainage map.

Using HydroCAD V10 storm modeling software with SCS Type II 24-hr storm duration, the proposed 2, 10 and 100-year site peak discharges were determined for the site can be found in Table 2 below. See Appendix “D” of this report for the proposed Drainage Map and HydroCAD output.

Table 2 – Proposed Runoff Conditions

Watershed Area	Time of Conc. (minutes)	Composite Curve Number (CN)	Drainage Area (acres)	2-Year Peak Flow (cfs)	10-Year Peak Flow (cfs)	100-Year Peak Flow (cfs)
North	6.8	80	0.51	1.45	2.75	4.55
South	11.8	93	12.52	4.67	18.70	28.29
Total	N/A	93	13.03	6.11	19.08	32.79

4.0 Stormwater Detention Requirements

Per City of Lee’s Summit Municipal Code detention facilities must comply with the “Comprehensive Control” method of detention found in APWA 5600. This states that the allowable peak runoff rate for a watershed is 0.5 CFS per acre in the 2-year event, 2.0 CFS per acre in the 10-year event, and 3.0 CFS per acre in the 100-year storm event. The allowable release rates for each watershed have already been provided in Table 1 above. In addition to the allowable flow requirements, the comprehensive control method also requires that the water quality event be detained and released over a period of 40 hours. This will be achieved by designing the basin an extended dry detention basin. It

has been determined that on-site drainage area to the basin will be 11.64 acres. This area has been calculated to be roughly 72% impervious. This results in a water quality volume of 1001.79 within the basin. A 4" orifice will be placed at the bottom elevation of the basin and will be only orifice opening below the water quality elevation. Thus, meeting the requirements for an extended dry detention basin.

The north watershed will not require detention as the drainage area will be reduced enough that proposed condition meets the allowable release rates without detention. Detention has been proposed within the south watershed. The basin has been designed so that the south watershed and the total site meet the allowable release rates. See Table 3 below for a comparison of the allowable and proposed runoff conditions for each watershed.

Table 3 - Comparison of Release Rates

Watershed	Storm Event	Allowable Release Rate	Proposed Release Rate
North	2-Year	1.77	1.45
	10-Year	7.08	2.75
	100-Year	10.62	4.55
South	2-Year	4.74	4.67
	10-Year	18.98	18.70
	100-Year	28.47	28.29
Total	2-Year	6.52	6.11
	10-Year	26.06	19.08
	100-Year	39.09	32.79

Additional Information regarding the basin design will be provided with the Final Stormwater Management Plan.

5.0 Permitting Requirements

5.1 FEMA/DWR

No FEMA regulatory floodplain exists onsite, and the entire property has been designated as Zone X; per Map Panel 29095C0417G of the Flood Insurance Rate Map dated January 20, 2017. Zone X is defined areas outside the 0.2% annual chance flood plain.

5.2 Stream Buffer


Per APWA 5600, stream buffers are not required for this project as there are no streams on the property with a contributing area over 40 acres.

6.0 Conclusion

This report and attached exhibits complete PEI's Preliminary Stormwater Management Plan for the Tudor Road Multi-Family development located southeast of the intersection of Douglas Street and Tudor Road in the City of Lee's Summit, Jackson County, Missouri. Please feel free to contact PEI at (913) 393-1155 if you require further information or have additional questions.

Sincerely,

PHELPS ENGINEERING, INC

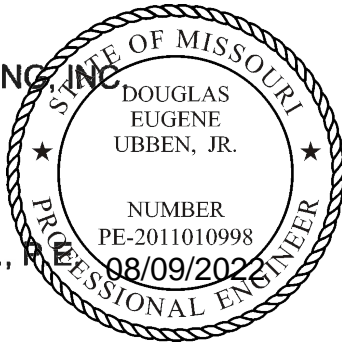

Douglas E. Ubben, Jr., P.E.

Kyle Deters E.I.T.
Kyle Deters, E.I.T.


Enclosures

Appendix A



Appendix B

Custom Soil Resource Report for **Jackson County, Missouri**

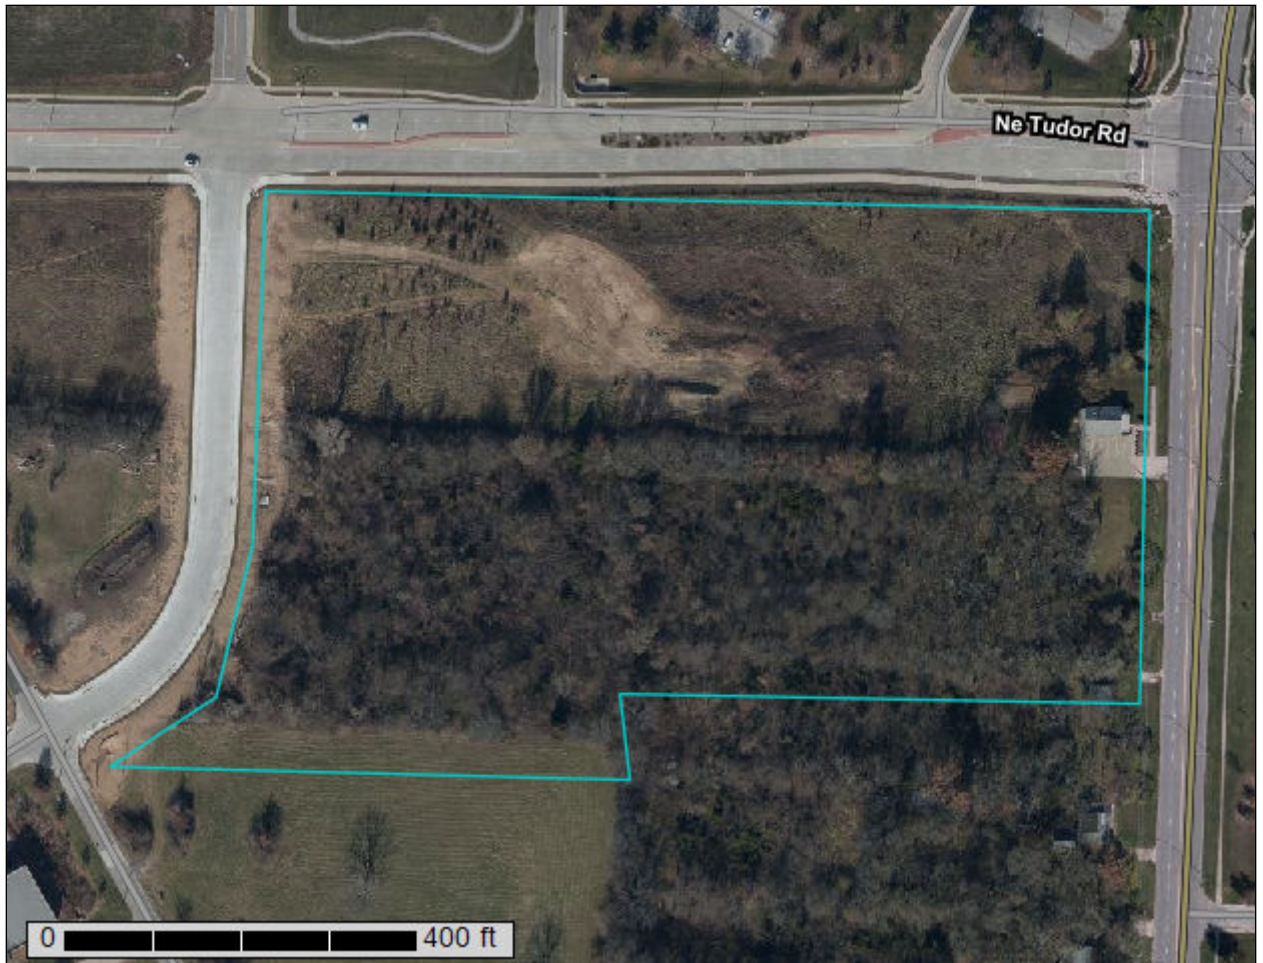

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Jackson County, Missouri.....	13
10082—Arisburg-Urban land complex, 1 to 5 percent slopes.....	13
10128—Sharpsburg-Urban land complex, 2 to 5 percent slopes.....	14
10129—Sharpsburg-Urban land complex, 5 to 9 percent slopes.....	16
10180—Udarents-Urban land-Sampsel complex, 2 to 5 percent slopes....	17
References	20

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Map Scale: 1:1,970 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 15N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)




















Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

Special Point Features

-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Jackson County, Missouri
 Survey Area Data: Version 23, Sep 1, 2021

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 6, 2019—Nov 16, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
10082	Arisburg-Urban land complex, 1 to 5 percent slopes	10.2	72.6%
10128	Sharpsburg-Urban land complex, 2 to 5 percent slopes	0.1	0.7%
10129	Sharpsburg-Urban land complex, 5 to 9 percent slopes	3.4	24.1%
10180	Udarents-Urban land-Sampsel complex, 2 to 5 percent slopes	0.4	2.6%
Totals for Area of Interest		14.1	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it

Custom Soil Resource Report

was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Jackson County, Missouri

10082—Arisburg-Urban land complex, 1 to 5 percent slopes

Map Unit Setting

National map unit symbol: 2w7ld
Elevation: 750 to 1,130 feet
Mean annual precipitation: 39 to 45 inches
Mean annual air temperature: 50 to 55 degrees F
Frost-free period: 177 to 220 days
Farmland classification: All areas are prime farmland

Map Unit Composition

Arisburg and similar soils: 61 percent
Urban land: 30 percent
Minor components: 9 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Arisburg

Setting

Landform: Interfluves
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Interfluve
Down-slope shape: Convex
Across-slope shape: Convex
Parent material: Loess

Typical profile

Ap - 0 to 6 inches: silt loam
A - 6 to 13 inches: silt loam
Bt - 13 to 19 inches: silty clay loam
Btg - 19 to 56 inches: silty clay loam
BCg - 56 to 79 inches: silty clay loam

Properties and qualities

Slope: 1 to 5 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat poorly drained
Capacity of the most limiting layer to transmit water (Ksat): Moderately high (0.20 to 0.60 in/hr)
Depth to water table: About 18 to 30 inches
Frequency of flooding: None
Frequency of ponding: None
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water supply, 0 to 60 inches: High (about 11.5 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 2e
Hydrologic Soil Group: C
Ecological site: R107BY007MO - Loess Upland Prairie
Hydric soil rating: No

Description of Urban Land

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 8
Hydric soil rating: No

Minor Components

Sampsel

Percent of map unit: 3 percent
Landform: Hills
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Side slope
Down-slope shape: Convex
Across-slope shape: Concave
Ecological site: R109XY010MO - Interbedded Sedimentary Upland Savanna
Hydric soil rating: Yes

Greenton

Percent of map unit: 3 percent
Landform: Hillslopes
Landform position (two-dimensional): Shoulder
Landform position (three-dimensional): Side slope
Down-slope shape: Convex
Across-slope shape: Convex
Ecological site: R109XY002MO - Loess Upland Prairie
Hydric soil rating: No

Sharpsburg

Percent of map unit: 3 percent
Landform: Ridges
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Interfluve
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R109XY002MO - Loess Upland Prairie
Hydric soil rating: No

10128—Sharpsburg-Urban land complex, 2 to 5 percent slopes

Map Unit Setting

National map unit symbol: 2ql09
Elevation: 1,000 to 1,300 feet
Mean annual precipitation: 33 to 41 inches
Mean annual air temperature: 50 to 55 degrees F
Frost-free period: 177 to 220 days
Farmland classification: All areas are prime farmland

Map Unit Composition

Sharpsburg and similar soils: 60 percent

Urban land: 35 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Sharpsburg

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loess

Typical profile

A - 0 to 17 inches: silt loam

Bt - 17 to 55 inches: silty clay loam

C - 55 to 60 inches: silty clay loam

Properties and qualities

Slope: 2 to 5 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Moderately well drained

Runoff class: High

Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 24 to 35 inches

Frequency of flooding: None

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: Very high (about 12.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: D

Ecological site: R109XY002MO - Loess Upland Prairie

Other vegetative classification: Grass/Prairie (Herbaceous Vegetation)

Hydric soil rating: No

Description of Urban Land

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 8

Hydric soil rating: No

10129—Sharpsburg-Urban land complex, 5 to 9 percent slopes

Map Unit Setting

National map unit symbol: 2q10b

Elevation: 1,000 to 1,300 feet

Mean annual precipitation: 33 to 41 inches

Mean annual air temperature: 50 to 55 degrees F

Frost-free period: 177 to 220 days

Farmland classification: Farmland of statewide importance

Map Unit Composition

Sharpsburg and similar soils: 60 percent

Urban land: 35 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Sharpsburg

Setting

Landform: Ridges

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Crest

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loess

Typical profile

A - 0 to 7 inches: silt loam

Bt - 7 to 48 inches: silty clay loam

C - 48 to 60 inches: silty clay loam

Properties and qualities

Slope: 5 to 9 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Moderately well drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 24 to 35 inches

Frequency of flooding: None

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: High (about 11.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: D

Ecological site: R109XY002MO - Loess Upland Prairie

Other vegetative classification: Grass/Prairie (Herbaceous Vegetation)

Hydric soil rating: No

Description of Urban Land

Setting

Landform: Ridges
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Crest

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 8
Hydric soil rating: No

10180—Udarents-Urban land-Sampsel complex, 2 to 5 percent slopes

Map Unit Setting

National map unit symbol: 1n85h
Elevation: 600 to 900 feet
Mean annual precipitation: 33 to 43 inches
Mean annual air temperature: 50 to 57 degrees F
Frost-free period: 175 to 220 days
Farmland classification: All areas are prime farmland

Map Unit Composition

Udarents and similar soils: 41 percent
Urban land: 39 percent
Sampsel and similar soils: 15 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Udarents

Setting

Landform position (two-dimensional): Summit
Landform position (three-dimensional): Crest
Down-slope shape: Convex
Across-slope shape: Convex
Parent material: Mine spoil or earthy fill

Typical profile

C1 - 0 to 5 inches: silt loam
C2 - 5 to 80 inches: silty clay loam

Properties and qualities

Slope: 2 to 5 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat poorly drained
Runoff class: Very high
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.14 to 0.57 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None

Custom Soil Resource Report

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: Moderate (about 9.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: C

Ecological site: R107BY002MO - Deep Loess Upland Prairie

Other vegetative classification: Mixed/Transitional (Mixed Native Vegetation)

Hydric soil rating: No

Description of Urban Land

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Across-slope shape: Convex

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 8

Hydric soil rating: No

Description of Sampsel

Setting

Landform: Hillslopes

Landform position (two-dimensional): Footslope

Landform position (three-dimensional): Base slope

Down-slope shape: Concave

Across-slope shape: Convex

Parent material: Residuum weathered from shale

Typical profile

Ap - 0 to 13 inches: silty clay loam

Bt - 13 to 80 inches: silty clay

Properties and qualities

Slope: 2 to 5 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Somewhat poorly drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 0 to 18 inches

Frequency of flooding: None

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: Moderate (about 8.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: C/D

Ecological site: R109XY010MO - Interbedded Sedimentary Upland Savanna

Other vegetative classification: Grass/Prairie (Herbaceous Vegetation)

Custom Soil Resource Report

Hydric soil rating: No

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report


United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

Appendix C

\\phelps-arw\projects\220231\formwork\Exhibits\Exhibits.dwg Layout:Existing Conditions A1 Aug 09, 2022 9:50am Kyle Delers

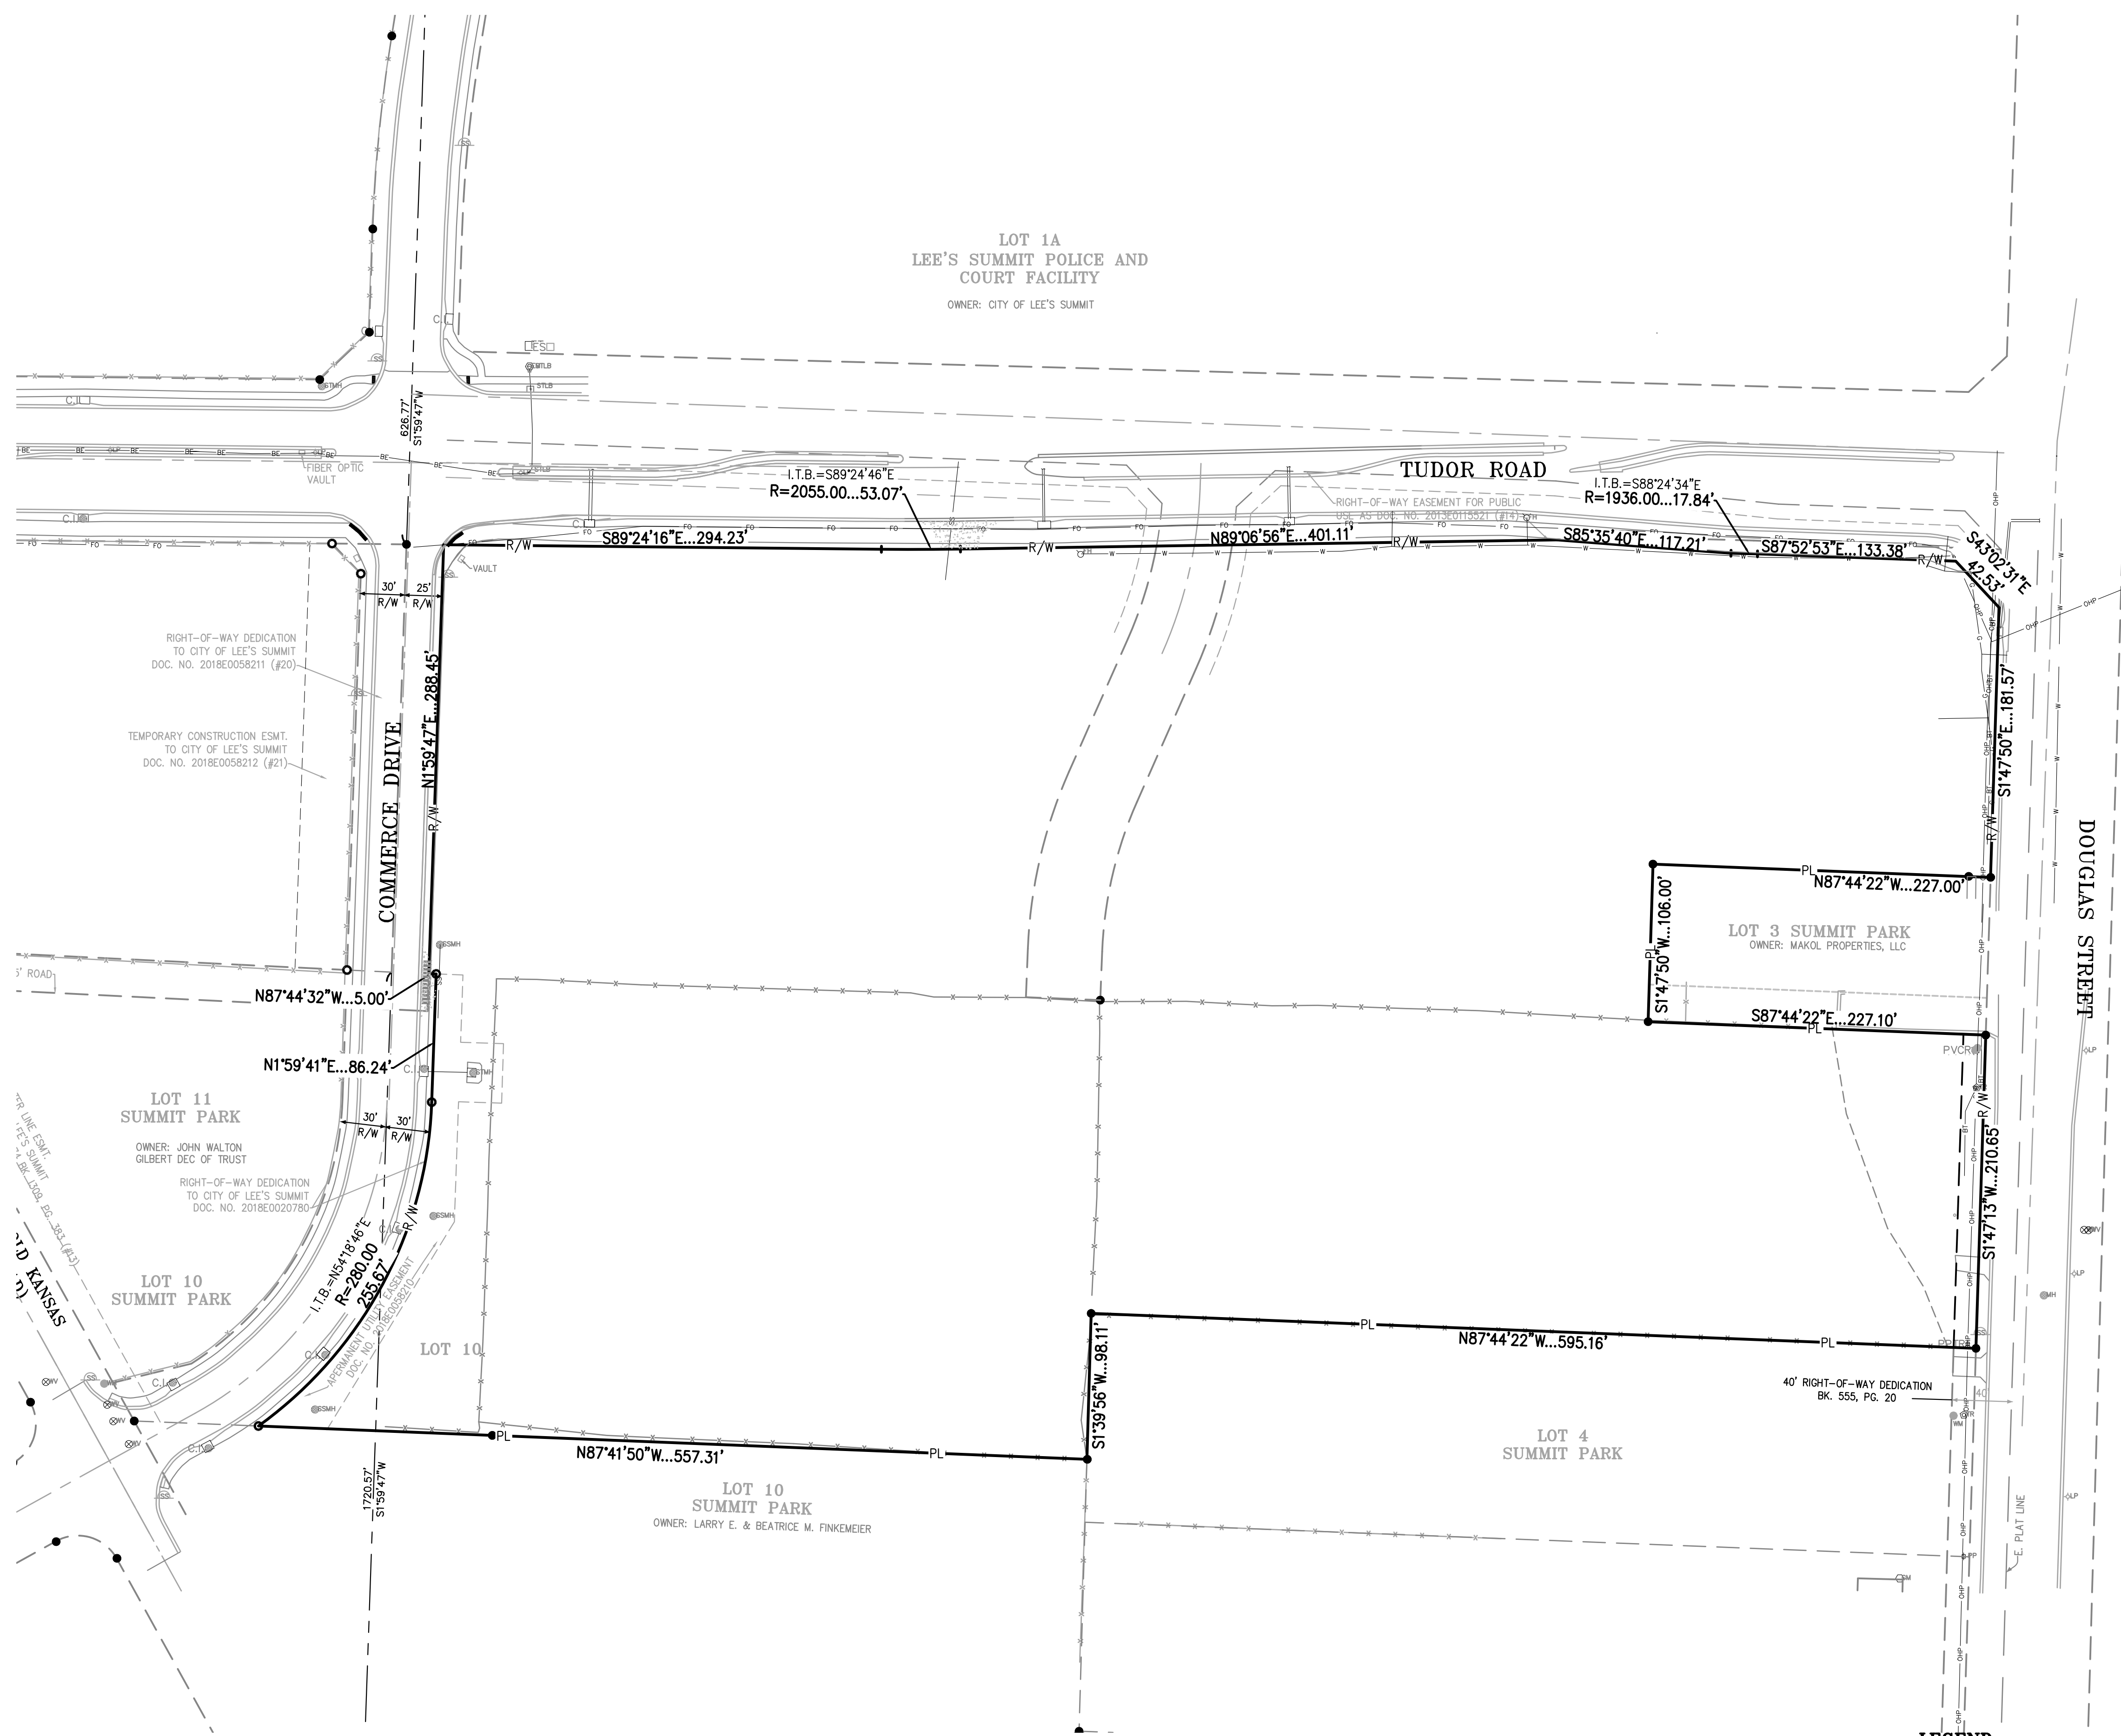

EXISTING IMPERVIOUS AREA = 0 S.F.

LEGEND

- PL — PROPERTY LINE
- LOT LINE
- - - R/W - - - RIGHT-OF-WAY
- IMPERVIOUS
- OPEN SPACE
- - - DRAINAGE BOUNDARY FOR LOS VALUE RATING CALCULATION

SCALE: 1"=60'

0' 60' 120'

811
Know what's below.
Call before you dig.

UTILITY NOTES:
VISUAL INDICATIONS OF UTILITIES ARE AS SHOWN. UNDERGROUND LOCATIONS SHOWN, AS FURNISHED BY THEIR LESSORS, ARE APPROXIMATE AND SHOULD BE VERIFIED IN THE FIELD AT THE TIME OF CONSTRUCTION. FOR ACTUAL FIELD LOCATIONS OF UNDERGROUND UTILITIES CALL 811.

PHILIPS ENGINEERING, INC.
1570 N. Winchester
Olathe, Kansas 66066
(913) 993-1155
Fax (913) 993-1165
www.philipsengineering.com


PLANNING
ENGINEERING
IMPLEMENTATION

EXISTING CONDITIONS MAP
TUDOR MULTIFAMILY

PROJECT NO.	No.	Date	By	App.	Revisions:
220231	1.	08-09-22	B.J.G.	DEU	CITY COMMENTS
DATE: 08-23-2022	DRAWN BY: B.J.G.	CHECKED BY: DEU	APPROVED BY: DEU	CORPORATE AUTHORIZATION	LAND SURVEYING - LS-82
ENGINEERING - E-361	CERTIFICATE OF AUTHORIZATION	LAND SURVEYING - 200701028	ENGINEERING - 200700038		

1/2" 20' WATERLINE ESMT.
BK. 600.3, PG. 101
(C4-#11)

LOT 1A
LEE'S SUMMIT POLICE AND
COURT FACILITY
OWNER: CITY OF LEE'S SUMMIT

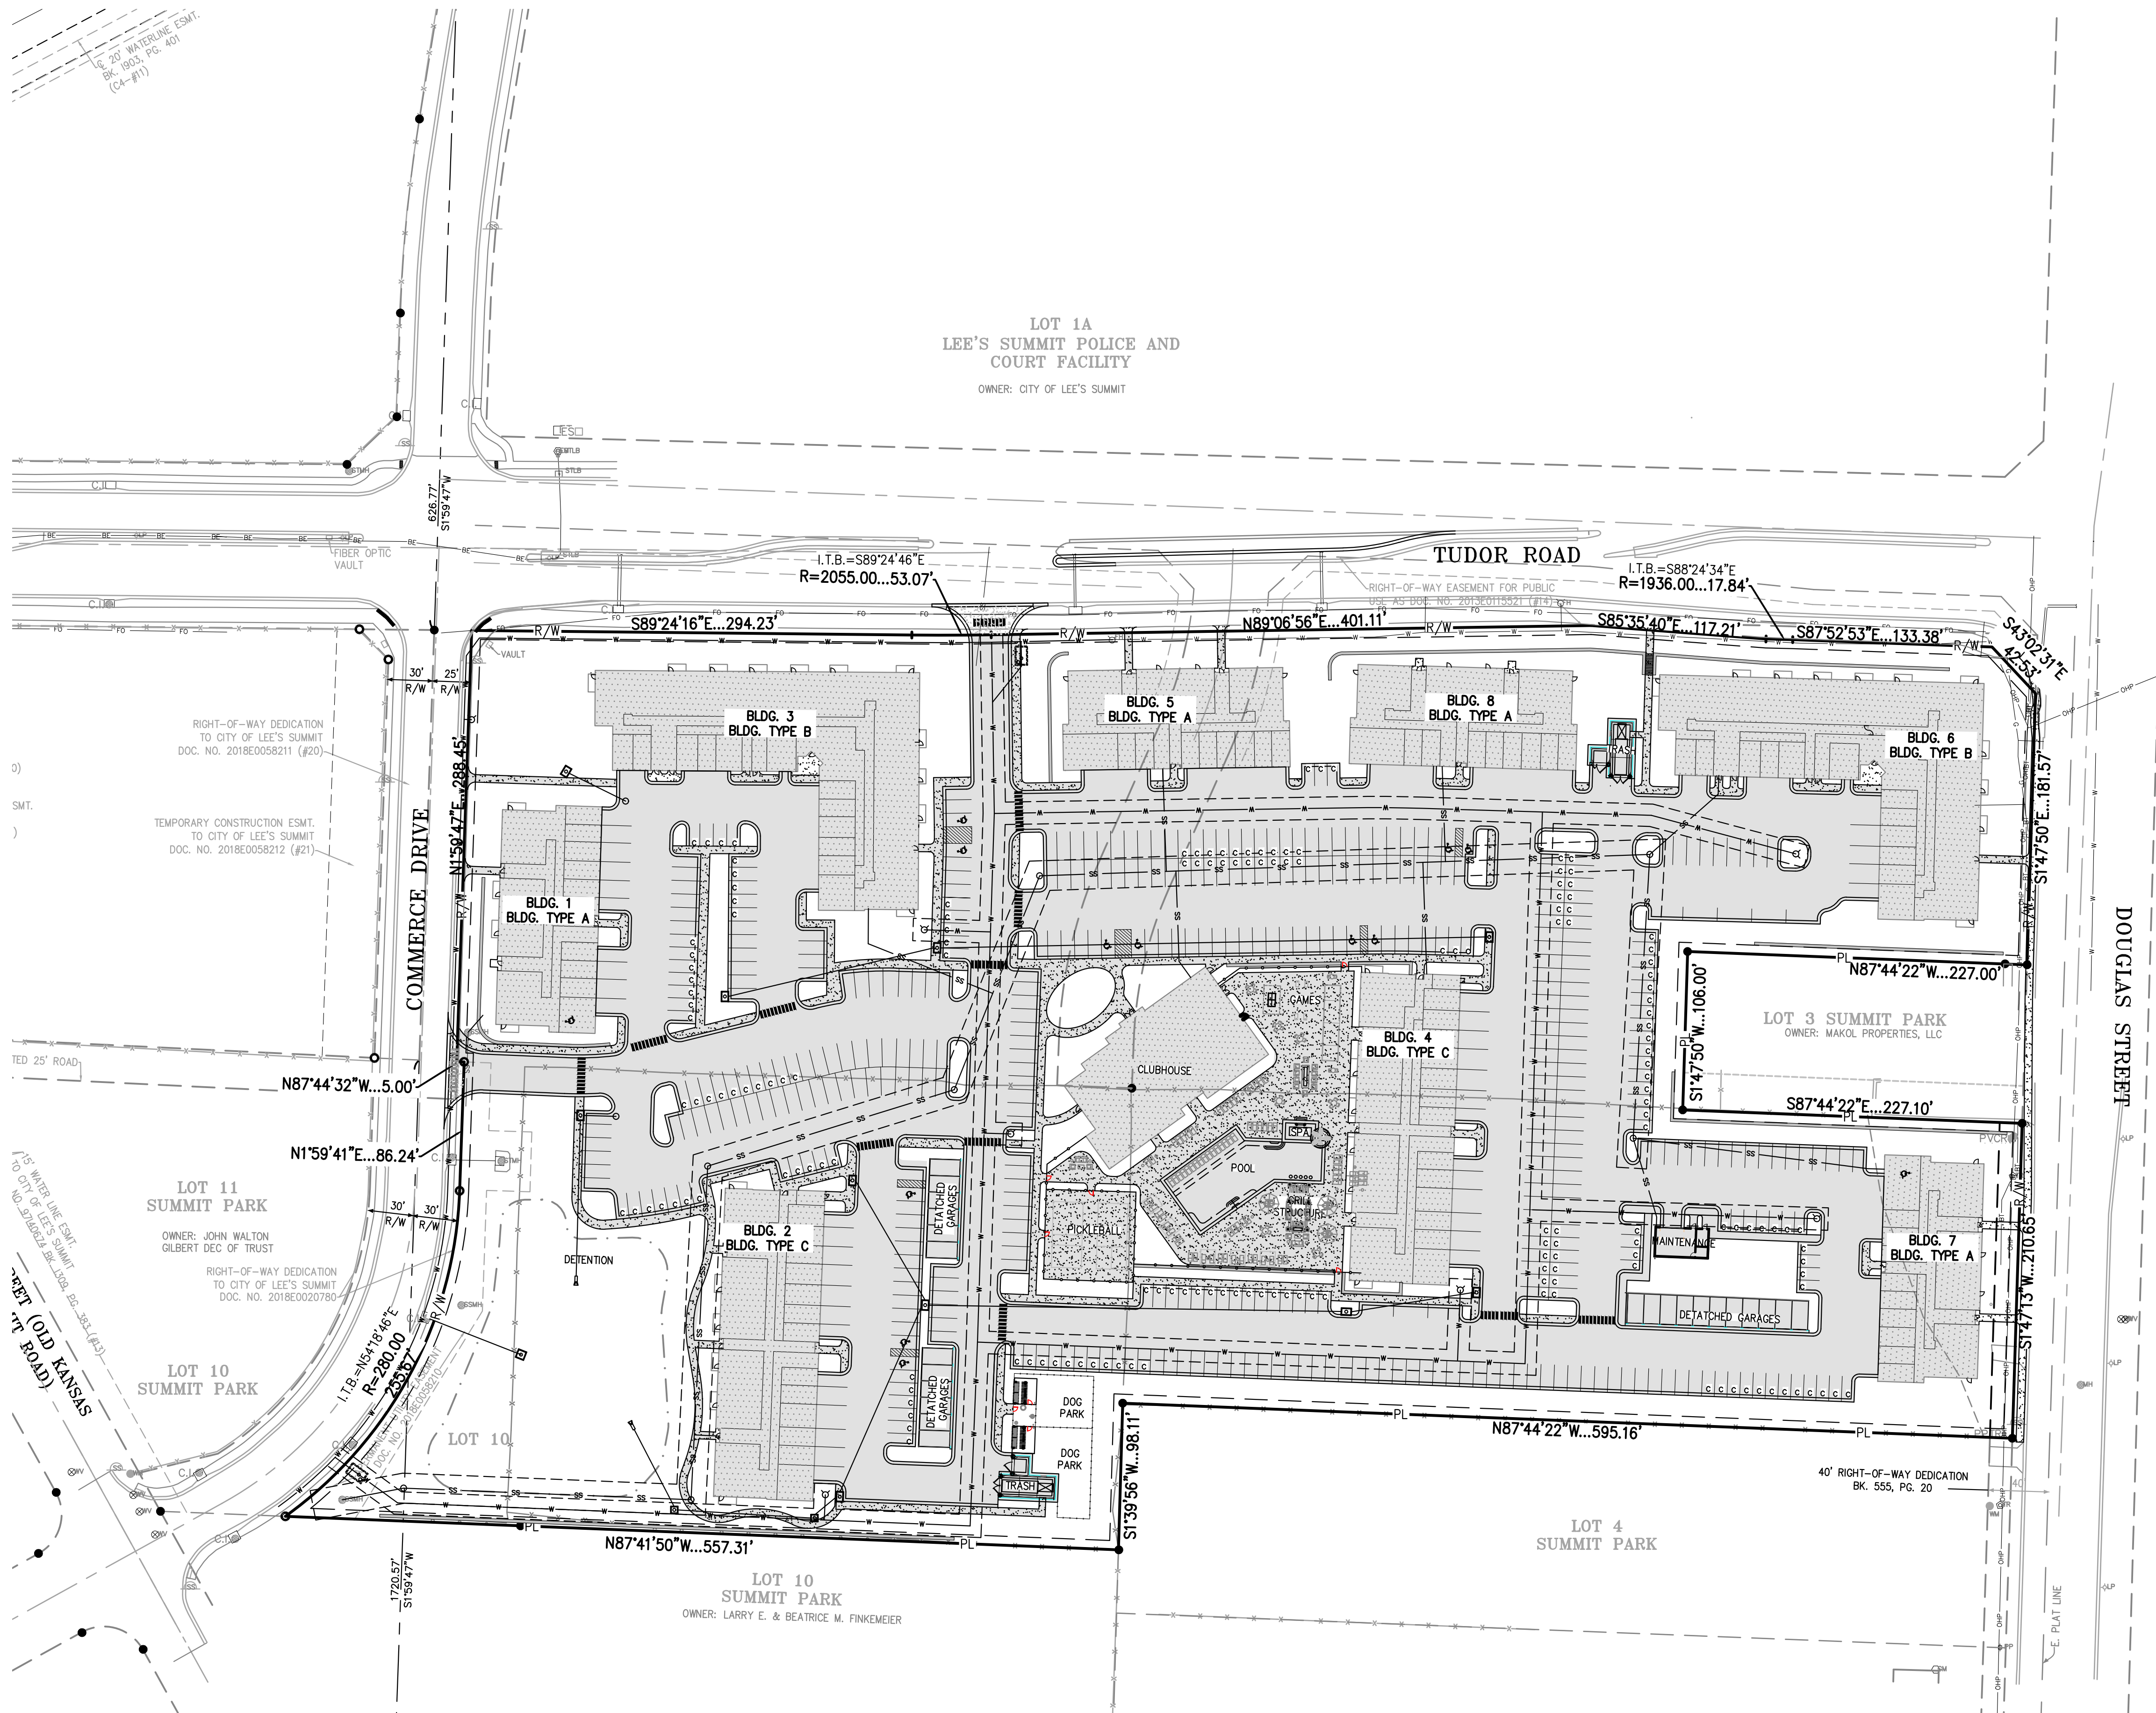


PROPOSED IMPERVIOUS AREA = 388,685 S.F.

LOT 11
SUMMIT PARK
OWNER: JOHN WALTON
GILBERT DEC OF TRUST

LOT 10
SUMMIT PARK
OWNER: LARRY E. & BEATRICE M. FINKEMEIER

- LEGEND**
- PL — PROPERTY LINE
 - LOT LINE
 - - - R/W - - - RIGHT-OF-WAY
 - IMPERVIOUS
 - OPEN SPACE
 - - - DRAINAGE BOUNDARY FOR LOS VALUE RATING CALCULATION

UTILITY NOTES:
VISUAL INDICATIONS OF UTILITIES ARE AS SHOWN.
UNDERGROUND LOCATIONS SHOWN, AS FURNISHED BY THEIR LESSORS, ARE APPROXIMATE AND SHOULD BE VERIFIED IN THE FIELD AT THE TIME OF CONSTRUCTION. FOR ACTUAL FIELD LOCATIONS OF UNDERGROUND UTILITIES CALL 811.

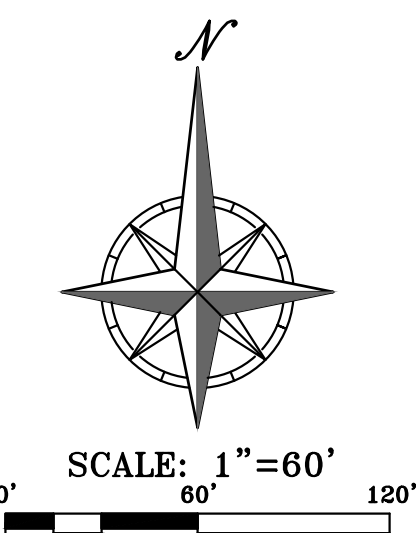

PHELPS ENGINEERING, INC.
1270 N. Winchester
Olathe, Kansas 66066
(913) 993-1155
Fax (913) 993-1165
www.phelpsengineering.com

PLANNING
ENGINEERING
IMPLEMENTATION

PROPOSED CONDITIONS MAP
TUDOR MULTIFAMILY


Project No.	No.	Date	By	App.	Revisions:
220231	1.	08-09-22	BJG	DEU	CITY COMMENTS

SHEET
A2

\phelps-engineering\projects\220231\formwork\Exhibits\Exhibits.dwg Layout: Proposed Conditions A2 Aug 09, 2022 - 9:50am Kyle Detert

Appendix D


\\phelps-engineering.com\projects\220231\formwork\ Exhibits\ Exhibits.dwg Layout: Existing Drainage B1 Aug 05, 2022 - 11:06am Kyle Delers

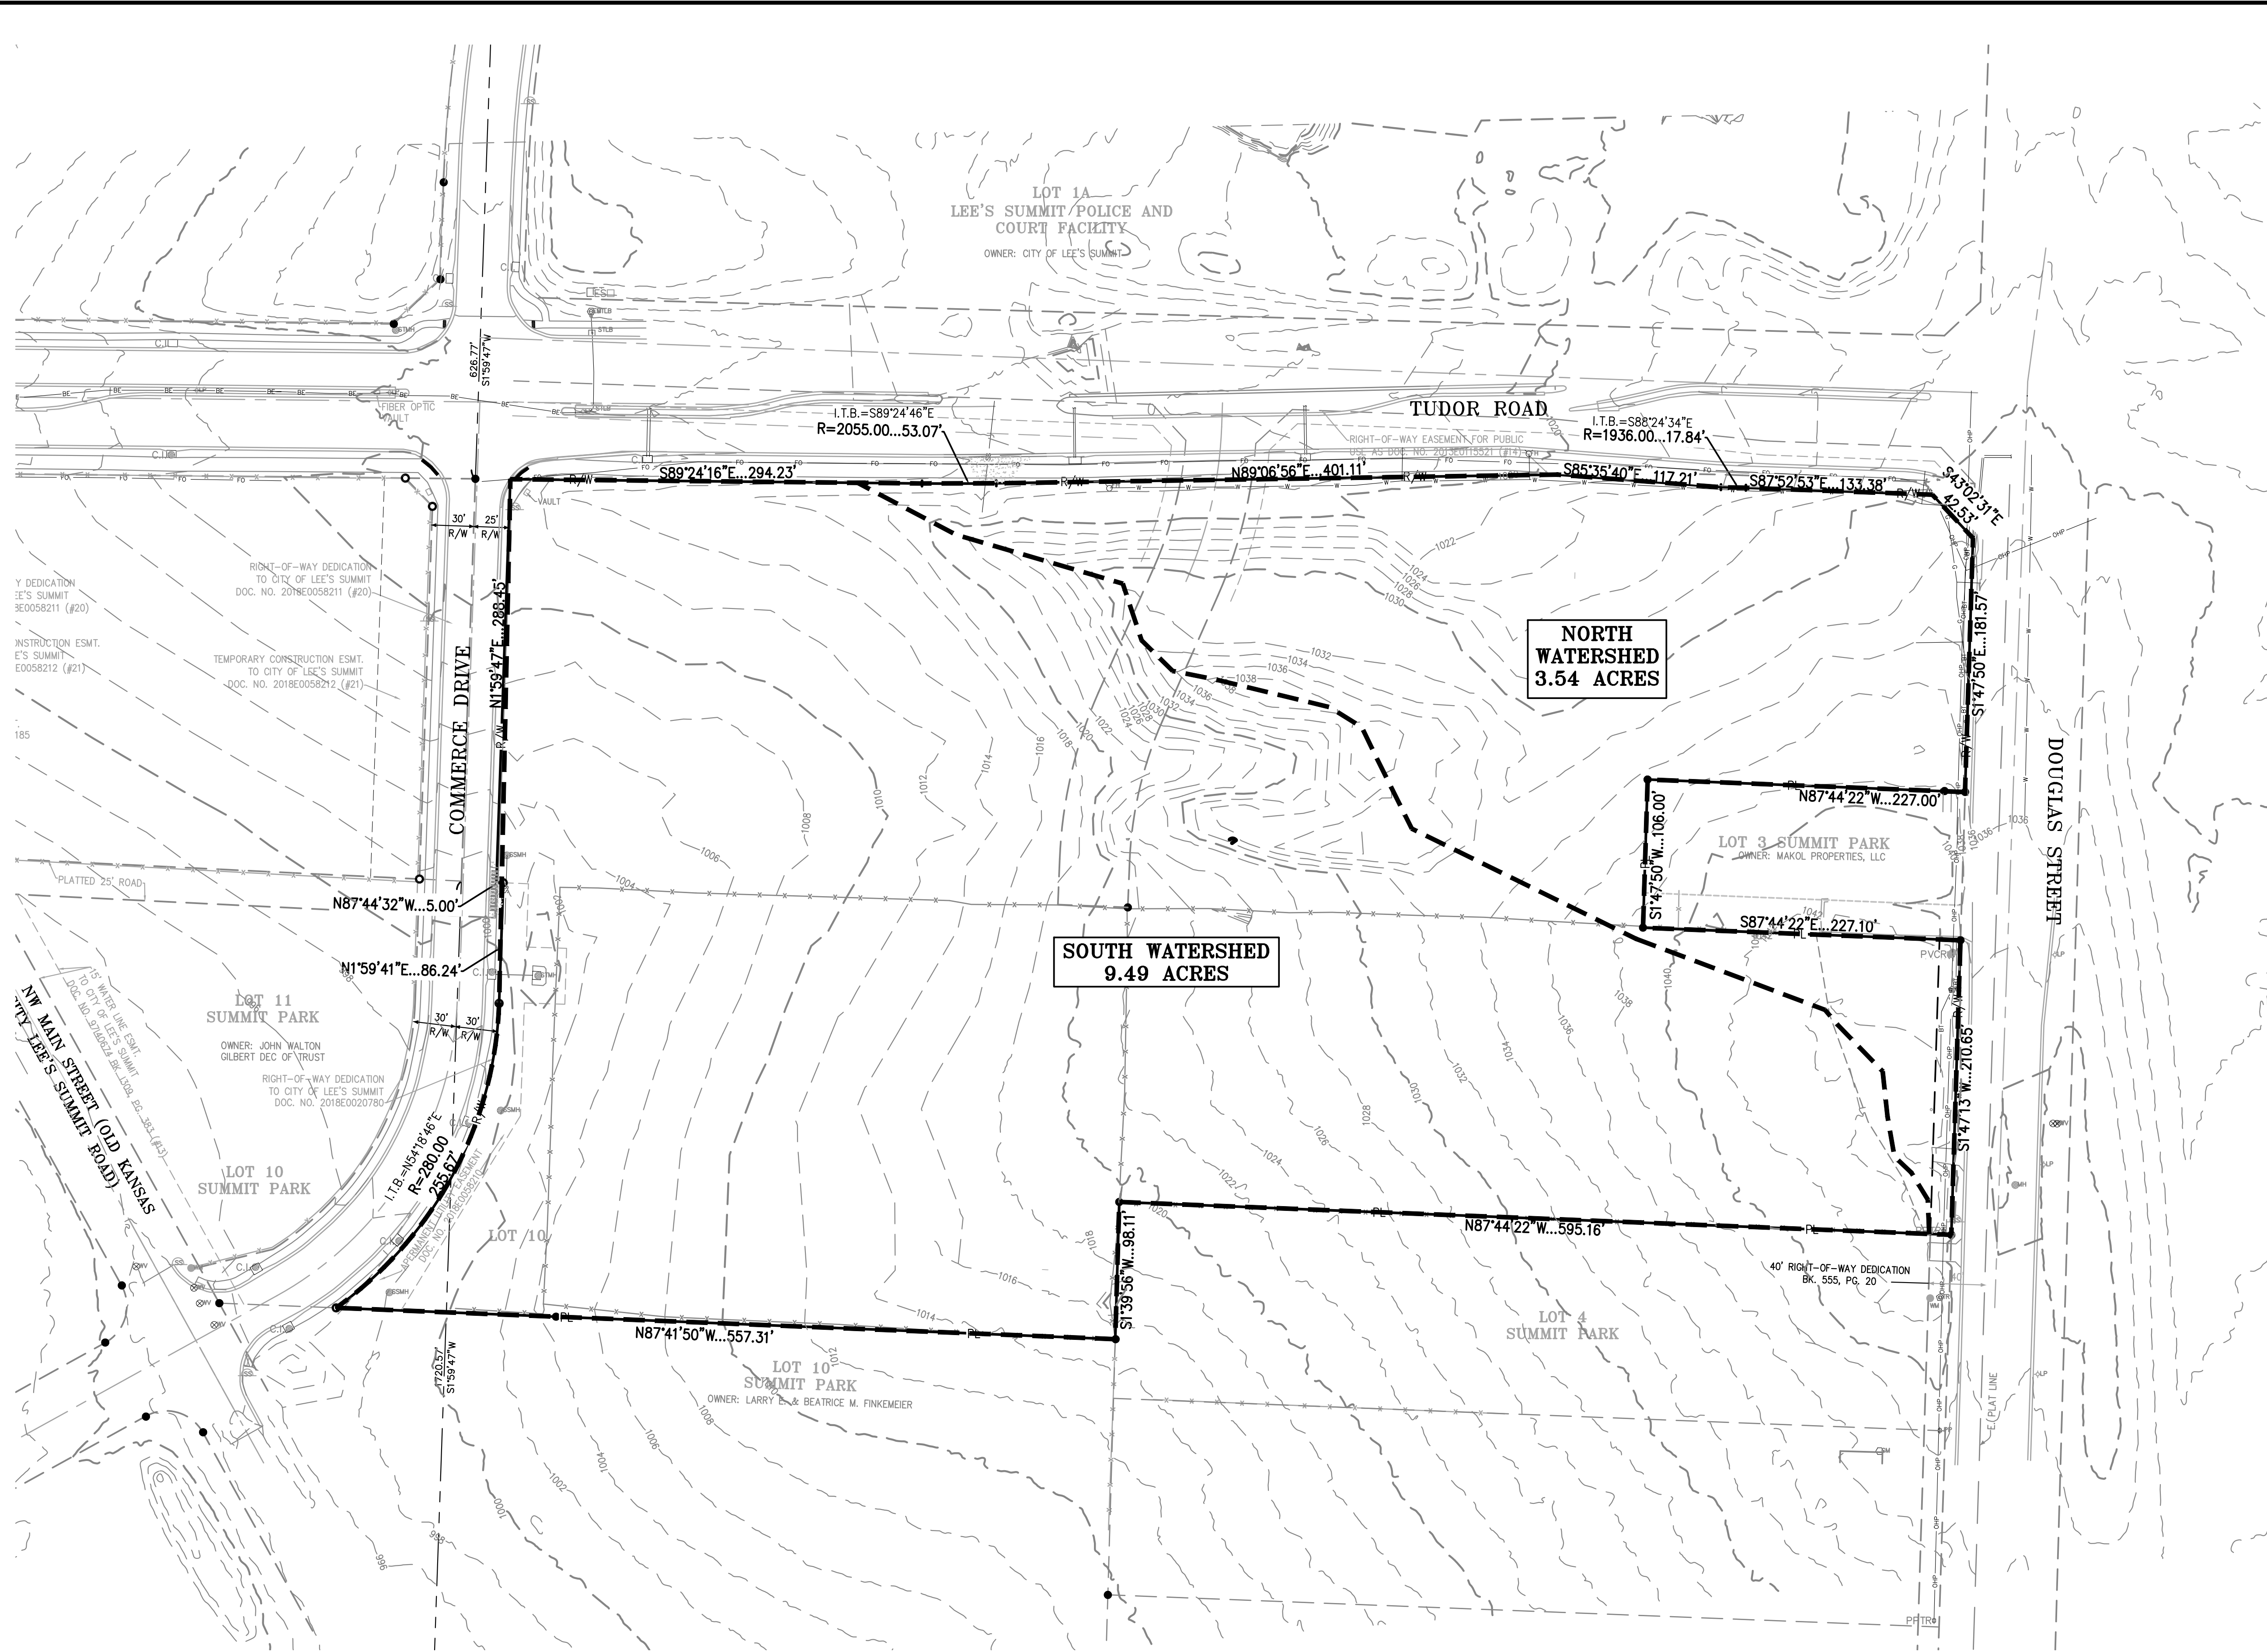

Know what's below.
Call before you dig.

UTILITY NOTES:
VISUAL INDICATIONS OF UTILITIES ARE AS SHOWN.
UNDERGROUND LOCATIONS SHOWN, AS FURNISHED BY THEIR LESSORS, ARE APPROXIMATE AND SHOULD BE VERIFIED IN THE FIELD AT THE TIME OF CONSTRUCTION. FOR ACTUAL FIELD LOCATIONS OF UNDERGROUND UTILITIES CALL 811.

- LEGEND**
- PL — PROPERTY LINE
 - LOT LINE
 - - - R/W - - - RIGHT-OF-WAY
 - DRAINAGE BOUNDARY FOR LOS VALUE RATING CALCULATION

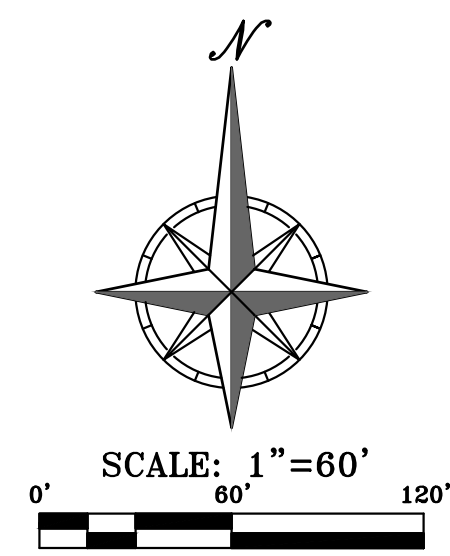


PHelps ENGINEERING, INC.
1370 N. Winchester
Olathe, Kansas 66066
(913) 993-1155
Fax (913) 993-1165
www.phelpsengineering.com

PLANNING
ENGINEERING
IMPLEMENTATION

EXISTING DRAINAGE MAP
TUDOR MULTIFAMILY

PROJECT NO.	No.	Date	By	App.	Revisions:
220231	1.	08-09-22	B.J.G.	DEU	CITY COMMENTS
DATE: 08-23-2022	DRAWN: B.J.G.	CHECKED: DEU	APPROVED: DEU	CORPORATE AUTHORIZATION	LAND SURVEYING - LS-82
ENGINEERING - E-91	GEOTECHNICAL AUTHORIZATION	LAND SURVEYING - 200701028	ENGINEERING - 200705038		


SHEET
B1

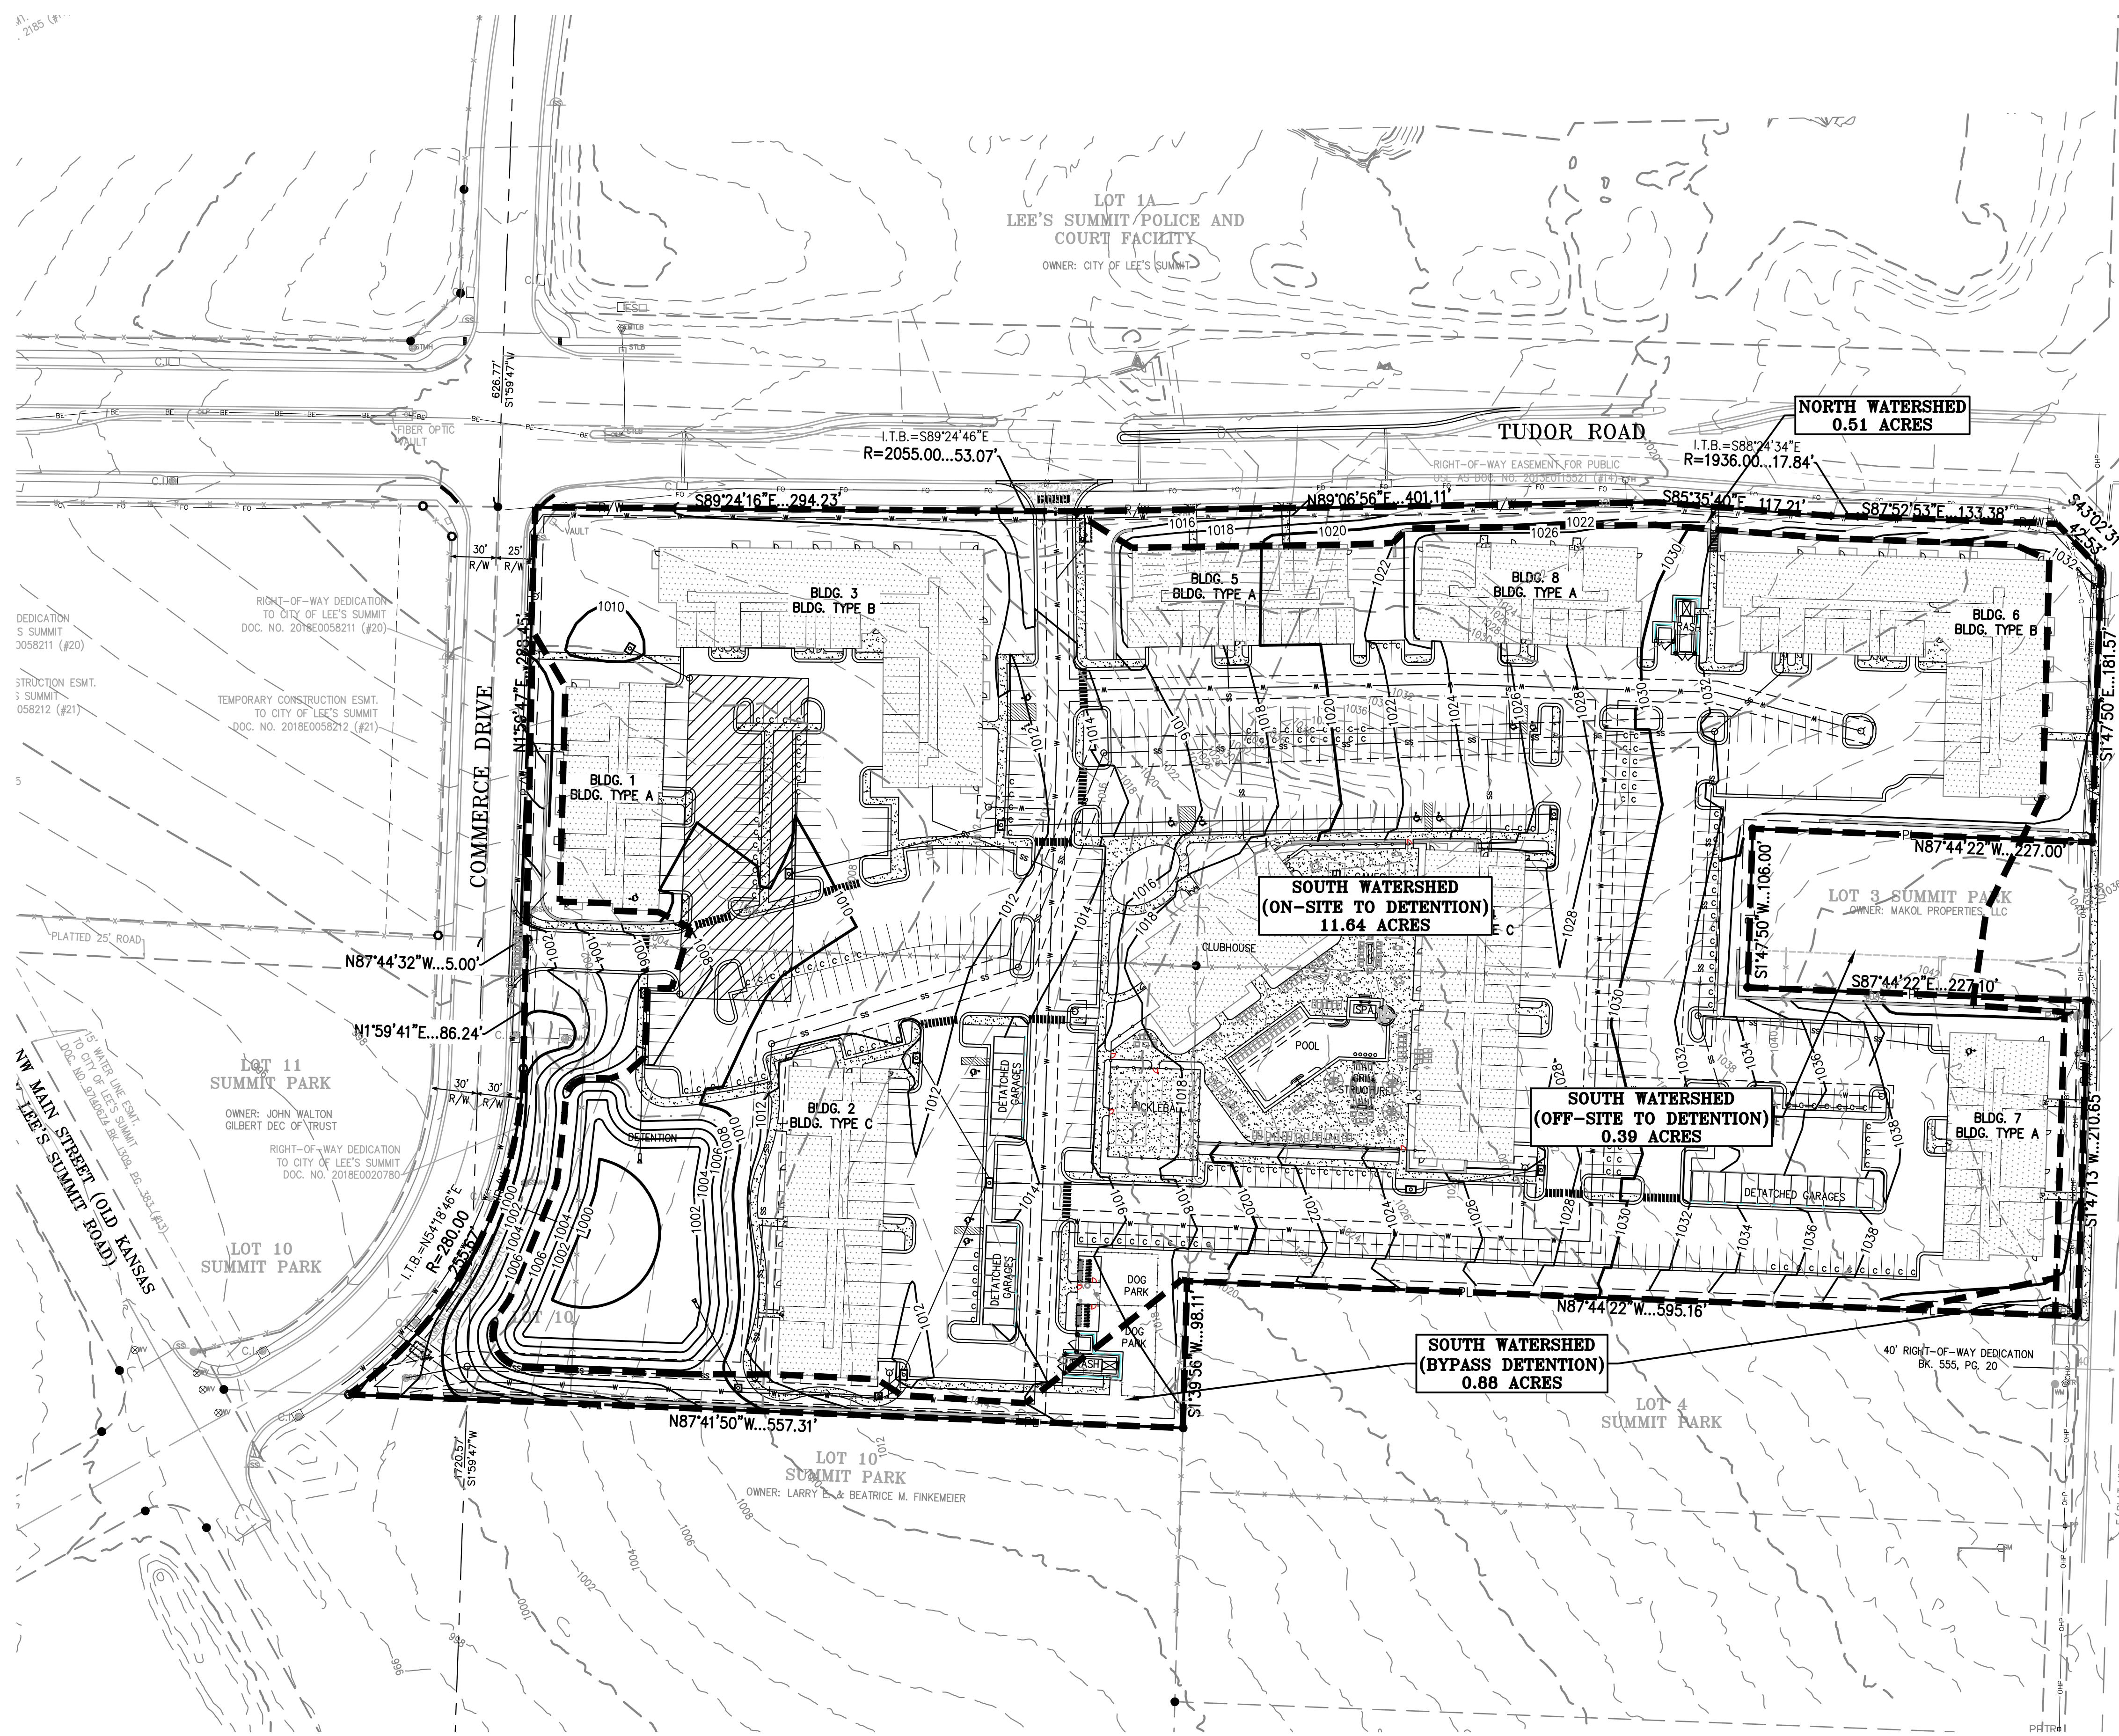

UTILITY NOTES:
 VISUAL INDICATIONS OF UTILITIES ARE AS SHOWN.
 UNDERGROUND LOCATIONS SHOWN, AS FURNISHED BY THEIR LESSORS, ARE APPROXIMATE AND SHOULD BE VERIFIED IN THE FIELD AT THE TIME OF CONSTRUCTION. FOR ACTUAL FIELD LOCATIONS OF UNDERGROUND UTILITIES CALL 811.

LEGEND

- PL — PROPERTY LINE
- LOT LINE
- - - R/W - - - RIGHT-OF-WAY
- - - DRAINAGE BOUNDARY
- - - FOR LOS VALUE RATING CALCULATION

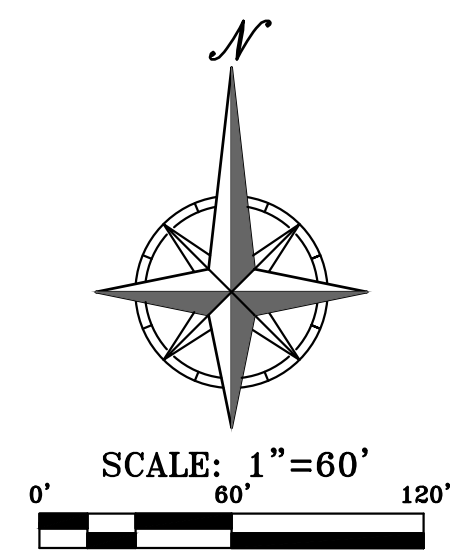

PHELPS ENGINEERING, INC.
 1270 N. Winchester
 Olathe, Kansas 66066
 (913) 993-1155
 Fax: (913) 993-1165
 www.phelpsengineering.com

PLANNING
 ENGINEERING
 IMPLEMENTATION

PROPOSED DRAINAGE MAP
 TUDOR MULTIFAMILY

PROJECT NO.	No.	Date	By	App.
220231	1.	08-09-22	BIG	DEU

Revisions:	Revisions:
CITY COMMENTS	

DATE	BY	DESCRIPTION
08-09-22	BIG	APPROVED DEU
		CERTIFICATE OF AUTHORIZATION
		LAND SURVEYING - LS-82
		ENGINEERING - E-391
		CERTIFICATE OF AUTHORIZATION
		LAND SURVEYING-200701028
		ENGINEERING-200705038

\phelps-new\projects\220231\formwork\Exhibits\Exhibits.dwg Layout:Proposed Drainage B2 Aug 09, 2022 9:50am Kyle Delers

Design Procedure Form: Extended Dry Detention Basin Main Worksheet

Designer: KAD
Checked By: DEU
Company: Phelps Engineering, Inc
Date: 8/8/2022
Project: Tudor Apartments
Location: Lee's Summit, Mo

I. Basin Water Quality Volume

Step 1) Tributary area to EDW, A_T (ac) A_T (ac) = 11.6

Step 2) Calculate WQv using methodology in Section 6 WQv (ac-ft) = 0.9

IIIb. Water Quality Outlet Type

Step 1) Set water quality outlet type: Outlet Type = 1
 Type 1 = single orifice
 Type 2 = perforated riser or plate
 Type 3 = v-notch weir

Step 2) Proceed to part IIIb, IIIC, or IIID based on water quality outlet type selected.

IIIb. Water Quality Pool Outlet, Single Orifice

Step 1) Depth of water quality volume above permanent pool, Z_{WQ} (ft) Z_{WQ} (ft) = 2.79

Step 2) Average head of water quality volume over invert of orifice, H_{WQ} (ft)
 $H_{WQ} = 0.5 * Z_{WQ}$ H_{WQ} (ft) = 1.4

Step 3) Average water quality outflow rate, Q_{WQ} (cfs)
 $Q_{WQ} = (WQv * 43,560)/(40 * 3,600)$ Q_{WQ} (cfs) = 0.28

Step 4) Set value of orifice discharge coefficient, C_o
 $C_o = 0.66$ when thickness of riser/weir plate is = or < orifice diameter
 $C_o = 0.80$ when thickness of riser/weir plate is > orifice diameter C_o = 0.66

Step 5) Water quality outlet orifice diameter (minimum of 4 inches), D_o (in)
 $D_o = 12 * 2 * (Q_{WQ}/(C_o * \pi * (2 * g * H)^{0.5}))^{0.5}$ D_o (in) = 2.87
 (If orifice diameter < 4 inches, use outlet type 2 or 3)

Step 6) To size outlet orifice for EDW with an irregular stage-volume relationship, use the Single Orifice Work

IIIC. Water Quality Outlet, Perforated Riser

Step 1) Depth of water quality volume above permanent pool, Z_{WQ} (ft) Z_{WQ} (ft) = 2.79




Step 2) Recommended maximum outlet area per row, A_o (in²)
 $A_o = WQv/(0.013 * Z_{WQ}^2 + 0.22 * Z_{WQ} - 0.10)$ A_o (in²) = 1.51

Step 3) Circular perforation diameter per row assuming a single column, D_1 (in)	D_1 (in) = <u>1.4</u>
Step 4) Number of columns, n_c	$n_c =$
Step 5) Design circular perforation diameter (between 1 and 2 inches), D_{perf} (in)	D_{perf} (in) = <u>1.0</u>
Step 6) Horizontal perforation column spacing when $n_c > 1$, center to center, S_c If $D_{perf} \geq 1.0$ in, $S_c = 4$	S_c (in) = <u>NA</u>
Step 7) Number of rows (4" vertical spacing between perforations, center to center), n_r	$n_r =$ <u>8</u>

IIId. Water Quality Outlet, V-Notch Weir

Step 1) Depth of water quality volume above permanent pool, Z_{WQ} (ft)	Z_{WQ} (ft) = 2.79
Step 2) Average head of water quality pool volume over invert of v-notch, H_{WQ} (ft) $H_{WQ} = 0.5 * Z_{WQ}$	H_{WQ} (ft) = <u>1.4</u>
Step 3) Average water quality pool outflow rate, Q_{WQ} (cfs) $Q_{WQ} = (WQV * 43,560)/(40 * 3,600)$	Q_{WQ} (cfs) = <u>0.28</u>
Step 4) V-notch weir coefficient, C_v	$C_v =$ 2.5
Step 5) V-notch weir angle, θ (deg) $\theta = 2 * \arctan(Q_{WQ}/(C_v * H_{WQ}^{5/2}))$ V-notch angle should be at least 20 degrees. Set to 20 degrees if calculated angle is smaller.	θ (deg, 20 min) = <u>20</u>
Step 6) V-notch weir top width, W_v (ft) $W_v = 2 * Z_{WQ} * \text{TAN}(\theta/2)$	W_v (ft) = <u>0.98</u> Height (ft) = <u>2.79</u>

Step 7) To calculate v-notch angle for EDW with an irregular stage-volume relationship, use the V-notch Weir

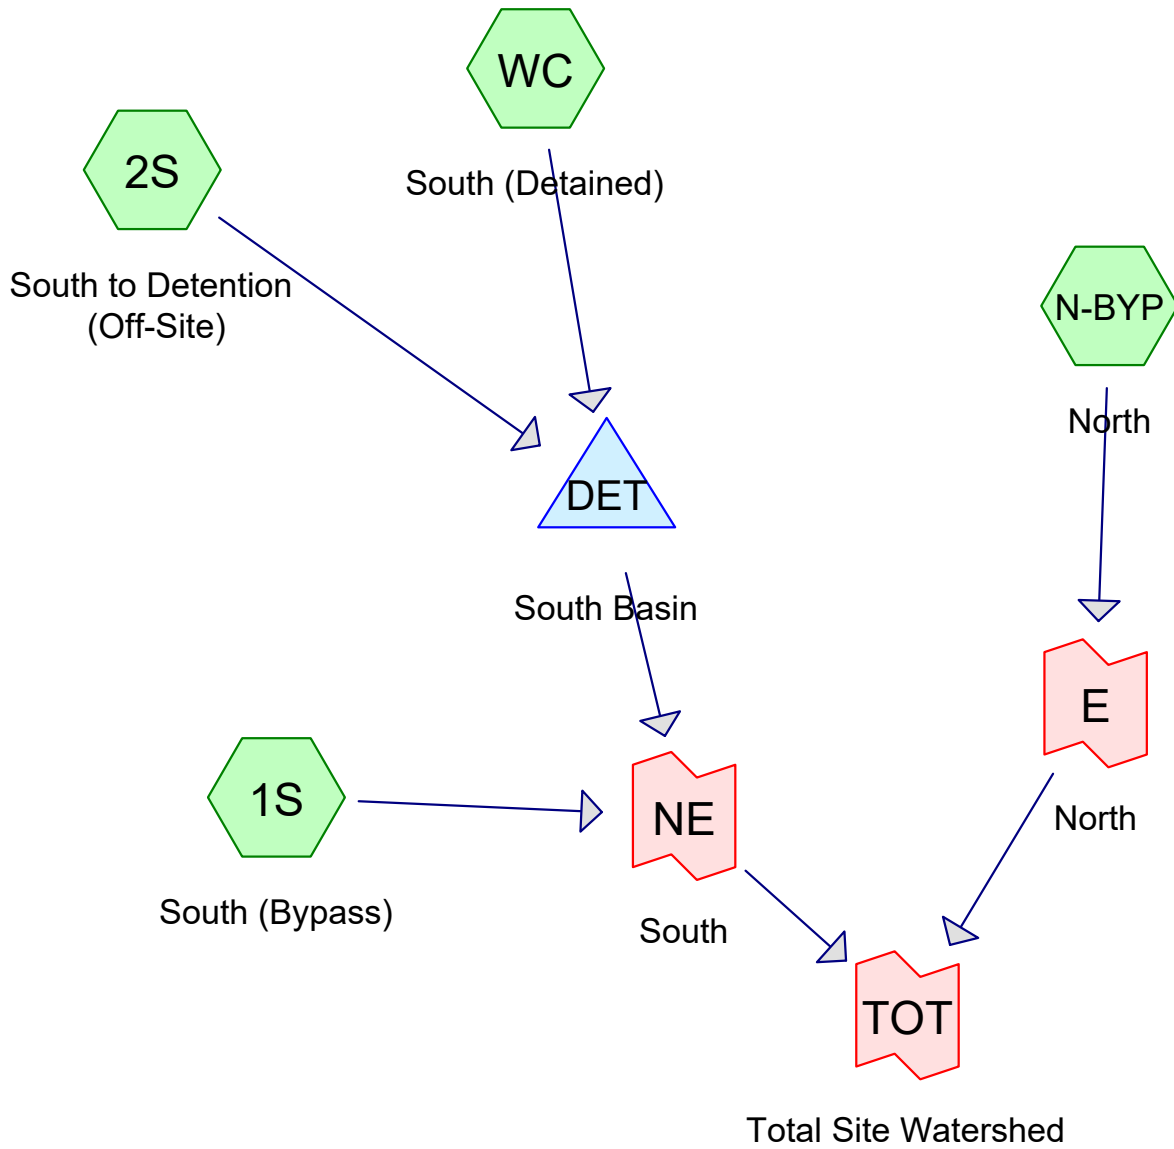

Routing Diagram for Proposed
 Prepared by {enter your company name here}, Printed 8/9/2022
 HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Printed 8/9/2022

Page 2

Rainfall Events Listing (selected events)

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Year	Type II 24-hr		Default	24.00	1	3.50	2
2	10-Year	Type II 24-hr		Default	24.00	1	5.30	2
3	100-Year	Type II 24-hr		Default	24.00	1	7.70	2

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Printed 8/9/2022

Page 3

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
4.150	80	>75% Grass cover, Good, HSG D (1S, N-BYP, WC)
8.920	98	Paved parking, HSG D (1S, WC)
0.390	93	Urban industrial, 72% imp, HSG D (2S)
13.460	92	TOTAL AREA

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Printed 8/9/2022

Page 4

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
13.460	HSG D	1S, 2S, N-BYP, WC
0.000	Other	
13.460		TOTAL AREA

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Printed 8/9/2022

Page 5

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	4.150	0.000	4.150	>75% Grass cover, Good	1S, N-BYP, WC
0.000	0.000	0.000	8.920	0.000	8.920	Paved parking	1S, WC
0.000	0.000	0.000	0.390	0.000	0.390	Urban industrial, 72% imp	2S
0.000	0.000	0.000	13.460	0.000	13.460	TOTAL AREA	

Proposed

Type II 24-hr 2-Year Rainfall=3.50"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 6

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: South (Bypass)	Runoff Area=0.920 ac 68.48% Impervious	Runoff Depth=2.64"
	Tc=6.2 min CN=92	Runoff=4.05 cfs 0.202 af
Subcatchment2S: South to Detention	Runoff Area=0.390 ac 72.00% Impervious	Runoff Depth=2.73"
	Tc=12.1 min CN=93	Runoff=1.45 cfs 0.089 af
SubcatchmentN-BYP: North	Runoff Area=0.510 ac 0.00% Impervious	Runoff Depth=1.64"
	Tc=6.8 min CN=80	Runoff=1.45 cfs 0.070 af
SubcatchmentWC: South (Detained)	Runoff Area=11.640 ac 71.22% Impervious	Runoff Depth=2.73"
	Tc=11.8 min CN=93	Runoff=43.66 cfs 2.653 af
Pond DET: South Basin	Peak Elev=1,003.26' Storage=74,827 cf	Inflow=45.11 cfs 2.742 af
		Outflow=1.89 cfs 2.505 af
Link E: North		Inflow=1.45 cfs 0.070 af
		Primary=1.45 cfs 0.070 af
Link NE: South		Inflow=4.67 cfs 2.707 af
		Primary=4.67 cfs 2.707 af
Link TOT: Total Site Watershed		Inflow=6.11 cfs 2.777 af
		Primary=6.11 cfs 2.777 af

Total Runoff Area = 13.460 ac Runoff Volume = 3.013 af Average Runoff Depth = 2.69"
31.64% Pervious = 4.259 ac 68.36% Impervious = 9.201 ac

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 7

Summary for Subcatchment 1S: South (Bypass)

Runoff = 4.05 cfs @ 11.97 hrs, Volume= 0.202 af, Depth= 2.64"
Routed to Link NE : South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 2-Year Rainfall=3.50"

Area (ac)	CN	Description
0.630	98	Paved parking, HSG D
0.290	80	>75% Grass cover, Good, HSG D
0.920	92	Weighted Average
0.290		31.52% Pervious Area
0.630		68.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2					Direct Entry,

Subcatchment 1S: South (Bypass)

Hydrograph

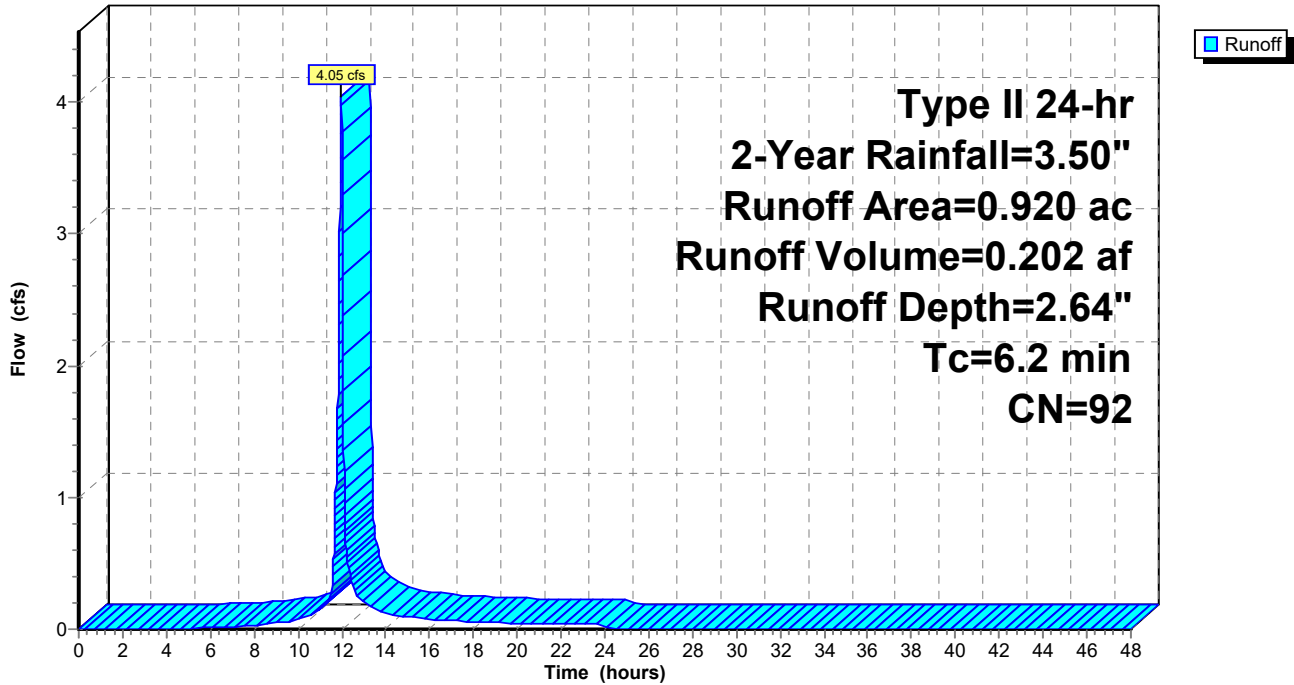

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 8

Hydrograph for Subcatchment 1S: South (Bypass)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.50	2.64	0.00
0.50	0.02	0.00	0.00	26.50	3.50	2.64	0.00
1.00	0.04	0.00	0.00	27.00	3.50	2.64	0.00
1.50	0.06	0.00	0.00	27.50	3.50	2.64	0.00
2.00	0.08	0.00	0.00	28.00	3.50	2.64	0.00
2.50	0.10	0.00	0.00	28.50	3.50	2.64	0.00
3.00	0.12	0.00	0.00	29.00	3.50	2.64	0.00
3.50	0.14	0.00	0.00	29.50	3.50	2.64	0.00
4.00	0.17	0.00	0.00	30.00	3.50	2.64	0.00
4.50	0.19	0.00	0.00	30.50	3.50	2.64	0.00
5.00	0.22	0.00	0.00	31.00	3.50	2.64	0.00
5.50	0.25	0.01	0.01	31.50	3.50	2.64	0.00
6.00	0.28	0.01	0.01	32.00	3.50	2.64	0.00
6.50	0.31	0.02	0.02	32.50	3.50	2.64	0.00
7.00	0.35	0.03	0.02	33.00	3.50	2.64	0.00
7.50	0.38	0.04	0.02	33.50	3.50	2.64	0.00
8.00	0.42	0.05	0.03	34.00	3.50	2.64	0.00
8.50	0.46	0.07	0.04	34.50	3.50	2.64	0.00
9.00	0.51	0.10	0.05	35.00	3.50	2.64	0.00
9.50	0.57	0.12	0.05	35.50	3.50	2.64	0.00
10.00	0.63	0.16	0.07	36.00	3.50	2.64	0.00
10.50	0.71	0.21	0.10	36.50	3.50	2.64	0.00
11.00	0.82	0.28	0.15	37.00	3.50	2.64	0.00
11.50	0.99	0.40	0.26	37.50	3.50	2.64	0.00
12.00	2.32	1.53	3.77	38.00	3.50	2.64	0.00
12.50	2.57	1.76	0.33	38.50	3.50	2.64	0.00
13.00	2.70	1.88	0.20	39.00	3.50	2.64	0.00
13.50	2.80	1.97	0.15	39.50	3.50	2.64	0.00
14.00	2.87	2.04	0.12	40.00	3.50	2.64	0.00
14.50	2.93	2.10	0.10	40.50	3.50	2.64	0.00
15.00	2.99	2.15	0.09	41.00	3.50	2.64	0.00
15.50	3.04	2.20	0.08	41.50	3.50	2.64	0.00
16.00	3.08	2.24	0.07	42.00	3.50	2.64	0.00
16.50	3.12	2.27	0.07	42.50	3.50	2.64	0.00
17.00	3.16	2.31	0.06	43.00	3.50	2.64	0.00
17.50	3.19	2.34	0.06	43.50	3.50	2.64	0.00
18.00	3.22	2.37	0.06	44.00	3.50	2.64	0.00
18.50	3.25	2.40	0.05	44.50	3.50	2.64	0.00
19.00	3.28	2.43	0.05	45.00	3.50	2.64	0.00
19.50	3.31	2.45	0.04	45.50	3.50	2.64	0.00
20.00	3.33	2.48	0.04	46.00	3.50	2.64	0.00
20.50	3.35	2.50	0.04	46.50	3.50	2.64	0.00
21.00	3.38	2.52	0.04	47.00	3.50	2.64	0.00
21.50	3.40	2.54	0.04	47.50	3.50	2.64	0.00
22.00	3.42	2.56	0.04	48.00	3.50	2.64	0.00
22.50	3.44	2.58	0.04				
23.00	3.46	2.60	0.04				
23.50	3.48	2.62	0.04				
24.00	3.50	2.64	0.03				
24.50	3.50	2.64	0.00				
25.00	3.50	2.64	0.00				
25.50	3.50	2.64	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 9

Summary for Subcatchment 2S: South to Detention (Off-Site)

Runoff = 1.45 cfs @ 12.03 hrs, Volume= 0.089 af, Depth= 2.73"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 2-Year Rainfall=3.50"

Area (ac)	CN	Description
0.390	93	Urban industrial, 72% imp, HSG D
0.109		28.00% Pervious Area
0.281		72.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.1					Direct Entry,

Subcatchment 2S: South to Detention (Off-Site)

Hydrograph

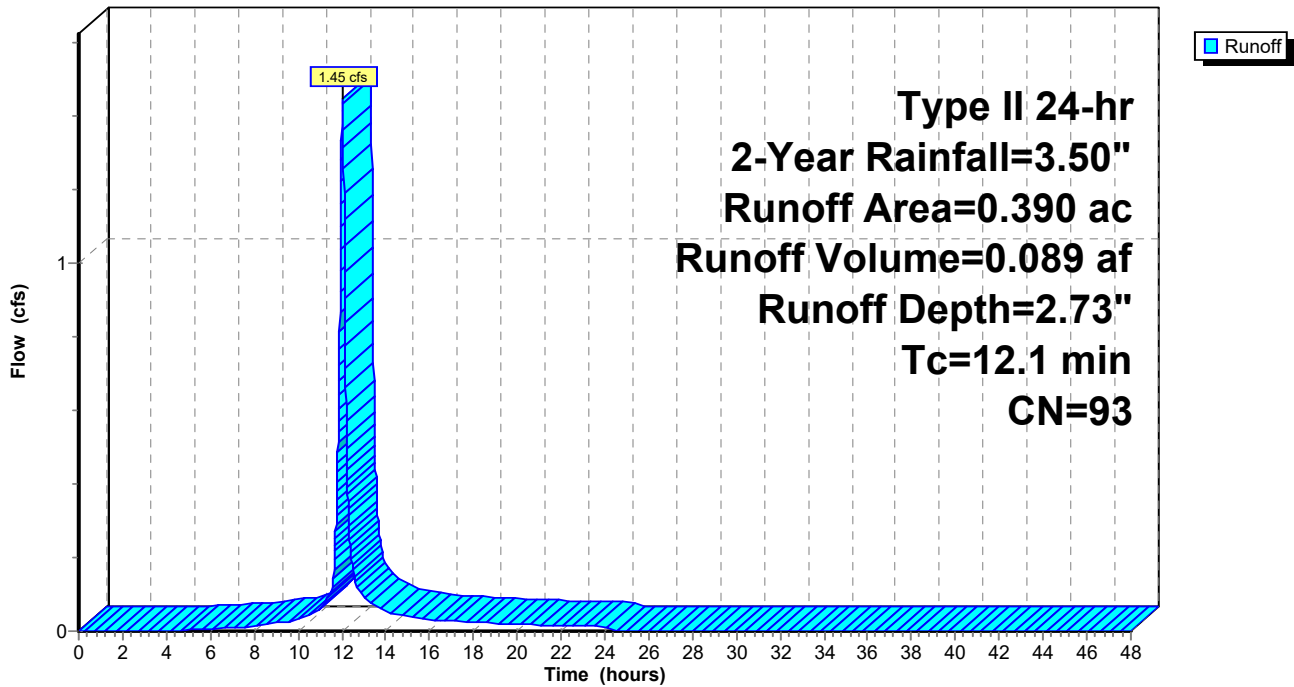

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 10

Hydrograph for Subcatchment 2S: South to Detention (Off-Site)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.50	2.73	0.00
0.50	0.02	0.00	0.00	26.50	3.50	2.73	0.00
1.00	0.04	0.00	0.00	27.00	3.50	2.73	0.00
1.50	0.06	0.00	0.00	27.50	3.50	2.73	0.00
2.00	0.08	0.00	0.00	28.00	3.50	2.73	0.00
2.50	0.10	0.00	0.00	28.50	3.50	2.73	0.00
3.00	0.12	0.00	0.00	29.00	3.50	2.73	0.00
3.50	0.14	0.00	0.00	29.50	3.50	2.73	0.00
4.00	0.17	0.00	0.00	30.00	3.50	2.73	0.00
4.50	0.19	0.00	0.00	30.50	3.50	2.73	0.00
5.00	0.22	0.01	0.00	31.00	3.50	2.73	0.00
5.50	0.25	0.01	0.00	31.50	3.50	2.73	0.00
6.00	0.28	0.02	0.01	32.00	3.50	2.73	0.00
6.50	0.31	0.03	0.01	32.50	3.50	2.73	0.00
7.00	0.35	0.04	0.01	33.00	3.50	2.73	0.00
7.50	0.38	0.05	0.01	33.50	3.50	2.73	0.00
8.00	0.42	0.07	0.01	34.00	3.50	2.73	0.00
8.50	0.46	0.09	0.02	34.50	3.50	2.73	0.00
9.00	0.51	0.12	0.02	35.00	3.50	2.73	0.00
9.50	0.57	0.15	0.03	35.50	3.50	2.73	0.00
10.00	0.63	0.19	0.03	36.00	3.50	2.73	0.00
10.50	0.71	0.24	0.04	36.50	3.50	2.73	0.00
11.00	0.82	0.32	0.06	37.00	3.50	2.73	0.00
11.50	0.99	0.44	0.11	37.50	3.50	2.73	0.00
12.00	2.32	1.61	1.38	38.00	3.50	2.73	0.00
12.50	2.57	1.85	0.18	38.50	3.50	2.73	0.00
13.00	2.70	1.97	0.09	39.00	3.50	2.73	0.00
13.50	2.80	2.06	0.07	39.50	3.50	2.73	0.00
14.00	2.87	2.13	0.05	40.00	3.50	2.73	0.00
14.50	2.93	2.19	0.05	40.50	3.50	2.73	0.00
15.00	2.99	2.24	0.04	41.00	3.50	2.73	0.00
15.50	3.04	2.29	0.04	41.50	3.50	2.73	0.00
16.00	3.08	2.33	0.03	42.00	3.50	2.73	0.00
16.50	3.12	2.37	0.03	42.50	3.50	2.73	0.00
17.00	3.16	2.40	0.03	43.00	3.50	2.73	0.00
17.50	3.19	2.44	0.03	43.50	3.50	2.73	0.00
18.00	3.22	2.47	0.02	44.00	3.50	2.73	0.00
18.50	3.25	2.50	0.02	44.50	3.50	2.73	0.00
19.00	3.28	2.52	0.02	45.00	3.50	2.73	0.00
19.50	3.31	2.55	0.02	45.50	3.50	2.73	0.00
20.00	3.33	2.57	0.02	46.00	3.50	2.73	0.00
20.50	3.35	2.59	0.02	46.50	3.50	2.73	0.00
21.00	3.38	2.62	0.02	47.00	3.50	2.73	0.00
21.50	3.40	2.64	0.02	47.50	3.50	2.73	0.00
22.00	3.42	2.66	0.02	48.00	3.50	2.73	0.00
22.50	3.44	2.68	0.02				
23.00	3.46	2.70	0.02				
23.50	3.48	2.72	0.02				
24.00	3.50	2.73	0.01				
24.50	3.50	2.73	0.00				
25.00	3.50	2.73	0.00				
25.50	3.50	2.73	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 11

Summary for Subcatchment N-BYP: North

Runoff = 1.45 cfs @ 11.98 hrs, Volume= 0.070 af, Depth= 1.64"

Routed to Link E : North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 2-Year Rainfall=3.50"

Area (ac)	CN	Description
0.510	80	>75% Grass cover, Good, HSG D
0.510		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8					Direct Entry,

Subcatchment N-BYP: North

Hydrograph

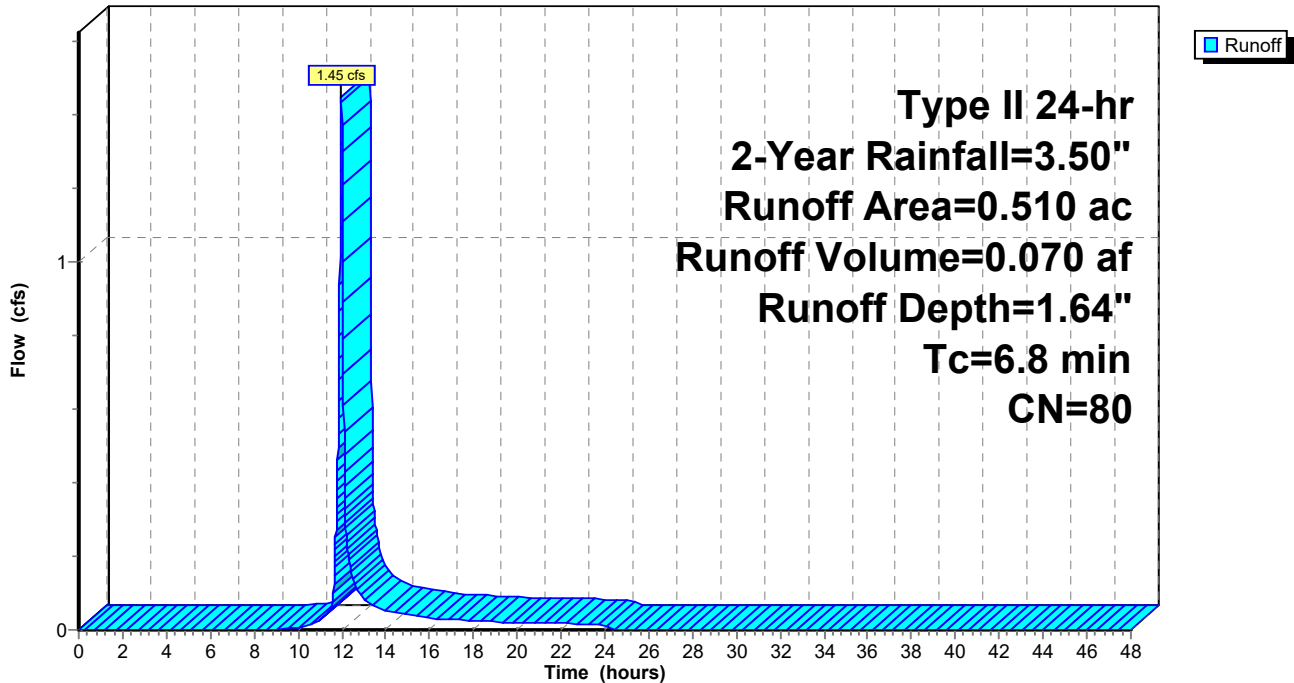

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 12

Hydrograph for Subcatchment N-BYP: North

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.50	1.64	0.00
0.50	0.02	0.00	0.00	26.50	3.50	1.64	0.00
1.00	0.04	0.00	0.00	27.00	3.50	1.64	0.00
1.50	0.06	0.00	0.00	27.50	3.50	1.64	0.00
2.00	0.08	0.00	0.00	28.00	3.50	1.64	0.00
2.50	0.10	0.00	0.00	28.50	3.50	1.64	0.00
3.00	0.12	0.00	0.00	29.00	3.50	1.64	0.00
3.50	0.14	0.00	0.00	29.50	3.50	1.64	0.00
4.00	0.17	0.00	0.00	30.00	3.50	1.64	0.00
4.50	0.19	0.00	0.00	30.50	3.50	1.64	0.00
5.00	0.22	0.00	0.00	31.00	3.50	1.64	0.00
5.50	0.25	0.00	0.00	31.50	3.50	1.64	0.00
6.00	0.28	0.00	0.00	32.00	3.50	1.64	0.00
6.50	0.31	0.00	0.00	32.50	3.50	1.64	0.00
7.00	0.35	0.00	0.00	33.00	3.50	1.64	0.00
7.50	0.38	0.00	0.00	33.50	3.50	1.64	0.00
8.00	0.42	0.00	0.00	34.00	3.50	1.64	0.00
8.50	0.46	0.00	0.00	34.50	3.50	1.64	0.00
9.00	0.51	0.00	0.00	35.00	3.50	1.64	0.00
9.50	0.57	0.00	0.00	35.50	3.50	1.64	0.00
10.00	0.63	0.01	0.01	36.00	3.50	1.64	0.00
10.50	0.71	0.02	0.01	36.50	3.50	1.64	0.00
11.00	0.82	0.04	0.02	37.00	3.50	1.64	0.00
11.50	0.99	0.08	0.06	37.50	3.50	1.64	0.00
12.00	2.32	0.77	1.42	38.00	3.50	1.64	0.00
12.50	2.57	0.94	0.14	38.50	3.50	1.64	0.00
13.00	2.70	1.03	0.09	39.00	3.50	1.64	0.00
13.50	2.80	1.10	0.07	39.50	3.50	1.64	0.00
14.00	2.87	1.15	0.05	40.00	3.50	1.64	0.00
14.50	2.93	1.20	0.05	40.50	3.50	1.64	0.00
15.00	2.99	1.24	0.04	41.00	3.50	1.64	0.00
15.50	3.04	1.28	0.04	41.50	3.50	1.64	0.00
16.00	3.08	1.31	0.03	42.00	3.50	1.64	0.00
16.50	3.12	1.34	0.03	42.50	3.50	1.64	0.00
17.00	3.16	1.37	0.03	43.00	3.50	1.64	0.00
17.50	3.19	1.39	0.03	43.50	3.50	1.64	0.00
18.00	3.22	1.42	0.03	44.00	3.50	1.64	0.00
18.50	3.25	1.44	0.02	44.50	3.50	1.64	0.00
19.00	3.28	1.47	0.02	45.00	3.50	1.64	0.00
19.50	3.31	1.49	0.02	45.50	3.50	1.64	0.00
20.00	3.33	1.50	0.02	46.00	3.50	1.64	0.00
20.50	3.35	1.52	0.02	46.50	3.50	1.64	0.00
21.00	3.38	1.54	0.02	47.00	3.50	1.64	0.00
21.50	3.40	1.56	0.02	47.50	3.50	1.64	0.00
22.00	3.42	1.57	0.02	48.00	3.50	1.64	0.00
22.50	3.44	1.59	0.02				
23.00	3.46	1.61	0.02				
23.50	3.48	1.62	0.02				
24.00	3.50	1.64	0.02				
24.50	3.50	1.64	0.00				
25.00	3.50	1.64	0.00				
25.50	3.50	1.64	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 13

Summary for Subcatchment WC: South (Detained)

Runoff = 43.66 cfs @ 12.03 hrs, Volume= 2.653 af, Depth= 2.73"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 2-Year Rainfall=3.50"

Area (ac)	CN	Description
8.290	98	Paved parking, HSG D
3.350	80	>75% Grass cover, Good, HSG D
11.640	93	Weighted Average
3.350		28.78% Pervious Area
8.290		71.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.8					Direct Entry,

Subcatchment WC: South (Detained)

Hydrograph

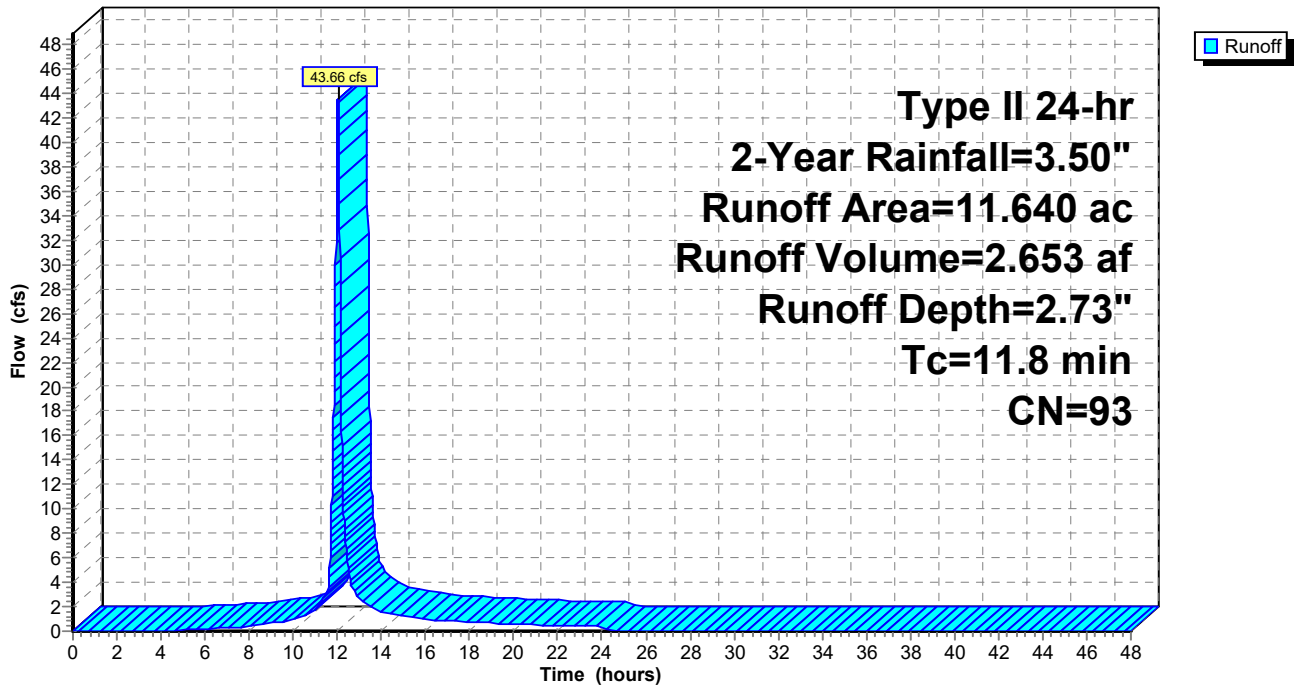

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 14

Hydrograph for Subcatchment WC: South (Detained)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.50	2.73	0.00
0.50	0.02	0.00	0.00	26.50	3.50	2.73	0.00
1.00	0.04	0.00	0.00	27.00	3.50	2.73	0.00
1.50	0.06	0.00	0.00	27.50	3.50	2.73	0.00
2.00	0.08	0.00	0.00	28.00	3.50	2.73	0.00
2.50	0.10	0.00	0.00	28.50	3.50	2.73	0.00
3.00	0.12	0.00	0.00	29.00	3.50	2.73	0.00
3.50	0.14	0.00	0.00	29.50	3.50	2.73	0.00
4.00	0.17	0.00	0.01	30.00	3.50	2.73	0.00
4.50	0.19	0.00	0.05	30.50	3.50	2.73	0.00
5.00	0.22	0.01	0.09	31.00	3.50	2.73	0.00
5.50	0.25	0.01	0.14	31.50	3.50	2.73	0.00
6.00	0.28	0.02	0.18	32.00	3.50	2.73	0.00
6.50	0.31	0.03	0.23	32.50	3.50	2.73	0.00
7.00	0.35	0.04	0.28	33.00	3.50	2.73	0.00
7.50	0.38	0.05	0.34	33.50	3.50	2.73	0.00
8.00	0.42	0.07	0.39	34.00	3.50	2.73	0.00
8.50	0.46	0.09	0.50	34.50	3.50	2.73	0.00
9.00	0.51	0.12	0.66	35.00	3.50	2.73	0.00
9.50	0.57	0.15	0.75	35.50	3.50	2.73	0.00
10.00	0.63	0.19	0.94	36.00	3.50	2.73	0.00
10.50	0.71	0.24	1.29	36.50	3.50	2.73	0.00
11.00	0.82	0.32	1.87	37.00	3.50	2.73	0.00
11.50	0.99	0.44	3.19	37.50	3.50	2.73	0.00
12.00	2.32	1.61	41.87	38.00	3.50	2.73	0.00
12.50	2.57	1.85	5.15	38.50	3.50	2.73	0.00
13.00	2.70	1.97	2.74	39.00	3.50	2.73	0.00
13.50	2.80	2.06	2.03	39.50	3.50	2.73	0.00
14.00	2.87	2.13	1.59	40.00	3.50	2.73	0.00
14.50	2.93	2.19	1.36	40.50	3.50	2.73	0.00
15.00	2.99	2.24	1.23	41.00	3.50	2.73	0.00
15.50	3.04	2.29	1.09	41.50	3.50	2.73	0.00
16.00	3.08	2.33	0.95	42.00	3.50	2.73	0.00
16.50	3.12	2.37	0.87	42.50	3.50	2.73	0.00
17.00	3.16	2.40	0.83	43.00	3.50	2.73	0.00
17.50	3.19	2.44	0.78	43.50	3.50	2.73	0.00
18.00	3.22	2.47	0.73	44.00	3.50	2.73	0.00
18.50	3.25	2.50	0.68	44.50	3.50	2.73	0.00
19.00	3.28	2.52	0.63	45.00	3.50	2.73	0.00
19.50	3.31	2.55	0.58	45.50	3.50	2.73	0.00
20.00	3.33	2.57	0.53	46.00	3.50	2.73	0.00
20.50	3.35	2.59	0.51	46.50	3.50	2.73	0.00
21.00	3.38	2.62	0.50	47.00	3.50	2.73	0.00
21.50	3.40	2.64	0.49	47.50	3.50	2.73	0.00
22.00	3.42	2.66	0.48	48.00	3.50	2.73	0.00
22.50	3.44	2.68	0.47				
23.00	3.46	2.70	0.46				
23.50	3.48	2.72	0.45				
24.00	3.50	2.73	0.44				
24.50	3.50	2.73	0.00				
25.00	3.50	2.73	0.00				
25.50	3.50	2.73	0.00				

Proposed

Type II 24-hr 2-Year Rainfall=3.50"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 15

Summary for Pond DET: South Basin

Inflow Area = 12.030 ac, 71.25% Impervious, Inflow Depth = 2.73" for 2-Year event
 Inflow = 45.11 cfs @ 12.03 hrs, Volume= 2.742 af
 Outflow = 1.89 cfs @ 13.70 hrs, Volume= 2.505 af, Atten= 96%, Lag= 100.5 min
 Primary = 1.89 cfs @ 13.70 hrs, Volume= 2.505 af
 Routed to Link NE : South

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Peak Elev= 1,003.26' @ 13.70 hrs Surf.Area= 22,574 sf Storage= 74,827 cf

Plug-Flow detention time= 796.7 min calculated for 2.505 af (91% of inflow)
 Center-of-Mass det. time= 750.9 min (1,542.7 - 791.8)

Volume	Invert	Avail.Storage	Storage Description
#1	999.00'	130,500 cf	Custom Stage Data (Prismatic) Listed below (Recalc) ADS_StormTech MC-4500 b +Cap @ 6.95' Lx 252 Effective Size= 90.4"W x 60.0"H => 26.46 sf x 6.95'L = 183.9 cf Overall Size= 100.0"W x 60.0"H x 4.33'L with 0.31' Overlap 252 Chambers in 10 Rows Cap Storage= 39.5 cf x 2 x 10 rows = 790.0 cf
#2	1,000.00'	47,127 cf	
		177,627 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
999.00	25	0	0
1,000.00	4,312	2,169	2,169
1,001.00	10,308	7,310	9,479
1,002.00	11,717	11,013	20,491
1,003.00	13,236	12,477	32,968
1,004.00	14,778	14,007	46,975
1,005.00	16,386	15,582	62,557
1,006.00	18,050	17,218	79,775
1,007.00	19,771	18,911	98,685
1,008.00	21,548	20,660	119,345
1,008.50	23,072	11,155	130,500

Device	Routing	Invert	Outlet Devices
#1	Primary	996.00'	16.0" Round Culvert L= 90.0' Ke= 0.500 Inlet / Outlet Invert= 996.00' / 993.10' S= 0.0322 '/' Cc= 0.900 n= 0.013, Flow Area= 1.40 sf
#2	Device 1	999.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	1,003.10'	60.0" W x 9.0" H Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=1.89 cfs @ 13.70 hrs HW=1,003.26' (Free Discharge)

- 1=Culvert (Passes 1.89 cfs of 17.26 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.85 cfs @ 9.74 fps)
- 3=Orifice/Grate (Orifice Controls 1.04 cfs @ 1.29 fps)

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 16


Pond DET: South Basin

Hydrograph

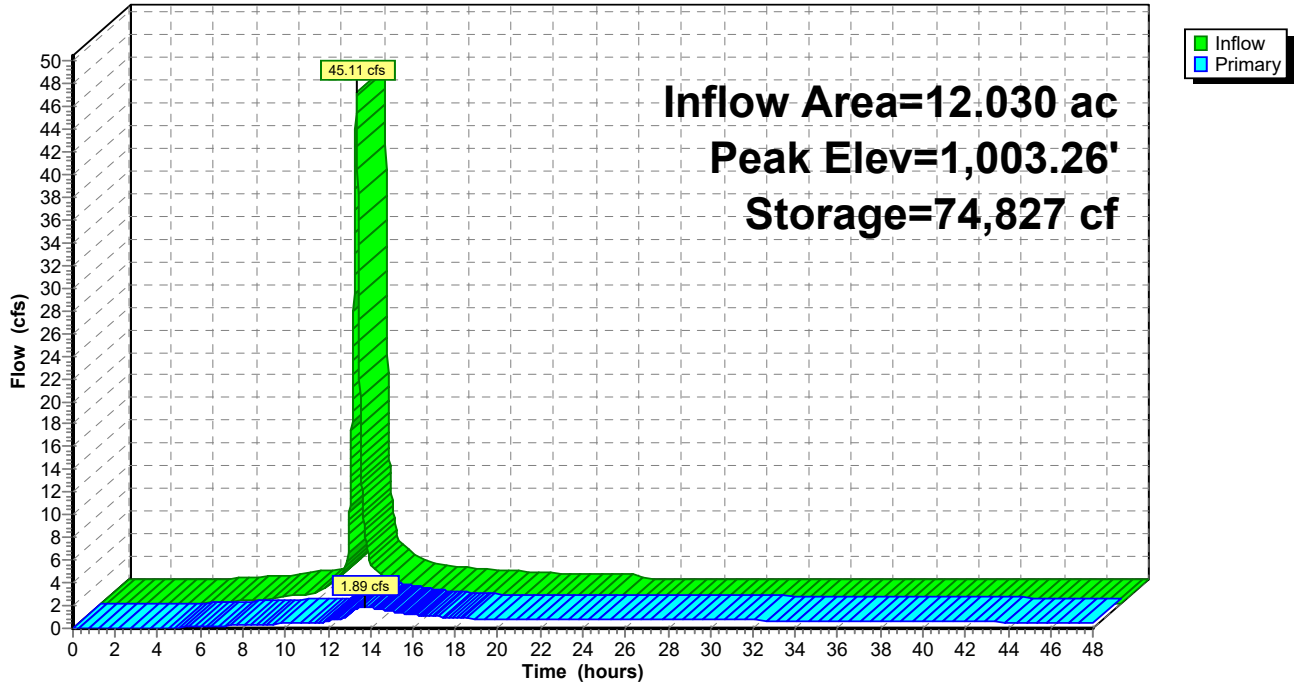

Pond DET: South Basin

Stage-Discharge

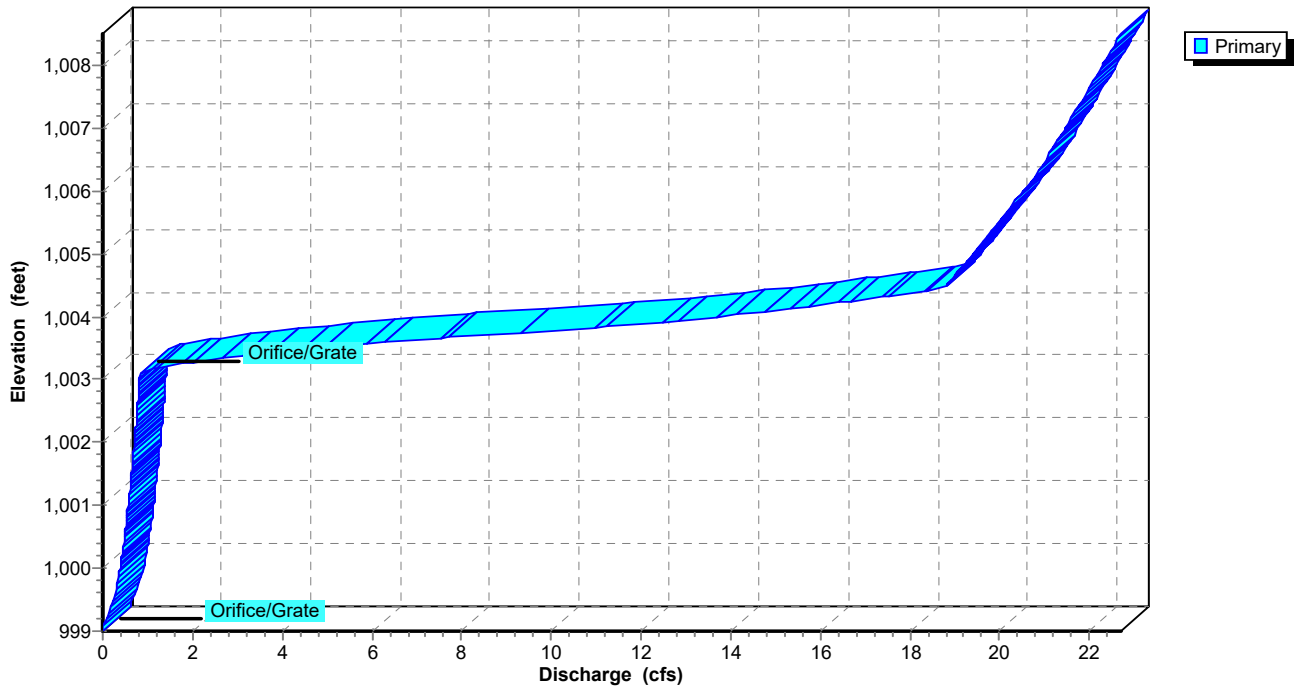

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 17

Pond DET: South Basin

Stage-Area-Storage

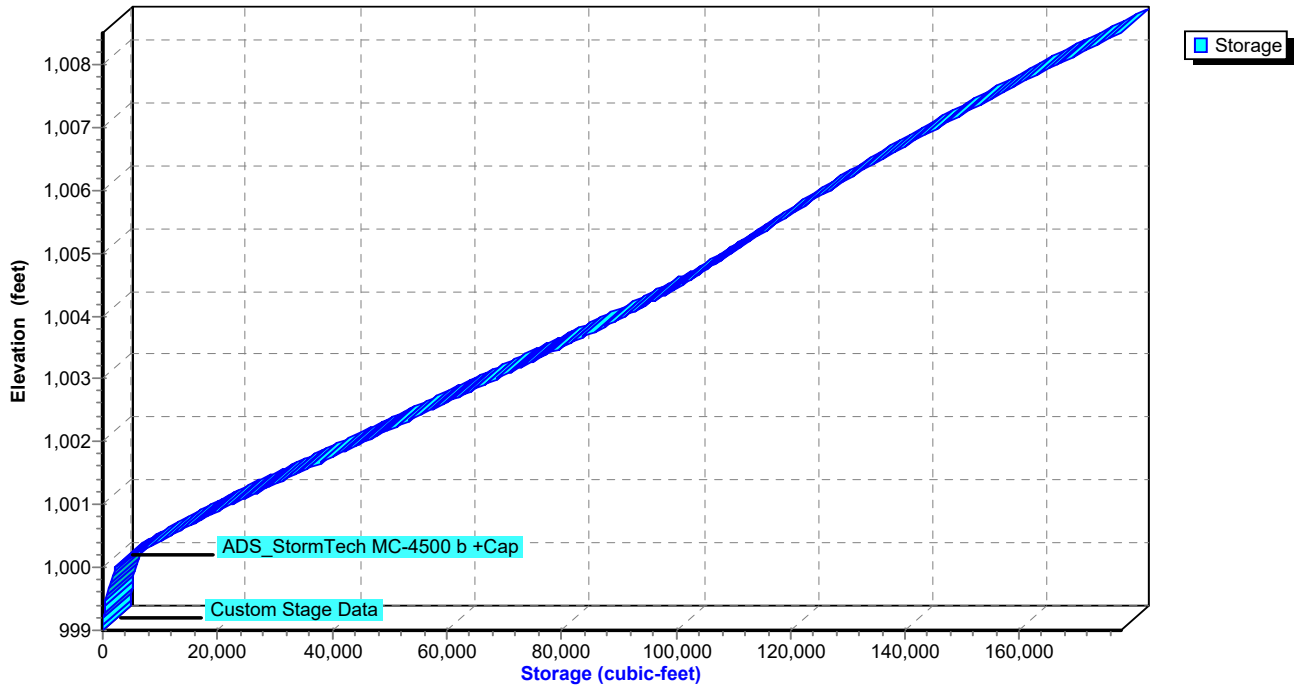

Proposed

Type II 24-hr 2-Year Rainfall=3.50"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 18

Hydrograph for Pond DET: South Basin

Time (hours)	Inflow (cfs)	Storage (cubic-feet)	Elevation (feet)	Primary (cfs)
0.00	0.00	0	999.00	0.00
1.00	0.00	0	999.00	0.00
2.00	0.00	0	999.00	0.00
3.00	0.00	0	999.00	0.00
4.00	0.01	4	999.02	0.00
5.00	0.09	74	999.18	0.07
6.00	0.19	192	999.29	0.15
7.00	0.29	408	999.43	0.21
8.00	0.41	784	999.60	0.28
9.00	0.68	1,563	999.85	0.35
10.00	0.97	3,065	1,000.05	0.39
11.00	1.93	6,502	1,000.24	0.43
12.00	43.24	35,776	1,001.57	0.65
13.00	2.84	73,370	1,003.20	1.34
14.00	1.64	74,713	1,003.26	1.84
15.00	1.27	73,820	1,003.22	1.50
16.00	0.99	73,005	1,003.18	1.21
17.00	0.85	72,276	1,003.15	1.04
18.00	0.75	71,646	1,003.12	0.92
19.00	0.65	71,052	1,003.09	0.83
20.00	0.55	70,225	1,003.06	0.83
21.00	0.52	69,147	1,003.01	0.82
22.00	0.50	68,010	1,002.96	0.82
23.00	0.47	66,820	1,002.91	0.81
24.00	0.45	65,579	1,002.85	0.81
25.00	0.00	62,992	1,002.74	0.79
26.00	0.00	60,157	1,002.62	0.78
27.00	0.00	57,370	1,002.50	0.77
28.00	0.00	54,634	1,002.38	0.75
29.00	0.00	51,947	1,002.27	0.74
30.00	0.00	49,308	1,002.15	0.73
31.00	0.00	46,720	1,002.04	0.71
32.00	0.00	44,180	1,001.93	0.70
33.00	0.00	41,690	1,001.82	0.68
34.00	0.00	39,249	1,001.72	0.67
35.00	0.00	36,857	1,001.62	0.66
36.00	0.00	34,514	1,001.52	0.64
37.00	0.00	32,221	1,001.42	0.63
38.00	0.00	29,977	1,001.32	0.62
39.00	0.00	27,782	1,001.22	0.60
40.00	0.00	25,637	1,001.13	0.59
41.00	0.00	23,541	1,001.04	0.58
42.00	0.00	21,495	1,000.95	0.56
43.00	0.00	19,499	1,000.86	0.55
44.00	0.00	17,554	1,000.78	0.53
45.00	0.00	15,662	1,000.69	0.52
46.00	0.00	13,823	1,000.60	0.50
47.00	0.00	12,038	1,000.52	0.49
48.00	0.00	10,310	1,000.43	0.47

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 19


Summary for Link E: North

Inflow Area = 0.510 ac, 0.00% Impervious, Inflow Depth = 1.64" for 2-Year event
Inflow = 1.45 cfs @ 11.98 hrs, Volume= 0.070 af
Primary = 1.45 cfs @ 11.98 hrs, Volume= 0.070 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link E: North

Hydrograph

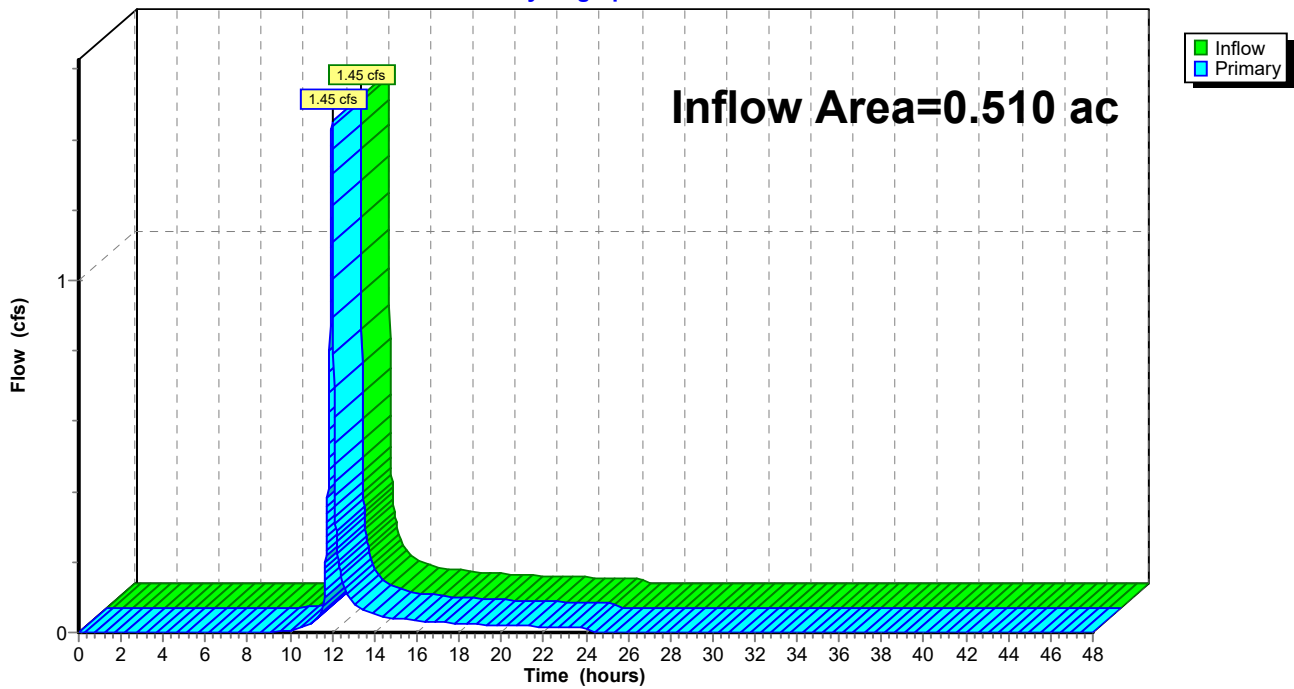

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 20

Hydrograph for Link E: North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.00	0.00	0.00	28.00	0.00	0.00	0.00
2.50	0.00	0.00	0.00	28.50	0.00	0.00	0.00
3.00	0.00	0.00	0.00	29.00	0.00	0.00	0.00
3.50	0.00	0.00	0.00	29.50	0.00	0.00	0.00
4.00	0.00	0.00	0.00	30.00	0.00	0.00	0.00
4.50	0.00	0.00	0.00	30.50	0.00	0.00	0.00
5.00	0.00	0.00	0.00	31.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	31.50	0.00	0.00	0.00
6.00	0.00	0.00	0.00	32.00	0.00	0.00	0.00
6.50	0.00	0.00	0.00	32.50	0.00	0.00	0.00
7.00	0.00	0.00	0.00	33.00	0.00	0.00	0.00
7.50	0.00	0.00	0.00	33.50	0.00	0.00	0.00
8.00	0.00	0.00	0.00	34.00	0.00	0.00	0.00
8.50	0.00	0.00	0.00	34.50	0.00	0.00	0.00
9.00	0.00	0.00	0.00	35.00	0.00	0.00	0.00
9.50	0.00	0.00	0.00	35.50	0.00	0.00	0.00
10.00	0.01	0.00	0.01	36.00	0.00	0.00	0.00
10.50	0.01	0.00	0.01	36.50	0.00	0.00	0.00
11.00	0.02	0.00	0.02	37.00	0.00	0.00	0.00
11.50	0.06	0.00	0.06	37.50	0.00	0.00	0.00
12.00	1.42	0.00	1.42	38.00	0.00	0.00	0.00
12.50	0.14	0.00	0.14	38.50	0.00	0.00	0.00
13.00	0.09	0.00	0.09	39.00	0.00	0.00	0.00
13.50	0.07	0.00	0.07	39.50	0.00	0.00	0.00
14.00	0.05	0.00	0.05	40.00	0.00	0.00	0.00
14.50	0.05	0.00	0.05	40.50	0.00	0.00	0.00
15.00	0.04	0.00	0.04	41.00	0.00	0.00	0.00
15.50	0.04	0.00	0.04	41.50	0.00	0.00	0.00
16.00	0.03	0.00	0.03	42.00	0.00	0.00	0.00
16.50	0.03	0.00	0.03	42.50	0.00	0.00	0.00
17.00	0.03	0.00	0.03	43.00	0.00	0.00	0.00
17.50	0.03	0.00	0.03	43.50	0.00	0.00	0.00
18.00	0.03	0.00	0.03	44.00	0.00	0.00	0.00
18.50	0.02	0.00	0.02	44.50	0.00	0.00	0.00
19.00	0.02	0.00	0.02	45.00	0.00	0.00	0.00
19.50	0.02	0.00	0.02	45.50	0.00	0.00	0.00
20.00	0.02	0.00	0.02	46.00	0.00	0.00	0.00
20.50	0.02	0.00	0.02	46.50	0.00	0.00	0.00
21.00	0.02	0.00	0.02	47.00	0.00	0.00	0.00
21.50	0.02	0.00	0.02	47.50	0.00	0.00	0.00
22.00	0.02	0.00	0.02	48.00	0.00	0.00	0.00
22.50	0.02	0.00	0.02				
23.00	0.02	0.00	0.02				
23.50	0.02	0.00	0.02				
24.00	0.02	0.00	0.02				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 21


Summary for Link NE: South

Inflow Area = 12.950 ac, 71.05% Impervious, Inflow Depth > 2.51" for 2-Year event
Inflow = 4.67 cfs @ 11.97 hrs, Volume= 2.707 af
Primary = 4.67 cfs @ 11.97 hrs, Volume= 2.707 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link NE: South

Hydrograph

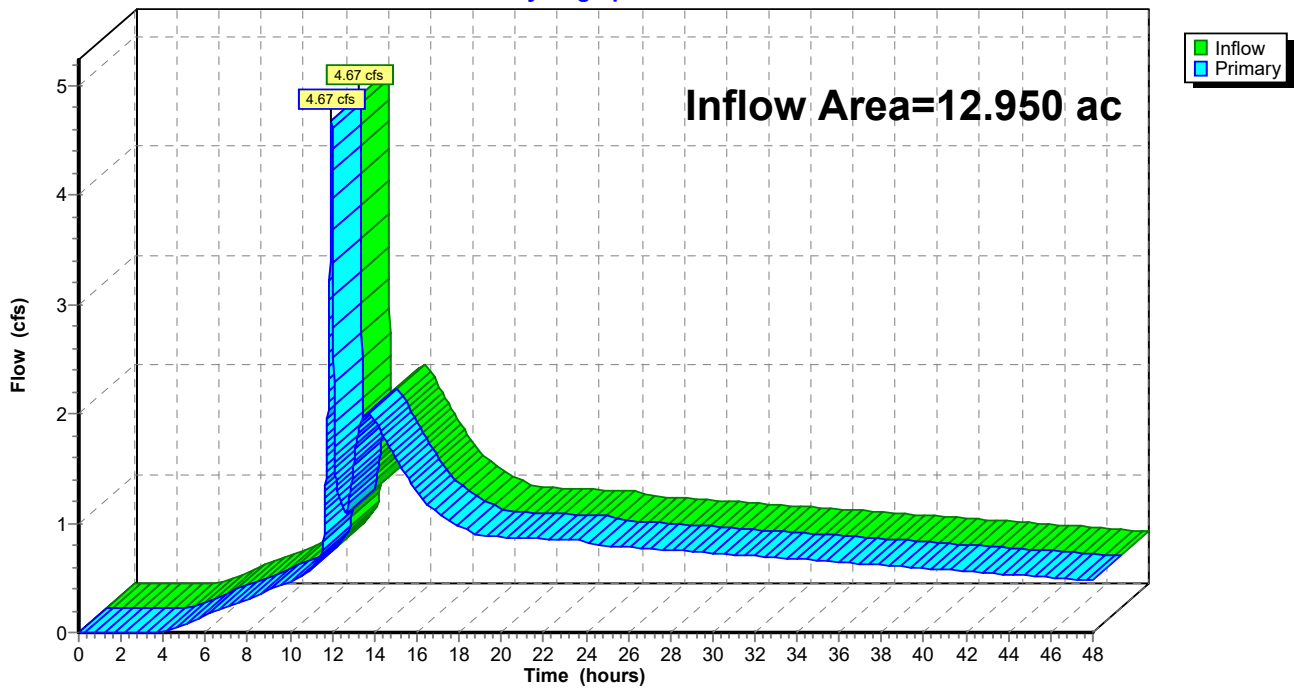

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 22

Hydrograph for Link NE: South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.78	0.00	0.78
0.50	0.00	0.00	0.00	26.50	0.77	0.00	0.77
1.00	0.00	0.00	0.00	27.00	0.77	0.00	0.77
1.50	0.00	0.00	0.00	27.50	0.76	0.00	0.76
2.00	0.00	0.00	0.00	28.00	0.75	0.00	0.75
2.50	0.00	0.00	0.00	28.50	0.75	0.00	0.75
3.00	0.00	0.00	0.00	29.00	0.74	0.00	0.74
3.50	0.00	0.00	0.00	29.50	0.73	0.00	0.73
4.00	0.00	0.00	0.00	30.00	0.73	0.00	0.73
4.50	0.03	0.00	0.03	30.50	0.72	0.00	0.72
5.00	0.07	0.00	0.07	31.00	0.71	0.00	0.71
5.50	0.11	0.00	0.11	31.50	0.71	0.00	0.71
6.00	0.16	0.00	0.16	32.00	0.70	0.00	0.70
6.50	0.20	0.00	0.20	32.50	0.69	0.00	0.69
7.00	0.23	0.00	0.23	33.00	0.68	0.00	0.68
7.50	0.27	0.00	0.27	33.50	0.68	0.00	0.68
8.00	0.30	0.00	0.30	34.00	0.67	0.00	0.67
8.50	0.34	0.00	0.34	34.50	0.66	0.00	0.66
9.00	0.39	0.00	0.39	35.00	0.66	0.00	0.66
9.50	0.44	0.00	0.44	35.50	0.65	0.00	0.65
10.00	0.47	0.00	0.47	36.00	0.64	0.00	0.64
10.50	0.51	0.00	0.51	36.50	0.64	0.00	0.64
11.00	0.58	0.00	0.58	37.00	0.63	0.00	0.63
11.50	0.73	0.00	0.73	37.50	0.62	0.00	0.62
12.00	4.42	0.00	4.42	38.00	0.62	0.00	0.62
12.50	1.15	0.00	1.15	38.50	0.61	0.00	0.61
13.00	1.54	0.00	1.54	39.00	0.60	0.00	0.60
13.50	2.00	0.00	2.00	39.50	0.60	0.00	0.60
14.00	1.96	0.00	1.96	40.00	0.59	0.00	0.59
14.50	1.77	0.00	1.77	40.50	0.58	0.00	0.58
15.00	1.60	0.00	1.60	41.00	0.58	0.00	0.58
15.50	1.44	0.00	1.44	41.50	0.57	0.00	0.57
16.00	1.28	0.00	1.28	42.00	0.56	0.00	0.56
16.50	1.17	0.00	1.17	42.50	0.55	0.00	0.55
17.00	1.10	0.00	1.10	43.00	0.55	0.00	0.55
17.50	1.04	0.00	1.04	43.50	0.54	0.00	0.54
18.00	0.98	0.00	0.98	44.00	0.53	0.00	0.53
18.50	0.92	0.00	0.92	44.50	0.53	0.00	0.53
19.00	0.88	0.00	0.88	45.00	0.52	0.00	0.52
19.50	0.88	0.00	0.88	45.50	0.51	0.00	0.51
20.00	0.87	0.00	0.87	46.00	0.50	0.00	0.50
20.50	0.87	0.00	0.87	46.50	0.50	0.00	0.50
21.00	0.86	0.00	0.86	47.00	0.49	0.00	0.49
21.50	0.86	0.00	0.86	47.50	0.48	0.00	0.48
22.00	0.86	0.00	0.86	48.00	0.47	0.00	0.47
22.50	0.85	0.00	0.85				
23.00	0.85	0.00	0.85				
23.50	0.85	0.00	0.85				
24.00	0.84	0.00	0.84				
24.50	0.80	0.00	0.80				
25.00	0.79	0.00	0.79				
25.50	0.79	0.00	0.79				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 2-Year Rainfall=3.50"

Printed 8/9/2022

Page 23


Summary for Link TOT: Total Site Watershed

Inflow Area = 13.460 ac, 68.36% Impervious, Inflow Depth > 2.48" for 2-Year event
Inflow = 6.11 cfs @ 11.98 hrs, Volume= 2.777 af
Primary = 6.11 cfs @ 11.98 hrs, Volume= 2.777 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link TOT: Total Site Watershed

Hydrograph

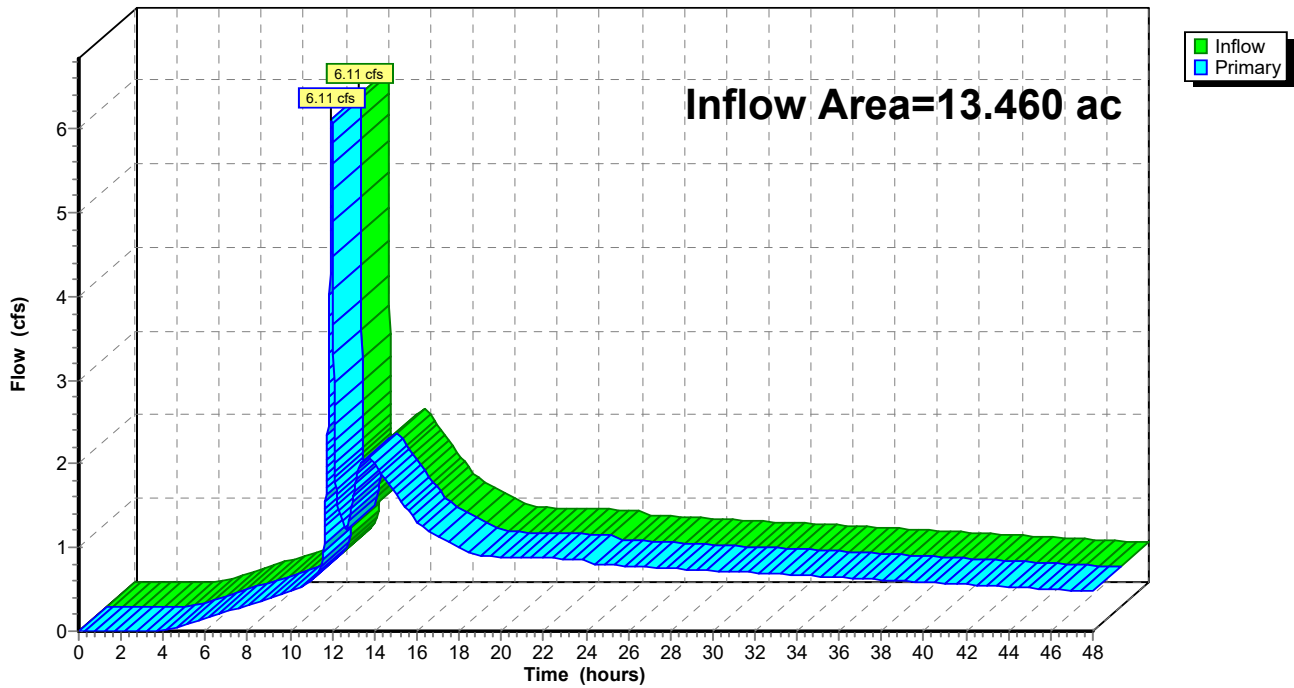

Proposed

Type II 24-hr 2-Year Rainfall=3.50"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 24

Hydrograph for Link TOT: Total Site Watershed

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.78	0.00	0.78
0.50	0.00	0.00	0.00	26.50	0.77	0.00	0.77
1.00	0.00	0.00	0.00	27.00	0.77	0.00	0.77
1.50	0.00	0.00	0.00	27.50	0.76	0.00	0.76
2.00	0.00	0.00	0.00	28.00	0.75	0.00	0.75
2.50	0.00	0.00	0.00	28.50	0.75	0.00	0.75
3.00	0.00	0.00	0.00	29.00	0.74	0.00	0.74
3.50	0.00	0.00	0.00	29.50	0.73	0.00	0.73
4.00	0.00	0.00	0.00	30.00	0.73	0.00	0.73
4.50	0.03	0.00	0.03	30.50	0.72	0.00	0.72
5.00	0.07	0.00	0.07	31.00	0.71	0.00	0.71
5.50	0.11	0.00	0.11	31.50	0.71	0.00	0.71
6.00	0.16	0.00	0.16	32.00	0.70	0.00	0.70
6.50	0.20	0.00	0.20	32.50	0.69	0.00	0.69
7.00	0.23	0.00	0.23	33.00	0.68	0.00	0.68
7.50	0.27	0.00	0.27	33.50	0.68	0.00	0.68
8.00	0.30	0.00	0.30	34.00	0.67	0.00	0.67
8.50	0.34	0.00	0.34	34.50	0.66	0.00	0.66
9.00	0.39	0.00	0.39	35.00	0.66	0.00	0.66
9.50	0.44	0.00	0.44	35.50	0.65	0.00	0.65
10.00	0.47	0.00	0.47	36.00	0.64	0.00	0.64
10.50	0.52	0.00	0.52	36.50	0.64	0.00	0.64
11.00	0.61	0.00	0.61	37.00	0.63	0.00	0.63
11.50	0.79	0.00	0.79	37.50	0.62	0.00	0.62
12.00	5.84	0.00	5.84	38.00	0.62	0.00	0.62
12.50	1.29	0.00	1.29	38.50	0.61	0.00	0.61
13.00	1.63	0.00	1.63	39.00	0.60	0.00	0.60
13.50	2.07	0.00	2.07	39.50	0.60	0.00	0.60
14.00	2.01	0.00	2.01	40.00	0.59	0.00	0.59
14.50	1.81	0.00	1.81	40.50	0.58	0.00	0.58
15.00	1.64	0.00	1.64	41.00	0.58	0.00	0.58
15.50	1.47	0.00	1.47	41.50	0.57	0.00	0.57
16.00	1.31	0.00	1.31	42.00	0.56	0.00	0.56
16.50	1.20	0.00	1.20	42.50	0.55	0.00	0.55
17.00	1.13	0.00	1.13	43.00	0.55	0.00	0.55
17.50	1.06	0.00	1.06	43.50	0.54	0.00	0.54
18.00	1.00	0.00	1.00	44.00	0.53	0.00	0.53
18.50	0.94	0.00	0.94	44.50	0.53	0.00	0.53
19.00	0.90	0.00	0.90	45.00	0.52	0.00	0.52
19.50	0.90	0.00	0.90	45.50	0.51	0.00	0.51
20.00	0.89	0.00	0.89	46.00	0.50	0.00	0.50
20.50	0.88	0.00	0.88	46.50	0.50	0.00	0.50
21.00	0.88	0.00	0.88	47.00	0.49	0.00	0.49
21.50	0.88	0.00	0.88	47.50	0.48	0.00	0.48
22.00	0.87	0.00	0.87	48.00	0.47	0.00	0.47
22.50	0.87	0.00	0.87				
23.00	0.87	0.00	0.87				
23.50	0.86	0.00	0.86				
24.00	0.86	0.00	0.86				
24.50	0.80	0.00	0.80				
25.00	0.79	0.00	0.79				
25.50	0.79	0.00	0.79				

Proposed

Type II 24-hr 10-Year Rainfall=5.30"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 25

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: South (Bypass)	Runoff Area=0.920 ac 68.48% Impervious Runoff Depth=4.38" Tc=6.2 min CN=92 Runoff=6.51 cfs 0.336 af
Subcatchment2S: South to Detention	Runoff Area=0.390 ac 72.00% Impervious Runoff Depth=4.49" Tc=12.1 min CN=93 Runoff=2.31 cfs 0.146 af
SubcatchmentN-BYP: North	Runoff Area=0.510 ac 0.00% Impervious Runoff Depth=3.16" Tc=6.8 min CN=80 Runoff=2.75 cfs 0.134 af
SubcatchmentWC: South (Detained)	Runoff Area=11.640 ac 71.22% Impervious Runoff Depth=4.49" Tc=11.8 min CN=93 Runoff=69.64 cfs 4.358 af
Pond DET: South Basin	Peak Elev=1,004.37' Storage=98,644 cf Inflow=71.95 cfs 4.504 af Outflow=17.91 cfs 4.198 af
Link E: North	Inflow=2.75 cfs 0.134 af Primary=2.75 cfs 0.134 af
Link NE: South	Inflow=18.70 cfs 4.534 af Primary=18.70 cfs 4.534 af
Link TOT: Total Site Watershed	Inflow=19.08 cfs 4.668 af Primary=19.08 cfs 4.668 af

Total Runoff Area = 13.460 ac Runoff Volume = 4.974 af Average Runoff Depth = 4.43"
31.64% Pervious = 4.259 ac 68.36% Impervious = 9.201 ac

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 26

Summary for Subcatchment 1S: South (Bypass)

Runoff = 6.51 cfs @ 11.97 hrs, Volume= 0.336 af, Depth= 4.38"
Routed to Link NE : South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 10-Year Rainfall=5.30"

Area (ac)	CN	Description
0.630	98	Paved parking, HSG D
0.290	80	>75% Grass cover, Good, HSG D
0.920	92	Weighted Average
0.290		31.52% Pervious Area
0.630		68.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2					Direct Entry,

Subcatchment 1S: South (Bypass)

Hydrograph

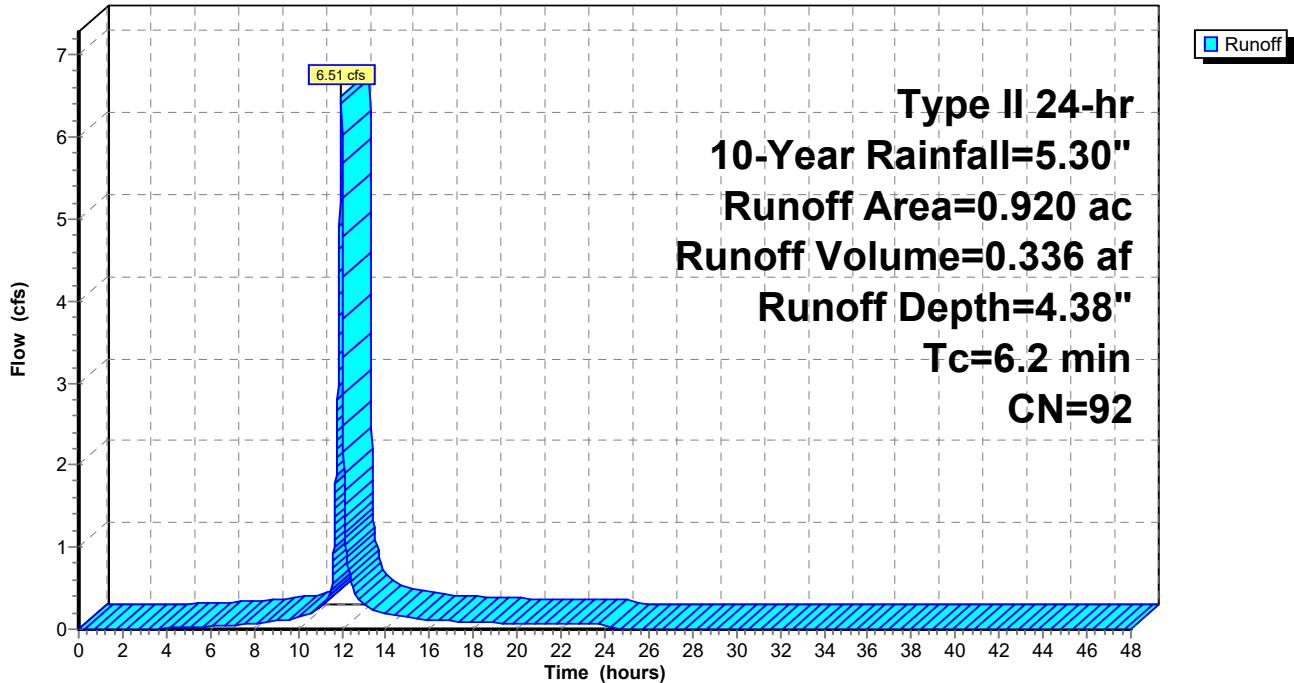

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 27

Hydrograph for Subcatchment 1S: South (Bypass)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.30	4.38	0.00
0.50	0.03	0.00	0.00	26.50	5.30	4.38	0.00
1.00	0.06	0.00	0.00	27.00	5.30	4.38	0.00
1.50	0.09	0.00	0.00	27.50	5.30	4.38	0.00
2.00	0.12	0.00	0.00	28.00	5.30	4.38	0.00
2.50	0.15	0.00	0.00	28.50	5.30	4.38	0.00
3.00	0.18	0.00	0.00	29.00	5.30	4.38	0.00
3.50	0.22	0.00	0.01	29.50	5.30	4.38	0.00
4.00	0.25	0.01	0.01	30.00	5.30	4.38	0.00
4.50	0.29	0.01	0.02	30.50	5.30	4.38	0.00
5.00	0.33	0.02	0.02	31.00	5.30	4.38	0.00
5.50	0.38	0.04	0.03	31.50	5.30	4.38	0.00
6.00	0.42	0.06	0.03	32.00	5.30	4.38	0.00
6.50	0.47	0.08	0.04	32.50	5.30	4.38	0.00
7.00	0.52	0.10	0.05	33.00	5.30	4.38	0.00
7.50	0.58	0.13	0.05	33.50	5.30	4.38	0.00
8.00	0.64	0.16	0.06	34.00	5.30	4.38	0.00
8.50	0.70	0.20	0.08	34.50	5.30	4.38	0.00
9.00	0.78	0.25	0.10	35.00	5.30	4.38	0.00
9.50	0.86	0.31	0.11	35.50	5.30	4.38	0.00
10.00	0.96	0.37	0.14	36.00	5.30	4.38	0.00
10.50	1.08	0.46	0.18	36.50	5.30	4.38	0.00
11.00	1.25	0.59	0.27	37.00	5.30	4.38	0.00
11.50	1.50	0.80	0.45	37.50	5.30	4.38	0.00
12.00	3.51	2.65	6.04	38.00	5.30	4.38	0.00
12.50	3.90	3.02	0.52	38.50	5.30	4.38	0.00
13.00	4.09	3.21	0.31	39.00	5.30	4.38	0.00
13.50	4.23	3.34	0.24	39.50	5.30	4.38	0.00
14.00	4.35	3.45	0.19	40.00	5.30	4.38	0.00
14.50	4.44	3.54	0.16	40.50	5.30	4.38	0.00
15.00	4.52	3.62	0.15	41.00	5.30	4.38	0.00
15.50	4.60	3.70	0.13	41.50	5.30	4.38	0.00
16.00	4.66	3.76	0.11	42.00	5.30	4.38	0.00
16.50	4.72	3.82	0.11	42.50	5.30	4.38	0.00
17.00	4.78	3.87	0.10	43.00	5.30	4.38	0.00
17.50	4.83	3.93	0.09	43.50	5.30	4.38	0.00
18.00	4.88	3.97	0.09	44.00	5.30	4.38	0.00
18.50	4.93	4.02	0.08	44.50	5.30	4.38	0.00
19.00	4.97	4.06	0.08	45.00	5.30	4.38	0.00
19.50	5.01	4.10	0.07	45.50	5.30	4.38	0.00
20.00	5.05	4.13	0.06	46.00	5.30	4.38	0.00
20.50	5.08	4.17	0.06	46.50	5.30	4.38	0.00
21.00	5.11	4.20	0.06	47.00	5.30	4.38	0.00
21.50	5.15	4.23	0.06	47.50	5.30	4.38	0.00
22.00	5.18	4.26	0.06	48.00	5.30	4.38	0.00
22.50	5.21	4.29	0.06				
23.00	5.24	4.32	0.06				
23.50	5.27	4.35	0.05				
24.00	5.30	4.38	0.05				
24.50	5.30	4.38	0.00				
25.00	5.30	4.38	0.00				
25.50	5.30	4.38	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 28

Summary for Subcatchment 2S: South to Detention (Off-Site)

Runoff = 2.31 cfs @ 12.03 hrs, Volume= 0.146 af, Depth= 4.49"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 10-Year Rainfall=5.30"

Area (ac)	CN	Description
0.390	93	Urban industrial, 72% imp, HSG D
0.109		28.00% Pervious Area
0.281		72.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.1					Direct Entry,

Subcatchment 2S: South to Detention (Off-Site)

Hydrograph

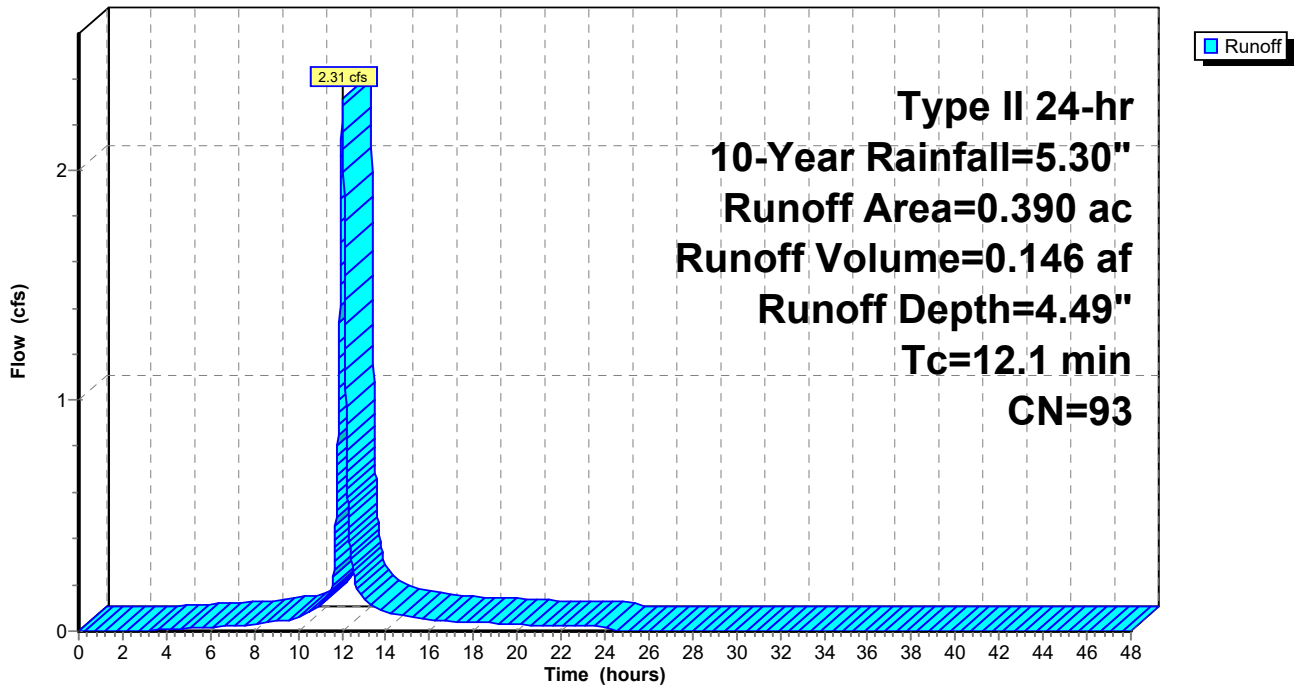

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 29

Hydrograph for Subcatchment 2S: South to Detention (Off-Site)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.30	4.49	0.00
0.50	0.03	0.00	0.00	26.50	5.30	4.49	0.00
1.00	0.06	0.00	0.00	27.00	5.30	4.49	0.00
1.50	0.09	0.00	0.00	27.50	5.30	4.49	0.00
2.00	0.12	0.00	0.00	28.00	5.30	4.49	0.00
2.50	0.15	0.00	0.00	28.50	5.30	4.49	0.00
3.00	0.18	0.00	0.00	29.00	5.30	4.49	0.00
3.50	0.22	0.01	0.00	29.50	5.30	4.49	0.00
4.00	0.25	0.01	0.01	30.00	5.30	4.49	0.00
4.50	0.29	0.02	0.01	30.50	5.30	4.49	0.00
5.00	0.33	0.04	0.01	31.00	5.30	4.49	0.00
5.50	0.38	0.05	0.01	31.50	5.30	4.49	0.00
6.00	0.42	0.07	0.02	32.00	5.30	4.49	0.00
6.50	0.47	0.10	0.02	32.50	5.30	4.49	0.00
7.00	0.52	0.12	0.02	33.00	5.30	4.49	0.00
7.50	0.58	0.16	0.02	33.50	5.30	4.49	0.00
8.00	0.64	0.19	0.03	34.00	5.30	4.49	0.00
8.50	0.70	0.23	0.03	34.50	5.30	4.49	0.00
9.00	0.78	0.29	0.04	35.00	5.30	4.49	0.00
9.50	0.86	0.35	0.05	35.50	5.30	4.49	0.00
10.00	0.96	0.42	0.06	36.00	5.30	4.49	0.00
10.50	1.08	0.51	0.08	36.50	5.30	4.49	0.00
11.00	1.25	0.65	0.11	37.00	5.30	4.49	0.00
11.50	1.50	0.87	0.18	37.50	5.30	4.49	0.00
12.00	3.51	2.75	2.21	38.00	5.30	4.49	0.00
12.50	3.90	3.12	0.27	38.50	5.30	4.49	0.00
13.00	4.09	3.31	0.14	39.00	5.30	4.49	0.00
13.50	4.23	3.45	0.11	39.50	5.30	4.49	0.00
14.00	4.35	3.56	0.08	40.00	5.30	4.49	0.00
14.50	4.44	3.65	0.07	40.50	5.30	4.49	0.00
15.00	4.52	3.73	0.06	41.00	5.30	4.49	0.00
15.50	4.60	3.80	0.06	41.50	5.30	4.49	0.00
16.00	4.66	3.87	0.05	42.00	5.30	4.49	0.00
16.50	4.72	3.93	0.05	42.50	5.30	4.49	0.00
17.00	4.78	3.98	0.04	43.00	5.30	4.49	0.00
17.50	4.83	4.03	0.04	43.50	5.30	4.49	0.00
18.00	4.88	4.08	0.04	44.00	5.30	4.49	0.00
18.50	4.93	4.13	0.04	44.50	5.30	4.49	0.00
19.00	4.97	4.17	0.03	45.00	5.30	4.49	0.00
19.50	5.01	4.21	0.03	45.50	5.30	4.49	0.00
20.00	5.05	4.24	0.03	46.00	5.30	4.49	0.00
20.50	5.08	4.28	0.03	46.50	5.30	4.49	0.00
21.00	5.11	4.31	0.03	47.00	5.30	4.49	0.00
21.50	5.15	4.34	0.03	47.50	5.30	4.49	0.00
22.00	5.18	4.37	0.02	48.00	5.30	4.49	0.00
22.50	5.21	4.40	0.02				
23.00	5.24	4.43	0.02				
23.50	5.27	4.46	0.02				
24.00	5.30	4.49	0.02				
24.50	5.30	4.49	0.00				
25.00	5.30	4.49	0.00				
25.50	5.30	4.49	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 30

Summary for Subcatchment N-BYP: North

Runoff = 2.75 cfs @ 11.98 hrs, Volume= 0.134 af, Depth= 3.16"
Routed to Link E : North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 10-Year Rainfall=5.30"

Area (ac)	CN	Description
0.510	80	>75% Grass cover, Good, HSG D
0.510		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8					Direct Entry,

Subcatchment N-BYP: North

Hydrograph

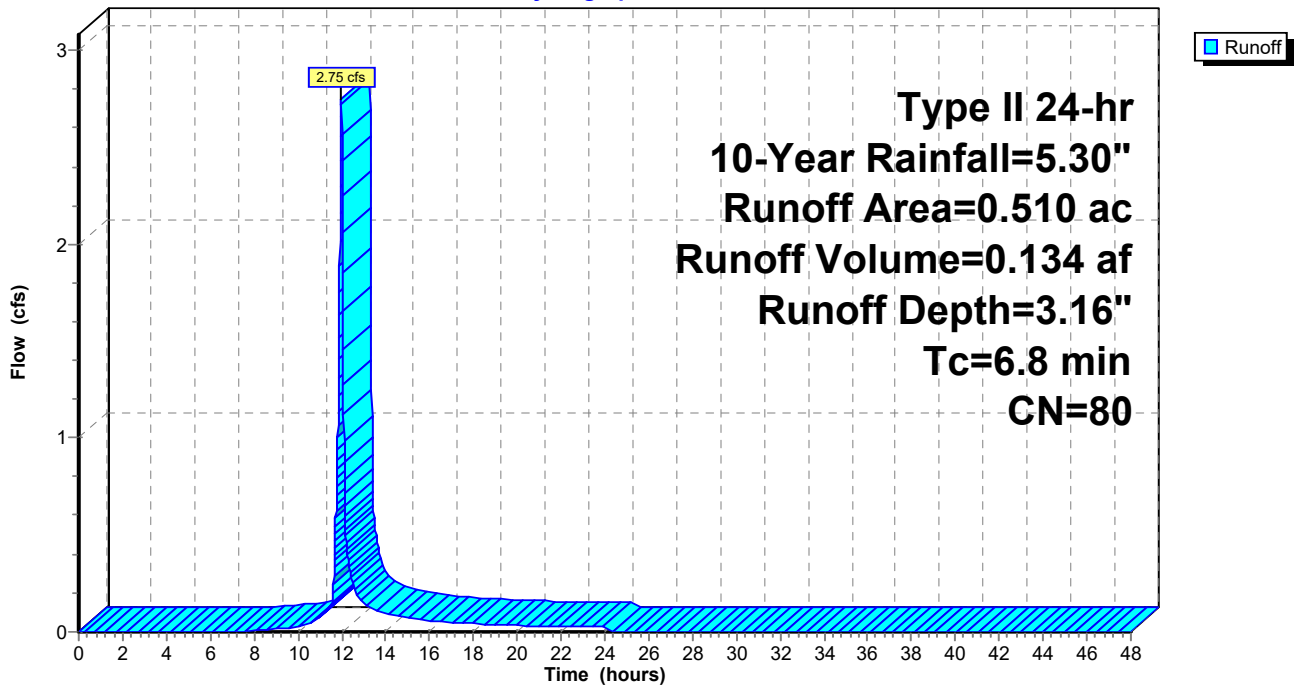

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 31

Hydrograph for Subcatchment N-BYP: North

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.30	3.16	0.00
0.50	0.03	0.00	0.00	26.50	5.30	3.16	0.00
1.00	0.06	0.00	0.00	27.00	5.30	3.16	0.00
1.50	0.09	0.00	0.00	27.50	5.30	3.16	0.00
2.00	0.12	0.00	0.00	28.00	5.30	3.16	0.00
2.50	0.15	0.00	0.00	28.50	5.30	3.16	0.00
3.00	0.18	0.00	0.00	29.00	5.30	3.16	0.00
3.50	0.22	0.00	0.00	29.50	5.30	3.16	0.00
4.00	0.25	0.00	0.00	30.00	5.30	3.16	0.00
4.50	0.29	0.00	0.00	30.50	5.30	3.16	0.00
5.00	0.33	0.00	0.00	31.00	5.30	3.16	0.00
5.50	0.38	0.00	0.00	31.50	5.30	3.16	0.00
6.00	0.42	0.00	0.00	32.00	5.30	3.16	0.00
6.50	0.47	0.00	0.00	32.50	5.30	3.16	0.00
7.00	0.52	0.00	0.00	33.00	5.30	3.16	0.00
7.50	0.58	0.00	0.00	33.50	5.30	3.16	0.00
8.00	0.64	0.01	0.01	34.00	5.30	3.16	0.00
8.50	0.70	0.01	0.01	34.50	5.30	3.16	0.00
9.00	0.78	0.03	0.02	35.00	5.30	3.16	0.00
9.50	0.86	0.05	0.02	35.50	5.30	3.16	0.00
10.00	0.96	0.07	0.03	36.00	5.30	3.16	0.00
10.50	1.08	0.11	0.04	36.50	5.30	3.16	0.00
11.00	1.25	0.17	0.07	37.00	5.30	3.16	0.00
11.50	1.50	0.29	0.14	37.50	5.30	3.16	0.00
12.00	3.51	1.65	2.67	38.00	5.30	3.16	0.00
12.50	3.90	1.96	0.25	38.50	5.30	3.16	0.00
13.00	4.09	2.12	0.15	39.00	5.30	3.16	0.00
13.50	4.23	2.24	0.11	39.50	5.30	3.16	0.00
14.00	4.35	2.33	0.09	40.00	5.30	3.16	0.00
14.50	4.44	2.41	0.08	40.50	5.30	3.16	0.00
15.00	4.52	2.48	0.07	41.00	5.30	3.16	0.00
15.50	4.60	2.55	0.06	41.50	5.30	3.16	0.00
16.00	4.66	2.60	0.06	42.00	5.30	3.16	0.00
16.50	4.72	2.65	0.05	42.50	5.30	3.16	0.00
17.00	4.78	2.70	0.05	43.00	5.30	3.16	0.00
17.50	4.83	2.75	0.05	43.50	5.30	3.16	0.00
18.00	4.88	2.79	0.04	44.00	5.30	3.16	0.00
18.50	4.93	2.83	0.04	44.50	5.30	3.16	0.00
19.00	4.97	2.87	0.04	45.00	5.30	3.16	0.00
19.50	5.01	2.90	0.03	45.50	5.30	3.16	0.00
20.00	5.05	2.93	0.03	46.00	5.30	3.16	0.00
20.50	5.08	2.96	0.03	46.50	5.30	3.16	0.00
21.00	5.11	2.99	0.03	47.00	5.30	3.16	0.00
21.50	5.15	3.02	0.03	47.50	5.30	3.16	0.00
22.00	5.18	3.05	0.03	48.00	5.30	3.16	0.00
22.50	5.21	3.08	0.03				
23.00	5.24	3.10	0.03				
23.50	5.27	3.13	0.03				
24.00	5.30	3.16	0.03				
24.50	5.30	3.16	0.00				
25.00	5.30	3.16	0.00				
25.50	5.30	3.16	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 32

Summary for Subcatchment WC: South (Detained)

Runoff = 69.64 cfs @ 12.03 hrs, Volume= 4.358 af, Depth= 4.49"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 10-Year Rainfall=5.30"

Area (ac)	CN	Description
8.290	98	Paved parking, HSG D
3.350	80	>75% Grass cover, Good, HSG D
11.640	93	Weighted Average
3.350		28.78% Pervious Area
8.290		71.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.8					Direct Entry,

Subcatchment WC: South (Detained)

Hydrograph

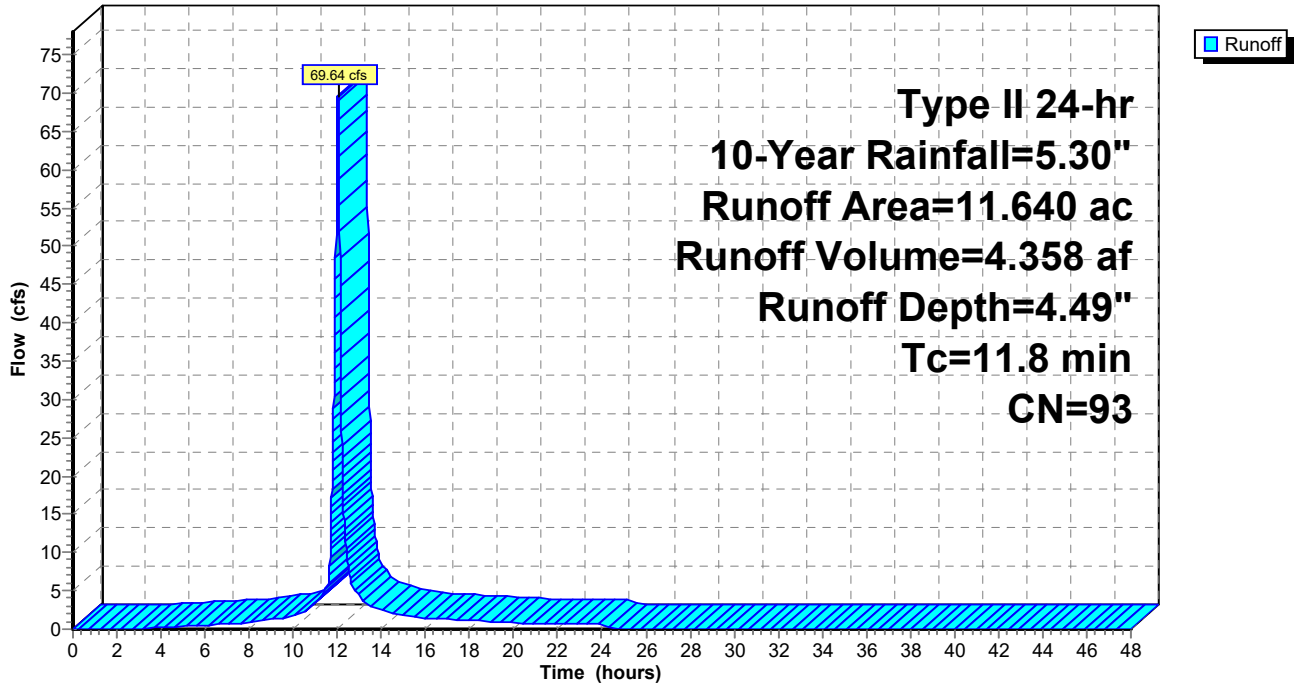

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 33

Hydrograph for Subcatchment WC: South (Detained)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.30	4.49	0.00
0.50	0.03	0.00	0.00	26.50	5.30	4.49	0.00
1.00	0.06	0.00	0.00	27.00	5.30	4.49	0.00
1.50	0.09	0.00	0.00	27.50	5.30	4.49	0.00
2.00	0.12	0.00	0.00	28.00	5.30	4.49	0.00
2.50	0.15	0.00	0.00	28.50	5.30	4.49	0.00
3.00	0.18	0.00	0.04	29.00	5.30	4.49	0.00
3.50	0.22	0.01	0.11	29.50	5.30	4.49	0.00
4.00	0.25	0.01	0.17	30.00	5.30	4.49	0.00
4.50	0.29	0.02	0.25	30.50	5.30	4.49	0.00
5.00	0.33	0.04	0.32	31.00	5.30	4.49	0.00
5.50	0.38	0.05	0.40	31.50	5.30	4.49	0.00
6.00	0.42	0.07	0.49	32.00	5.30	4.49	0.00
6.50	0.47	0.10	0.57	32.50	5.30	4.49	0.00
7.00	0.52	0.12	0.66	33.00	5.30	4.49	0.00
7.50	0.58	0.16	0.74	33.50	5.30	4.49	0.00
8.00	0.64	0.19	0.83	34.00	5.30	4.49	0.00
8.50	0.70	0.23	1.02	34.50	5.30	4.49	0.00
9.00	0.78	0.29	1.29	35.00	5.30	4.49	0.00
9.50	0.86	0.35	1.44	35.50	5.30	4.49	0.00
10.00	0.96	0.42	1.75	36.00	5.30	4.49	0.00
10.50	1.08	0.51	2.34	36.50	5.30	4.49	0.00
11.00	1.25	0.65	3.31	37.00	5.30	4.49	0.00
11.50	1.50	0.87	5.47	37.50	5.30	4.49	0.00
12.00	3.51	2.75	67.04	38.00	5.30	4.49	0.00
12.50	3.90	3.12	8.05	38.50	5.30	4.49	0.00
13.00	4.09	3.31	4.27	39.00	5.30	4.49	0.00
13.50	4.23	3.45	3.16	39.50	5.30	4.49	0.00
14.00	4.35	3.56	2.47	40.00	5.30	4.49	0.00
14.50	4.44	3.65	2.11	40.50	5.30	4.49	0.00
15.00	4.52	3.73	1.90	41.00	5.30	4.49	0.00
15.50	4.60	3.80	1.69	41.50	5.30	4.49	0.00
16.00	4.66	3.87	1.48	42.00	5.30	4.49	0.00
16.50	4.72	3.93	1.35	42.50	5.30	4.49	0.00
17.00	4.78	3.98	1.28	43.00	5.30	4.49	0.00
17.50	4.83	4.03	1.20	43.50	5.30	4.49	0.00
18.00	4.88	4.08	1.13	44.00	5.30	4.49	0.00
18.50	4.93	4.13	1.05	44.50	5.30	4.49	0.00
19.00	4.97	4.17	0.97	45.00	5.30	4.49	0.00
19.50	5.01	4.21	0.90	45.50	5.30	4.49	0.00
20.00	5.05	4.24	0.82	46.00	5.30	4.49	0.00
20.50	5.08	4.28	0.78	46.50	5.30	4.49	0.00
21.00	5.11	4.31	0.77	47.00	5.30	4.49	0.00
21.50	5.15	4.34	0.75	47.50	5.30	4.49	0.00
22.00	5.18	4.37	0.74	48.00	5.30	4.49	0.00
22.50	5.21	4.40	0.72				
23.00	5.24	4.43	0.71				
23.50	5.27	4.46	0.69				
24.00	5.30	4.49	0.68				
24.50	5.30	4.49	0.00				
25.00	5.30	4.49	0.00				
25.50	5.30	4.49	0.00				

Proposed

Type II 24-hr 10-Year Rainfall=5.30"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 34

Summary for Pond DET: South Basin

Inflow Area = 12.030 ac, 71.25% Impervious, Inflow Depth = 4.49" for 10-Year event
 Inflow = 71.95 cfs @ 12.03 hrs, Volume= 4.504 af
 Outflow = 17.91 cfs @ 12.26 hrs, Volume= 4.198 af, Atten= 75%, Lag= 14.1 min
 Primary = 17.91 cfs @ 12.26 hrs, Volume= 4.198 af
 Routed to Link NE : South

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Peak Elev= 1,004.37' @ 12.26 hrs Surf.Area= 19,626 sf Storage= 98,644 cf

Plug-Flow detention time= 512.8 min calculated for 4.198 af (93% of inflow)
 Center-of-Mass det. time= 474.6 min (1,253.0 - 778.5)

Volume	Invert	Avail.Storage	Storage Description
#1	999.00'	130,500 cf	Custom Stage Data (Prismatic) Listed below (Recalc) ADS_StormTech MC-4500 b +Cap @ 6.95' Lx 252 Effective Size= 90.4"W x 60.0"H => 26.46 sf x 6.95'L = 183.9 cf Overall Size= 100.0"W x 60.0"H x 4.33'L with 0.31' Overlap 252 Chambers in 10 Rows Cap Storage= 39.5 cf x 2 x 10 rows = 790.0 cf
#2	1,000.00'	47,127 cf	
		177,627 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
999.00	25	0	0
1,000.00	4,312	2,169	2,169
1,001.00	10,308	7,310	9,479
1,002.00	11,717	11,013	20,491
1,003.00	13,236	12,477	32,968
1,004.00	14,778	14,007	46,975
1,005.00	16,386	15,582	62,557
1,006.00	18,050	17,218	79,775
1,007.00	19,771	18,911	98,685
1,008.00	21,548	20,660	119,345
1,008.50	23,072	11,155	130,500

Device	Routing	Invert	Outlet Devices
#1	Primary	996.00'	16.0" Round Culvert L= 90.0' Ke= 0.500 Inlet / Outlet Invert= 996.00' / 993.10' S= 0.0322 '/' Cc= 0.900 n= 0.013, Flow Area= 1.40 sf
#2	Device 1	999.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	1,003.10'	60.0" W x 9.0" H Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=17.91 cfs @ 12.26 hrs HW=1,004.37' (Free Discharge)

- 1=Culvert (Passes 17.91 cfs of 18.66 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.96 cfs @ 10.98 fps)
- 3=Orifice/Grate (Orifice Controls 16.95 cfs @ 4.52 fps)

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 35


Pond DET: South Basin

Hydrograph

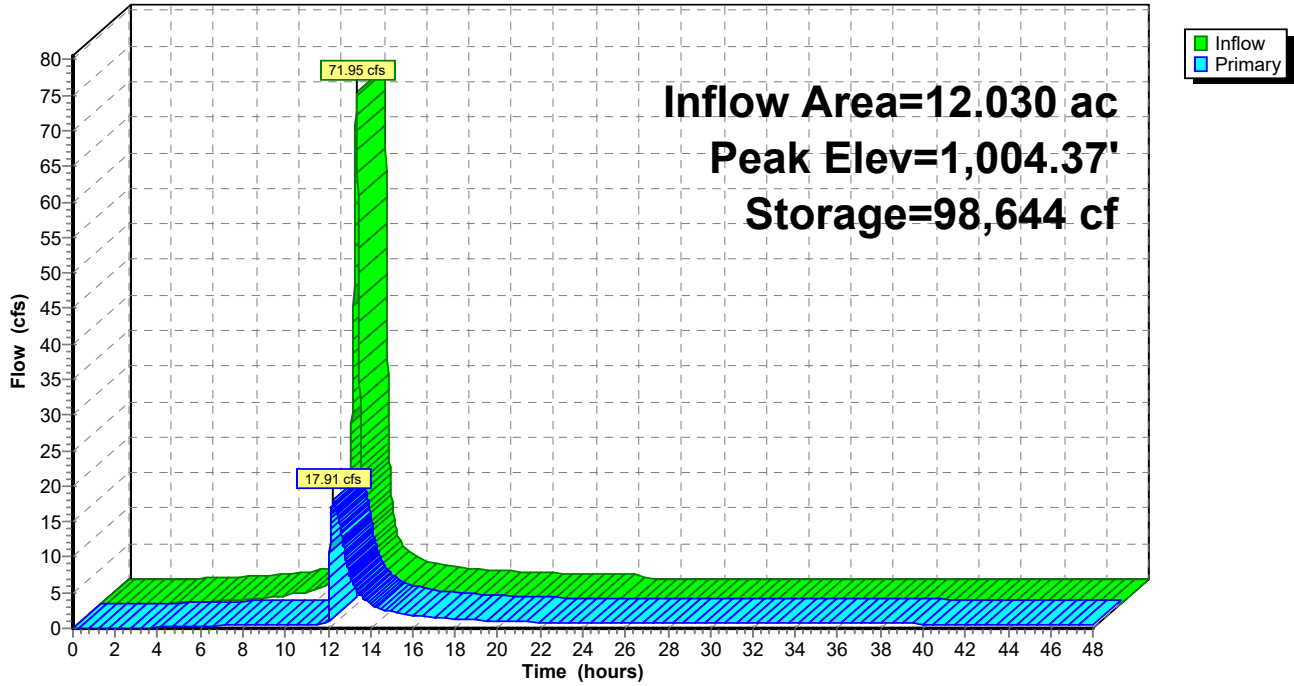

Pond DET: South Basin

Stage-Discharge

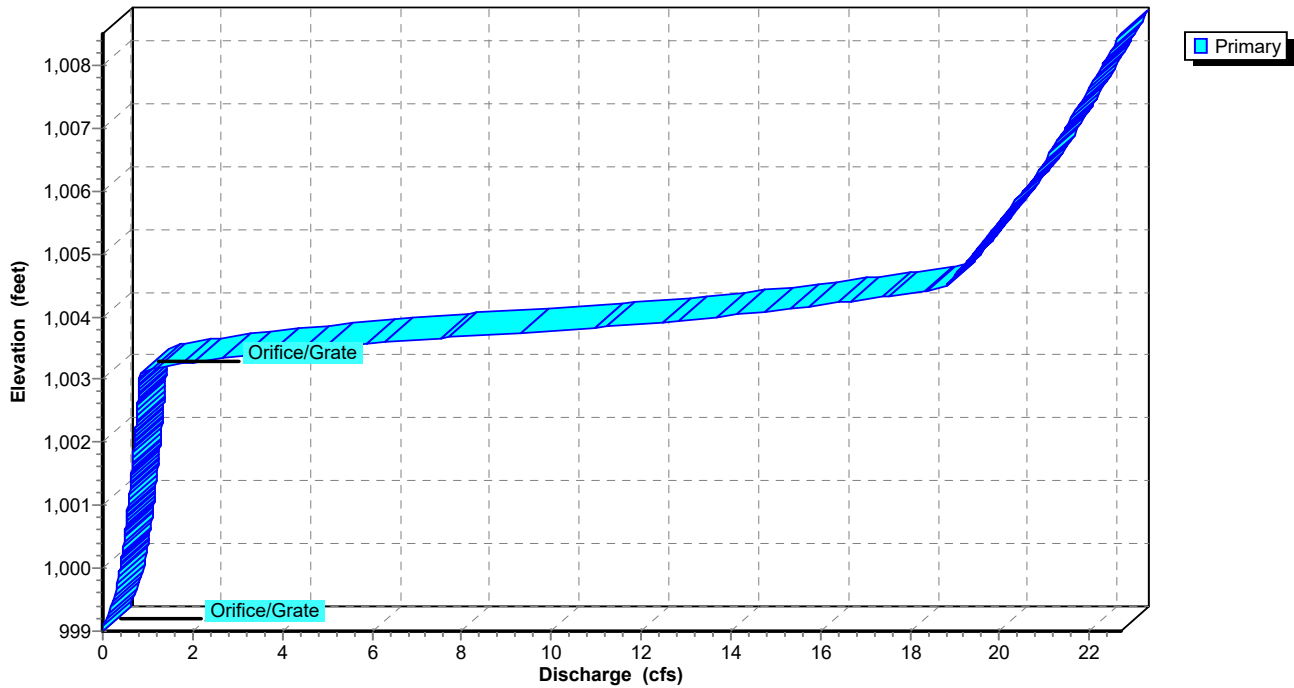

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 36

Pond DET: South Basin

Stage-Area-Storage

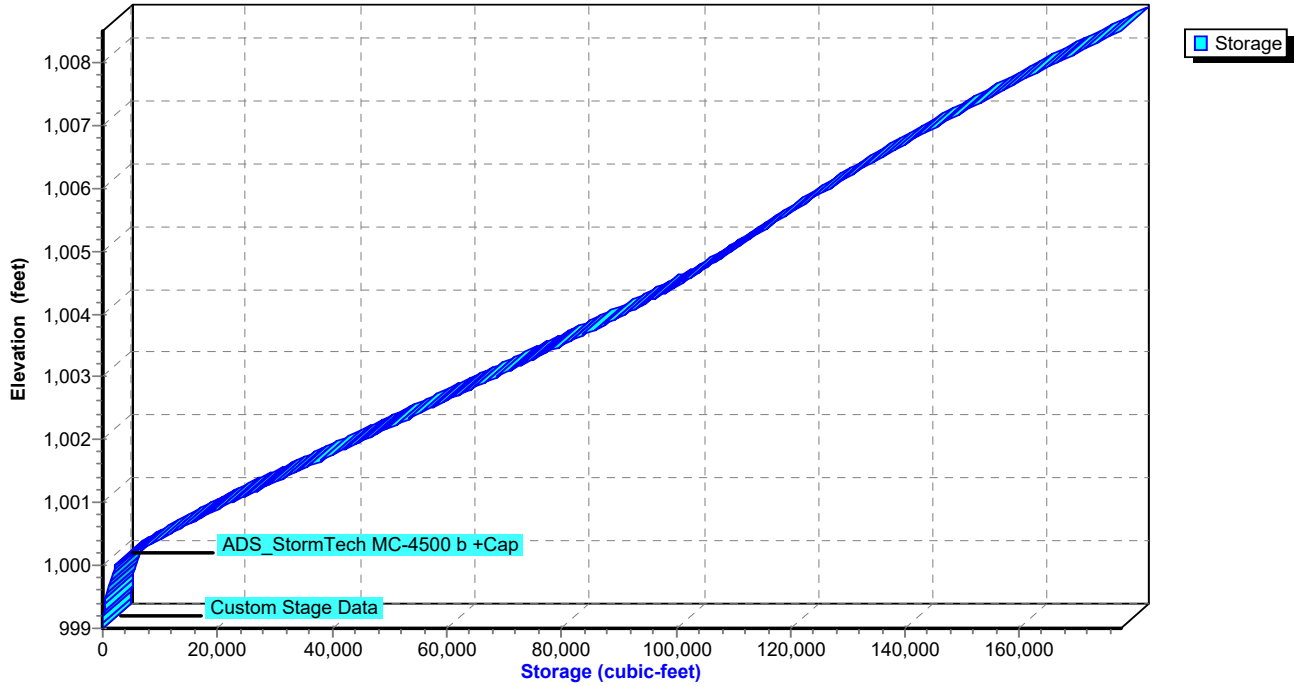

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 37

Hydrograph for Pond DET: South Basin

Time (hours)	Inflow (cfs)	Storage (cubic-feet)	Elevation (feet)	Primary (cfs)
0.00	0.00	0	999.00	0.00
1.00	0.00	0	999.00	0.00
2.00	0.00	0	999.00	0.00
3.00	0.04	17	999.07	0.02
4.00	0.18	160	999.26	0.13
5.00	0.33	439	999.44	0.22
6.00	0.50	1,001	999.68	0.30
7.00	0.68	1,920	999.94	0.37
8.00	0.86	3,295	1,000.06	0.40
9.00	1.34	5,663	1,000.19	0.43
10.00	1.80	9,543	1,000.39	0.47
11.00	3.42	16,683	1,000.74	0.53
12.00	69.25	65,959	1,002.87	0.81
13.00	4.42	83,865	1,003.67	7.74
14.00	2.55	77,844	1,003.40	3.44
15.00	1.97	75,773	1,003.30	2.33
16.00	1.53	74,661	1,003.25	1.82
17.00	1.32	73,808	1,003.22	1.50
18.00	1.16	73,258	1,003.19	1.30
19.00	1.01	72,784	1,003.17	1.14
20.00	0.85	72,223	1,003.15	1.03
21.00	0.80	71,654	1,003.12	0.92
22.00	0.76	71,277	1,003.10	0.85
23.00	0.73	70,962	1,003.09	0.83
24.00	0.70	70,551	1,003.07	0.83
25.00	0.00	68,039	1,002.96	0.82
26.00	0.00	65,117	1,002.83	0.80
27.00	0.00	62,245	1,002.71	0.79
28.00	0.00	59,422	1,002.59	0.78
29.00	0.00	56,649	1,002.47	0.76
30.00	0.00	53,925	1,002.35	0.75
31.00	0.00	51,251	1,002.24	0.74
32.00	0.00	48,626	1,002.12	0.72
33.00	0.00	46,050	1,002.01	0.71
34.00	0.00	43,523	1,001.90	0.70
35.00	0.00	41,046	1,001.80	0.68
36.00	0.00	38,617	1,001.69	0.67
37.00	0.00	36,238	1,001.59	0.65
38.00	0.00	33,909	1,001.49	0.64
39.00	0.00	31,628	1,001.39	0.63
40.00	0.00	29,397	1,001.29	0.61
41.00	0.00	27,215	1,001.20	0.60
42.00	0.00	25,083	1,001.11	0.59
43.00	0.00	23,000	1,001.02	0.57
44.00	0.00	20,967	1,000.93	0.56
45.00	0.00	18,985	1,000.84	0.54
46.00	0.00	17,054	1,000.75	0.53
47.00	0.00	15,175	1,000.67	0.51
48.00	0.00	13,350	1,000.58	0.50

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 38


Summary for Link E: North

Inflow Area = 0.510 ac, 0.00% Impervious, Inflow Depth = 3.16" for 10-Year event
Inflow = 2.75 cfs @ 11.98 hrs, Volume= 0.134 af
Primary = 2.75 cfs @ 11.98 hrs, Volume= 0.134 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link E: North

Hydrograph

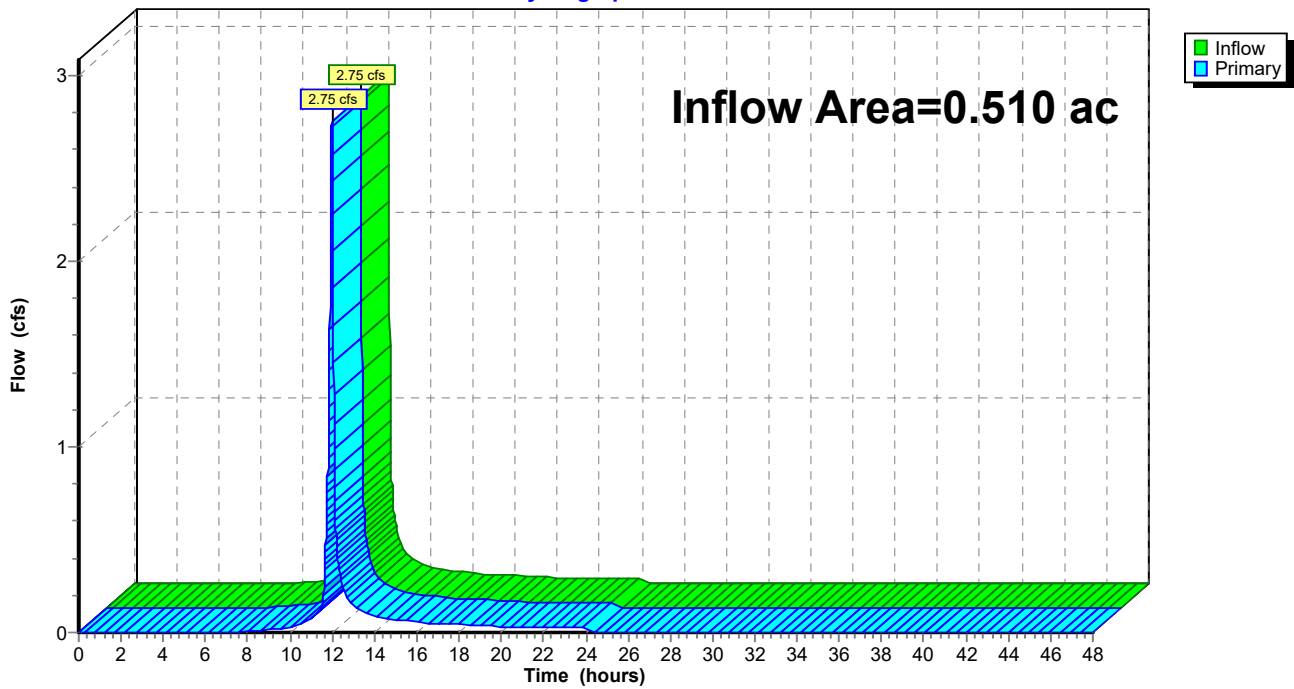

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 39

Hydrograph for Link E: North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.00	0.00	0.00	28.00	0.00	0.00	0.00
2.50	0.00	0.00	0.00	28.50	0.00	0.00	0.00
3.00	0.00	0.00	0.00	29.00	0.00	0.00	0.00
3.50	0.00	0.00	0.00	29.50	0.00	0.00	0.00
4.00	0.00	0.00	0.00	30.00	0.00	0.00	0.00
4.50	0.00	0.00	0.00	30.50	0.00	0.00	0.00
5.00	0.00	0.00	0.00	31.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	31.50	0.00	0.00	0.00
6.00	0.00	0.00	0.00	32.00	0.00	0.00	0.00
6.50	0.00	0.00	0.00	32.50	0.00	0.00	0.00
7.00	0.00	0.00	0.00	33.00	0.00	0.00	0.00
7.50	0.00	0.00	0.00	33.50	0.00	0.00	0.00
8.00	0.01	0.00	0.01	34.00	0.00	0.00	0.00
8.50	0.01	0.00	0.01	34.50	0.00	0.00	0.00
9.00	0.02	0.00	0.02	35.00	0.00	0.00	0.00
9.50	0.02	0.00	0.02	35.50	0.00	0.00	0.00
10.00	0.03	0.00	0.03	36.00	0.00	0.00	0.00
10.50	0.04	0.00	0.04	36.50	0.00	0.00	0.00
11.00	0.07	0.00	0.07	37.00	0.00	0.00	0.00
11.50	0.14	0.00	0.14	37.50	0.00	0.00	0.00
12.00	2.67	0.00	2.67	38.00	0.00	0.00	0.00
12.50	0.25	0.00	0.25	38.50	0.00	0.00	0.00
13.00	0.15	0.00	0.15	39.00	0.00	0.00	0.00
13.50	0.11	0.00	0.11	39.50	0.00	0.00	0.00
14.00	0.09	0.00	0.09	40.00	0.00	0.00	0.00
14.50	0.08	0.00	0.08	40.50	0.00	0.00	0.00
15.00	0.07	0.00	0.07	41.00	0.00	0.00	0.00
15.50	0.06	0.00	0.06	41.50	0.00	0.00	0.00
16.00	0.06	0.00	0.06	42.00	0.00	0.00	0.00
16.50	0.05	0.00	0.05	42.50	0.00	0.00	0.00
17.00	0.05	0.00	0.05	43.00	0.00	0.00	0.00
17.50	0.05	0.00	0.05	43.50	0.00	0.00	0.00
18.00	0.04	0.00	0.04	44.00	0.00	0.00	0.00
18.50	0.04	0.00	0.04	44.50	0.00	0.00	0.00
19.00	0.04	0.00	0.04	45.00	0.00	0.00	0.00
19.50	0.03	0.00	0.03	45.50	0.00	0.00	0.00
20.00	0.03	0.00	0.03	46.00	0.00	0.00	0.00
20.50	0.03	0.00	0.03	46.50	0.00	0.00	0.00
21.00	0.03	0.00	0.03	47.00	0.00	0.00	0.00
21.50	0.03	0.00	0.03	47.50	0.00	0.00	0.00
22.00	0.03	0.00	0.03	48.00	0.00	0.00	0.00
22.50	0.03	0.00	0.03				
23.00	0.03	0.00	0.03				
23.50	0.03	0.00	0.03				
24.00	0.03	0.00	0.03				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 40


Summary for Link NE: South

Inflow Area = 12.950 ac, 71.05% Impervious, Inflow Depth > 4.20" for 10-Year event
Inflow = 18.70 cfs @ 12.25 hrs, Volume= 4.534 af
Primary = 18.70 cfs @ 12.25 hrs, Volume= 4.534 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link NE: South

Hydrograph

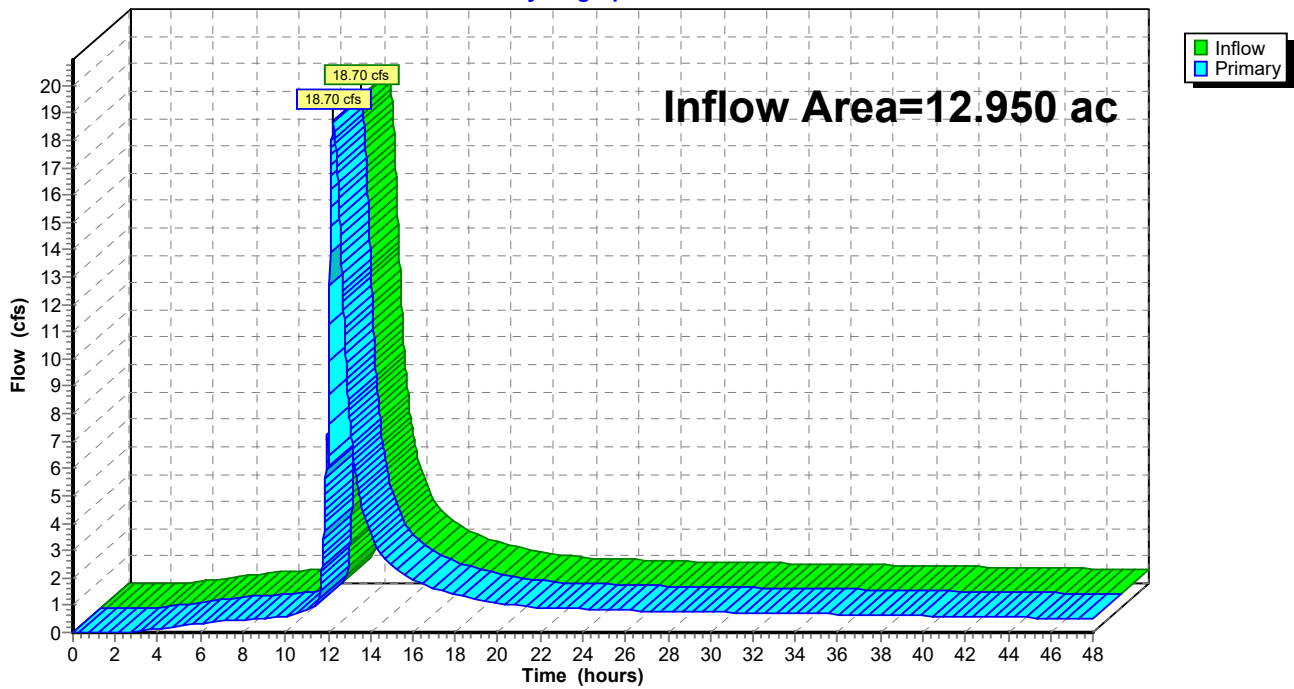

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 41

Hydrograph for Link NE: South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.80	0.00	0.80
0.50	0.00	0.00	0.00	26.50	0.80	0.00	0.80
1.00	0.00	0.00	0.00	27.00	0.79	0.00	0.79
1.50	0.00	0.00	0.00	27.50	0.78	0.00	0.78
2.00	0.00	0.00	0.00	28.00	0.78	0.00	0.78
2.50	0.00	0.00	0.00	28.50	0.77	0.00	0.77
3.00	0.02	0.00	0.02	29.00	0.76	0.00	0.76
3.50	0.08	0.00	0.08	29.50	0.76	0.00	0.76
4.00	0.14	0.00	0.14	30.00	0.75	0.00	0.75
4.50	0.19	0.00	0.19	30.50	0.74	0.00	0.74
5.00	0.24	0.00	0.24	31.00	0.74	0.00	0.74
5.50	0.29	0.00	0.29	31.50	0.73	0.00	0.73
6.00	0.33	0.00	0.33	32.00	0.72	0.00	0.72
6.50	0.38	0.00	0.38	32.50	0.72	0.00	0.72
7.00	0.42	0.00	0.42	33.00	0.71	0.00	0.71
7.50	0.44	0.00	0.44	33.50	0.70	0.00	0.70
8.00	0.46	0.00	0.46	34.00	0.70	0.00	0.70
8.50	0.49	0.00	0.49	34.50	0.69	0.00	0.69
9.00	0.52	0.00	0.52	35.00	0.68	0.00	0.68
9.50	0.55	0.00	0.55	35.50	0.67	0.00	0.67
10.00	0.60	0.00	0.60	36.00	0.67	0.00	0.67
10.50	0.68	0.00	0.68	36.50	0.66	0.00	0.66
11.00	0.79	0.00	0.79	37.00	0.65	0.00	0.65
11.50	1.03	0.00	1.03	37.50	0.65	0.00	0.65
12.00	6.84	0.00	6.84	38.00	0.64	0.00	0.64
12.50	16.09	0.00	16.09	38.50	0.63	0.00	0.63
13.00	8.05	0.00	8.05	39.00	0.63	0.00	0.63
13.50	4.97	0.00	4.97	39.50	0.62	0.00	0.62
14.00	3.63	0.00	3.63	40.00	0.61	0.00	0.61
14.50	2.88	0.00	2.88	40.50	0.61	0.00	0.61
15.00	2.48	0.00	2.48	41.00	0.60	0.00	0.60
15.50	2.18	0.00	2.18	41.50	0.59	0.00	0.59
16.00	1.93	0.00	1.93	42.00	0.59	0.00	0.59
16.50	1.74	0.00	1.74	42.50	0.58	0.00	0.58
17.00	1.60	0.00	1.60	43.00	0.57	0.00	0.57
17.50	1.49	0.00	1.49	43.50	0.56	0.00	0.56
18.00	1.39	0.00	1.39	44.00	0.56	0.00	0.56
18.50	1.30	0.00	1.30	44.50	0.55	0.00	0.55
19.00	1.22	0.00	1.22	45.00	0.54	0.00	0.54
19.50	1.15	0.00	1.15	45.50	0.54	0.00	0.54
20.00	1.09	0.00	1.09	46.00	0.53	0.00	0.53
20.50	1.03	0.00	1.03	46.50	0.52	0.00	0.52
21.00	0.98	0.00	0.98	47.00	0.51	0.00	0.51
21.50	0.94	0.00	0.94	47.50	0.51	0.00	0.51
22.00	0.91	0.00	0.91	48.00	0.50	0.00	0.50
22.50	0.89	0.00	0.89				
23.00	0.89	0.00	0.89				
23.50	0.89	0.00	0.89				
24.00	0.88	0.00	0.88				
24.50	0.83	0.00	0.83				
25.00	0.82	0.00	0.82				
25.50	0.81	0.00	0.81				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 10-Year Rainfall=5.30"

Printed 8/9/2022

Page 42


Summary for Link TOT: Total Site Watershed

Inflow Area = 13.460 ac, 68.36% Impervious, Inflow Depth > 4.16" for 10-Year event
Inflow = 19.08 cfs @ 12.25 hrs, Volume= 4.668 af
Primary = 19.08 cfs @ 12.25 hrs, Volume= 4.668 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link TOT: Total Site Watershed

Hydrograph

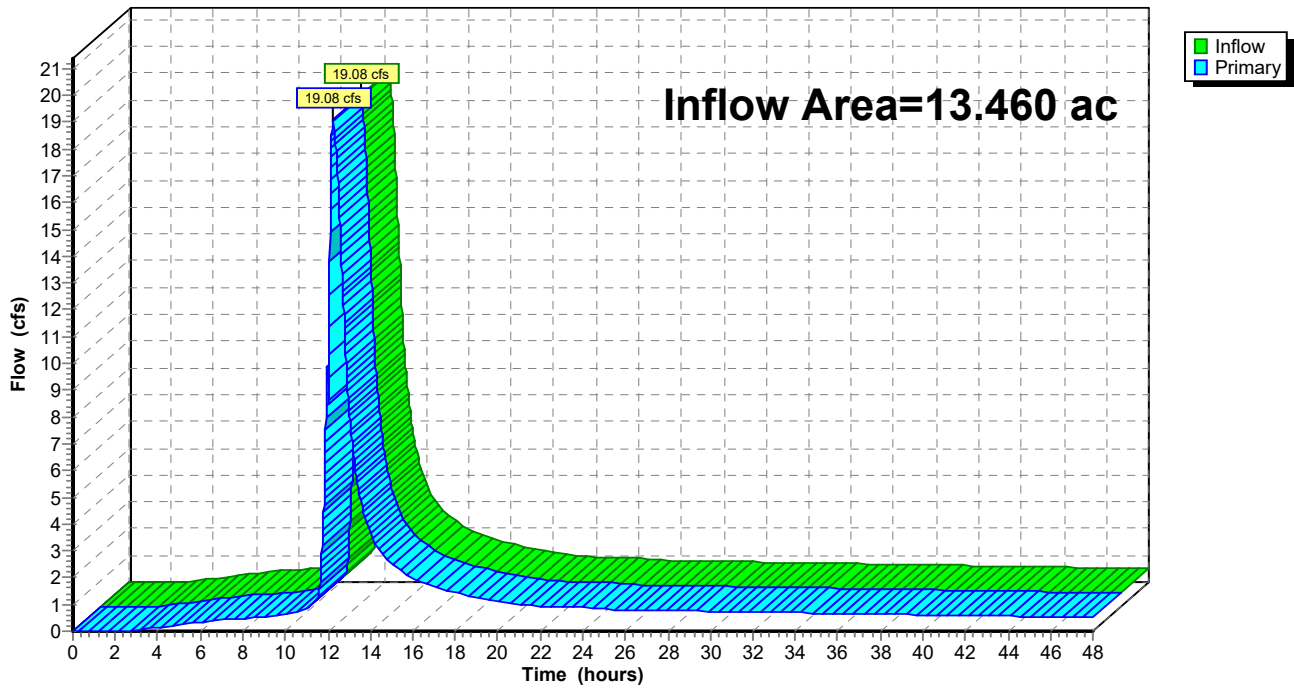

Proposed

Type II 24-hr 10-Year Rainfall=5.30"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 43

Hydrograph for Link TOT: Total Site Watershed

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.80	0.00	0.80
0.50	0.00	0.00	0.00	26.50	0.80	0.00	0.80
1.00	0.00	0.00	0.00	27.00	0.79	0.00	0.79
1.50	0.00	0.00	0.00	27.50	0.78	0.00	0.78
2.00	0.00	0.00	0.00	28.00	0.78	0.00	0.78
2.50	0.00	0.00	0.00	28.50	0.77	0.00	0.77
3.00	0.02	0.00	0.02	29.00	0.76	0.00	0.76
3.50	0.08	0.00	0.08	29.50	0.76	0.00	0.76
4.00	0.14	0.00	0.14	30.00	0.75	0.00	0.75
4.50	0.19	0.00	0.19	30.50	0.74	0.00	0.74
5.00	0.24	0.00	0.24	31.00	0.74	0.00	0.74
5.50	0.29	0.00	0.29	31.50	0.73	0.00	0.73
6.00	0.33	0.00	0.33	32.00	0.72	0.00	0.72
6.50	0.38	0.00	0.38	32.50	0.72	0.00	0.72
7.00	0.42	0.00	0.42	33.00	0.71	0.00	0.71
7.50	0.45	0.00	0.45	33.50	0.70	0.00	0.70
8.00	0.46	0.00	0.46	34.00	0.70	0.00	0.70
8.50	0.50	0.00	0.50	34.50	0.69	0.00	0.69
9.00	0.54	0.00	0.54	35.00	0.68	0.00	0.68
9.50	0.57	0.00	0.57	35.50	0.67	0.00	0.67
10.00	0.63	0.00	0.63	36.00	0.67	0.00	0.67
10.50	0.72	0.00	0.72	36.50	0.66	0.00	0.66
11.00	0.86	0.00	0.86	37.00	0.65	0.00	0.65
11.50	1.17	0.00	1.17	37.50	0.65	0.00	0.65
12.00	9.52	0.00	9.52	38.00	0.64	0.00	0.64
12.50	16.34	0.00	16.34	38.50	0.63	0.00	0.63
13.00	8.20	0.00	8.20	39.00	0.63	0.00	0.63
13.50	5.08	0.00	5.08	39.50	0.62	0.00	0.62
14.00	3.72	0.00	3.72	40.00	0.61	0.00	0.61
14.50	2.96	0.00	2.96	40.50	0.61	0.00	0.61
15.00	2.55	0.00	2.55	41.00	0.60	0.00	0.60
15.50	2.24	0.00	2.24	41.50	0.59	0.00	0.59
16.00	1.98	0.00	1.98	42.00	0.59	0.00	0.59
16.50	1.79	0.00	1.79	42.50	0.58	0.00	0.58
17.00	1.65	0.00	1.65	43.00	0.57	0.00	0.57
17.50	1.53	0.00	1.53	43.50	0.56	0.00	0.56
18.00	1.43	0.00	1.43	44.00	0.56	0.00	0.56
18.50	1.34	0.00	1.34	44.50	0.55	0.00	0.55
19.00	1.26	0.00	1.26	45.00	0.54	0.00	0.54
19.50	1.19	0.00	1.19	45.50	0.54	0.00	0.54
20.00	1.12	0.00	1.12	46.00	0.53	0.00	0.53
20.50	1.06	0.00	1.06	46.50	0.52	0.00	0.52
21.00	1.01	0.00	1.01	47.00	0.51	0.00	0.51
21.50	0.97	0.00	0.97	47.50	0.51	0.00	0.51
22.00	0.94	0.00	0.94	48.00	0.50	0.00	0.50
22.50	0.92	0.00	0.92				
23.00	0.92	0.00	0.92				
23.50	0.91	0.00	0.91				
24.00	0.91	0.00	0.91				
24.50	0.83	0.00	0.83				
25.00	0.82	0.00	0.82				
25.50	0.81	0.00	0.81				

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 44

Time span=0.00-48.00 hrs, dt=0.01 hrs, 4801 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: South (Bypass)	Runoff Area=0.920 ac 68.48% Impervious	Runoff Depth=6.75"
	Tc=6.2 min CN=92	Runoff=9.74 cfs 0.517 af
Subcatchment2S: South to Detention	Runoff Area=0.390 ac 72.00% Impervious	Runoff Depth=6.87"
	Tc=12.1 min CN=93	Runoff=3.45 cfs 0.223 af
SubcatchmentN-BYP: North	Runoff Area=0.510 ac 0.00% Impervious	Runoff Depth=5.34"
	Tc=6.8 min CN=80	Runoff=4.55 cfs 0.227 af
SubcatchmentWC: South (Detained)	Runoff Area=11.640 ac 71.22% Impervious	Runoff Depth=6.87"
	Tc=11.8 min CN=93	Runoff=103.82 cfs 6.659 af
Pond DET: South Basin	Peak Elev=1,007.25' Storage=150,808 cf	Inflow=107.26 cfs 6.882 af
		Outflow=21.67 cfs 6.550 af
Link E: North		Inflow=4.55 cfs 0.227 af
		Primary=4.55 cfs 0.227 af
Link NE: South		Inflow=28.29 cfs 7.067 af
		Primary=28.29 cfs 7.067 af
Link TOT: Total Site Watershed		Inflow=32.79 cfs 7.294 af
		Primary=32.79 cfs 7.294 af

Total Runoff Area = 13.460 ac Runoff Volume = 7.627 af Average Runoff Depth = 6.80"
31.64% Pervious = 4.259 ac 68.36% Impervious = 9.201 ac

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 45

Summary for Subcatchment 1S: South (Bypass)

Runoff = 9.74 cfs @ 11.97 hrs, Volume= 0.517 af, Depth= 6.75"
Routed to Link NE : South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 100-Year Rainfall=7.70"

Area (ac)	CN	Description
0.630	98	Paved parking, HSG D
0.290	80	>75% Grass cover, Good, HSG D
0.920	92	Weighted Average
0.290		31.52% Pervious Area
0.630		68.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.2					Direct Entry,

Subcatchment 1S: South (Bypass)

Hydrograph

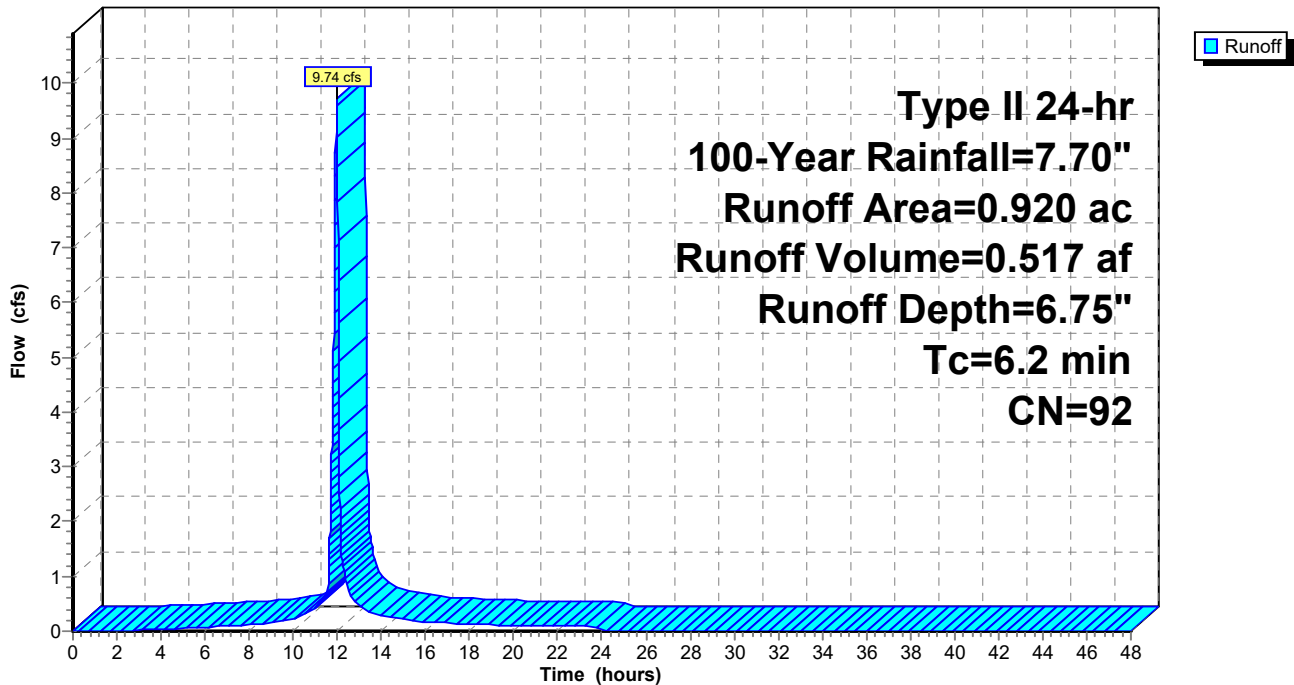

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 46

Hydrograph for Subcatchment 1S: South (Bypass)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	7.70	6.75	0.00
0.50	0.04	0.00	0.00	26.50	7.70	6.75	0.00
1.00	0.08	0.00	0.00	27.00	7.70	6.75	0.00
1.50	0.12	0.00	0.00	27.50	7.70	6.75	0.00
2.00	0.17	0.00	0.00	28.00	7.70	6.75	0.00
2.50	0.22	0.00	0.01	28.50	7.70	6.75	0.00
3.00	0.27	0.01	0.02	29.00	7.70	6.75	0.00
3.50	0.32	0.02	0.02	29.50	7.70	6.75	0.00
4.00	0.37	0.04	0.03	30.00	7.70	6.75	0.00
4.50	0.43	0.06	0.04	30.50	7.70	6.75	0.00
5.00	0.49	0.08	0.05	31.00	7.70	6.75	0.00
5.50	0.55	0.11	0.06	31.50	7.70	6.75	0.00
6.00	0.62	0.15	0.07	32.00	7.70	6.75	0.00
6.50	0.69	0.19	0.08	32.50	7.70	6.75	0.00
7.00	0.76	0.24	0.09	33.00	7.70	6.75	0.00
7.50	0.84	0.29	0.10	33.50	7.70	6.75	0.00
8.00	0.92	0.35	0.11	34.00	7.70	6.75	0.00
8.50	1.02	0.42	0.14	34.50	7.70	6.75	0.00
9.00	1.13	0.50	0.17	35.00	7.70	6.75	0.00
9.50	1.26	0.60	0.18	35.50	7.70	6.75	0.00
10.00	1.39	0.71	0.23	36.00	7.70	6.75	0.00
10.50	1.57	0.86	0.30	36.50	7.70	6.75	0.00
11.00	1.81	1.07	0.43	37.00	7.70	6.75	0.00
11.50	2.18	1.40	0.71	37.50	7.70	6.75	0.00
12.00	5.11	4.19	9.01	38.00	7.70	6.75	0.00
12.50	5.66	4.74	0.76	38.50	7.70	6.75	0.00
13.00	5.94	5.01	0.46	39.00	7.70	6.75	0.00
13.50	6.15	5.22	0.35	39.50	7.70	6.75	0.00
14.00	6.31	5.38	0.27	40.00	7.70	6.75	0.00
14.50	6.45	5.51	0.24	40.50	7.70	6.75	0.00
15.00	6.57	5.63	0.22	41.00	7.70	6.75	0.00
15.50	6.68	5.74	0.19	41.50	7.70	6.75	0.00
16.00	6.78	5.83	0.17	42.00	7.70	6.75	0.00
16.50	6.86	5.92	0.16	42.50	7.70	6.75	0.00
17.00	6.94	6.00	0.15	43.00	7.70	6.75	0.00
17.50	7.02	6.07	0.14	43.50	7.70	6.75	0.00
18.00	7.09	6.15	0.13	44.00	7.70	6.75	0.00
18.50	7.16	6.21	0.12	44.50	7.70	6.75	0.00
19.00	7.22	6.27	0.11	45.00	7.70	6.75	0.00
19.50	7.28	6.33	0.10	45.50	7.70	6.75	0.00
20.00	7.33	6.38	0.09	46.00	7.70	6.75	0.00
20.50	7.38	6.43	0.09	46.50	7.70	6.75	0.00
21.00	7.43	6.48	0.09	47.00	7.70	6.75	0.00
21.50	7.48	6.53	0.09	47.50	7.70	6.75	0.00
22.00	7.52	6.57	0.09	48.00	7.70	6.75	0.00
22.50	7.57	6.62	0.08				
23.00	7.61	6.66	0.08				
23.50	7.66	6.70	0.08				
24.00	7.70	6.75	0.08				
24.50	7.70	6.75	0.00				
25.00	7.70	6.75	0.00				
25.50	7.70	6.75	0.00				

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 47

Summary for Subcatchment 2S: South to Detention (Off-Site)

Runoff = 3.45 cfs @ 12.03 hrs, Volume= 0.223 af, Depth= 6.87"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 100-Year Rainfall=7.70"

Area (ac)	CN	Description
0.390	93	Urban industrial, 72% imp, HSG D
0.109		28.00% Pervious Area
0.281		72.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.1					Direct Entry,

Subcatchment 2S: South to Detention (Off-Site)

Hydrograph

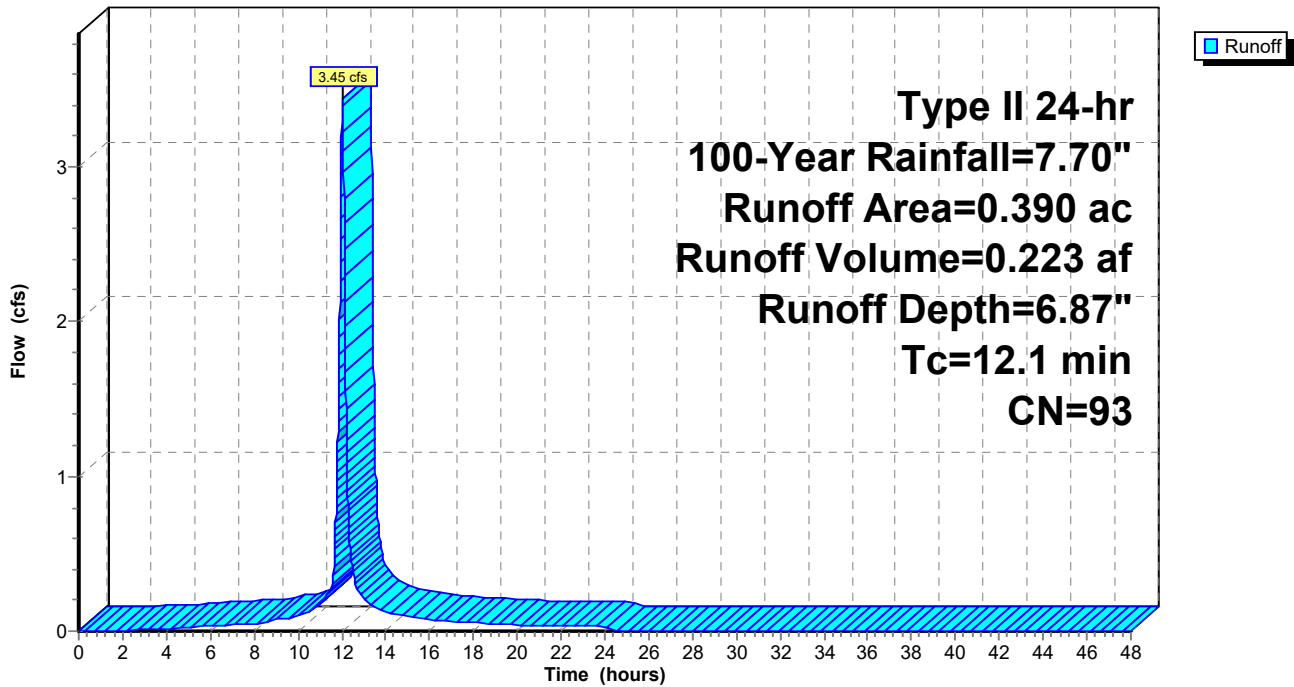

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 48

Hydrograph for Subcatchment 2S: South to Detention (Off-Site)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	7.70	6.87	0.00
0.50	0.04	0.00	0.00	26.50	7.70	6.87	0.00
1.00	0.08	0.00	0.00	27.00	7.70	6.87	0.00
1.50	0.12	0.00	0.00	27.50	7.70	6.87	0.00
2.00	0.17	0.00	0.00	28.00	7.70	6.87	0.00
2.50	0.22	0.01	0.00	28.50	7.70	6.87	0.00
3.00	0.27	0.02	0.01	29.00	7.70	6.87	0.00
3.50	0.32	0.03	0.01	29.50	7.70	6.87	0.00
4.00	0.37	0.05	0.02	30.00	7.70	6.87	0.00
4.50	0.43	0.07	0.02	30.50	7.70	6.87	0.00
5.00	0.49	0.10	0.02	31.00	7.70	6.87	0.00
5.50	0.55	0.14	0.03	31.50	7.70	6.87	0.00
6.00	0.62	0.18	0.03	32.00	7.70	6.87	0.00
6.50	0.69	0.22	0.04	32.50	7.70	6.87	0.00
7.00	0.76	0.27	0.04	33.00	7.70	6.87	0.00
7.50	0.84	0.33	0.04	33.50	7.70	6.87	0.00
8.00	0.92	0.39	0.05	34.00	7.70	6.87	0.00
8.50	1.02	0.46	0.06	34.50	7.70	6.87	0.00
9.00	1.13	0.56	0.07	35.00	7.70	6.87	0.00
9.50	1.26	0.66	0.08	35.50	7.70	6.87	0.00
10.00	1.39	0.77	0.10	36.00	7.70	6.87	0.00
10.50	1.57	0.93	0.13	36.50	7.70	6.87	0.00
11.00	1.81	1.14	0.17	37.00	7.70	6.87	0.00
11.50	2.18	1.48	0.28	37.50	7.70	6.87	0.00
12.00	5.11	4.30	3.30	38.00	7.70	6.87	0.00
12.50	5.66	4.85	0.40	38.50	7.70	6.87	0.00
13.00	5.94	5.13	0.21	39.00	7.70	6.87	0.00
13.50	6.15	5.33	0.16	39.50	7.70	6.87	0.00
14.00	6.31	5.49	0.12	40.00	7.70	6.87	0.00
14.50	6.45	5.63	0.10	40.50	7.70	6.87	0.00
15.00	6.57	5.75	0.09	41.00	7.70	6.87	0.00
15.50	6.68	5.86	0.08	41.50	7.70	6.87	0.00
16.00	6.78	5.95	0.07	42.00	7.70	6.87	0.00
16.50	6.86	6.03	0.07	42.50	7.70	6.87	0.00
17.00	6.94	6.12	0.06	43.00	7.70	6.87	0.00
17.50	7.02	6.19	0.06	43.50	7.70	6.87	0.00
18.00	7.09	6.26	0.06	44.00	7.70	6.87	0.00
18.50	7.16	6.33	0.05	44.50	7.70	6.87	0.00
19.00	7.22	6.39	0.05	45.00	7.70	6.87	0.00
19.50	7.28	6.45	0.04	45.50	7.70	6.87	0.00
20.00	7.33	6.50	0.04	46.00	7.70	6.87	0.00
20.50	7.38	6.55	0.04	46.50	7.70	6.87	0.00
21.00	7.43	6.60	0.04	47.00	7.70	6.87	0.00
21.50	7.48	6.64	0.04	47.50	7.70	6.87	0.00
22.00	7.52	6.69	0.04	48.00	7.70	6.87	0.00
22.50	7.57	6.73	0.04				
23.00	7.61	6.78	0.03				
23.50	7.66	6.82	0.03				
24.00	7.70	6.87	0.03				
24.50	7.70	6.87	0.00				
25.00	7.70	6.87	0.00				
25.50	7.70	6.87	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 49

Summary for Subcatchment N-BYP: North

Runoff = 4.55 cfs @ 11.98 hrs, Volume= 0.227 af, Depth= 5.34"
Routed to Link E : North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 100-Year Rainfall=7.70"

Area (ac)	CN	Description
0.510	80	>75% Grass cover, Good, HSG D
0.510		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8					Direct Entry,

Subcatchment N-BYP: North

Hydrograph

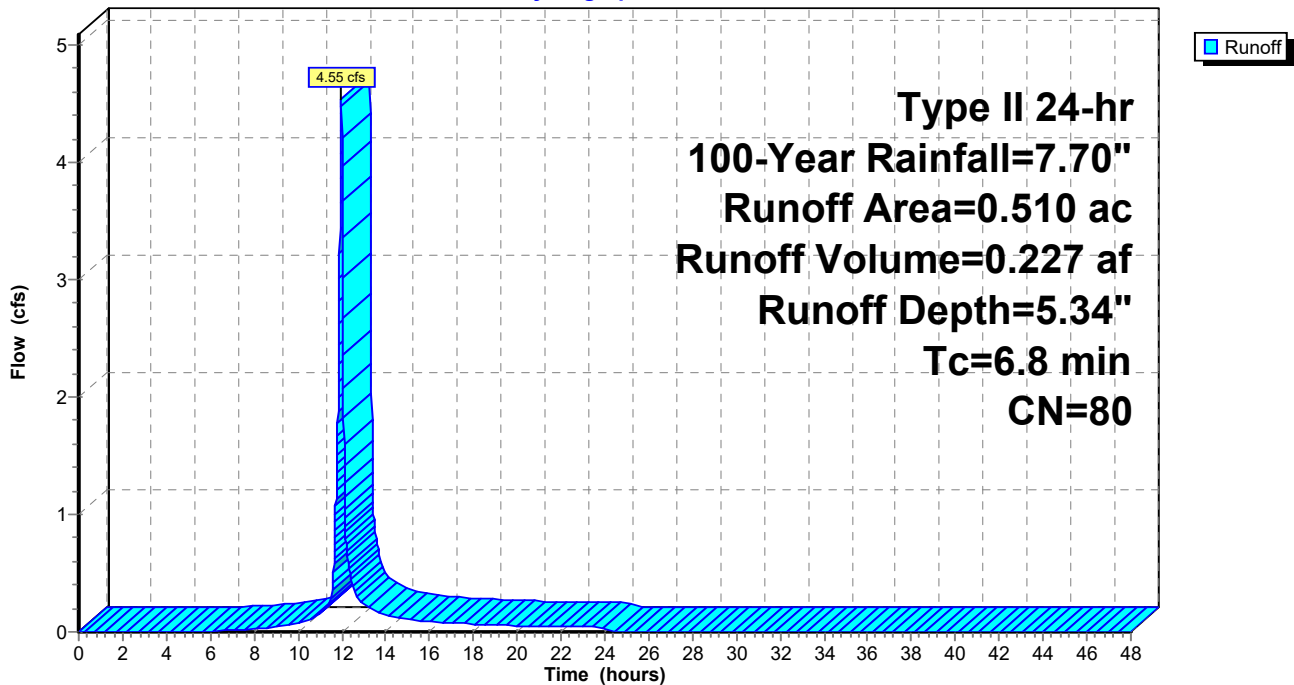

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 50

Hydrograph for Subcatchment N-BYP: North

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	7.70	5.34	0.00
0.50	0.04	0.00	0.00	26.50	7.70	5.34	0.00
1.00	0.08	0.00	0.00	27.00	7.70	5.34	0.00
1.50	0.12	0.00	0.00	27.50	7.70	5.34	0.00
2.00	0.17	0.00	0.00	28.00	7.70	5.34	0.00
2.50	0.22	0.00	0.00	28.50	7.70	5.34	0.00
3.00	0.27	0.00	0.00	29.00	7.70	5.34	0.00
3.50	0.32	0.00	0.00	29.50	7.70	5.34	0.00
4.00	0.37	0.00	0.00	30.00	7.70	5.34	0.00
4.50	0.43	0.00	0.00	30.50	7.70	5.34	0.00
5.00	0.49	0.00	0.00	31.00	7.70	5.34	0.00
5.50	0.55	0.00	0.00	31.50	7.70	5.34	0.00
6.00	0.62	0.01	0.01	32.00	7.70	5.34	0.00
6.50	0.69	0.01	0.01	32.50	7.70	5.34	0.00
7.00	0.76	0.02	0.01	33.00	7.70	5.34	0.00
7.50	0.84	0.04	0.02	33.50	7.70	5.34	0.00
8.00	0.92	0.06	0.02	34.00	7.70	5.34	0.00
8.50	1.02	0.09	0.03	34.50	7.70	5.34	0.00
9.00	1.13	0.13	0.04	35.00	7.70	5.34	0.00
9.50	1.26	0.18	0.05	35.50	7.70	5.34	0.00
10.00	1.39	0.24	0.07	36.00	7.70	5.34	0.00
10.50	1.57	0.32	0.10	36.50	7.70	5.34	0.00
11.00	1.81	0.45	0.15	37.00	7.70	5.34	0.00
11.50	2.18	0.67	0.27	37.50	7.70	5.34	0.00
12.00	5.11	2.98	4.39	38.00	7.70	5.34	0.00
12.50	5.66	3.48	0.39	38.50	7.70	5.34	0.00
13.00	5.94	3.73	0.24	39.00	7.70	5.34	0.00
13.50	6.15	3.92	0.18	39.50	7.70	5.34	0.00
14.00	6.31	4.07	0.14	40.00	7.70	5.34	0.00
14.50	6.45	4.19	0.12	40.50	7.70	5.34	0.00
15.00	6.57	4.30	0.11	41.00	7.70	5.34	0.00
15.50	6.68	4.40	0.10	41.50	7.70	5.34	0.00
16.00	6.78	4.49	0.09	42.00	7.70	5.34	0.00
16.50	6.86	4.57	0.08	42.50	7.70	5.34	0.00
17.00	6.94	4.64	0.08	43.00	7.70	5.34	0.00
17.50	7.02	4.71	0.07	43.50	7.70	5.34	0.00
18.00	7.09	4.78	0.07	44.00	7.70	5.34	0.00
18.50	7.16	4.84	0.06	44.50	7.70	5.34	0.00
19.00	7.22	4.90	0.06	45.00	7.70	5.34	0.00
19.50	7.28	4.95	0.05	45.50	7.70	5.34	0.00
20.00	7.33	5.00	0.05	46.00	7.70	5.34	0.00
20.50	7.38	5.05	0.05	46.50	7.70	5.34	0.00
21.00	7.43	5.09	0.05	47.00	7.70	5.34	0.00
21.50	7.48	5.14	0.05	47.50	7.70	5.34	0.00
22.00	7.52	5.18	0.04	48.00	7.70	5.34	0.00
22.50	7.57	5.22	0.04				
23.00	7.61	5.26	0.04				
23.50	7.66	5.30	0.04				
24.00	7.70	5.34	0.04				
24.50	7.70	5.34	0.00				
25.00	7.70	5.34	0.00				
25.50	7.70	5.34	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 51

Summary for Subcatchment WC: South (Detained)

Runoff = 103.82 cfs @ 12.03 hrs, Volume= 6.659 af, Depth= 6.87"
Routed to Pond DET : South Basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
Type II 24-hr 100-Year Rainfall=7.70"

Area (ac)	CN	Description
8.290	98	Paved parking, HSG D
3.350	80	>75% Grass cover, Good, HSG D
11.640	93	Weighted Average
3.350		28.78% Pervious Area
8.290		71.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.8					Direct Entry,

Subcatchment WC: South (Detained)

Hydrograph

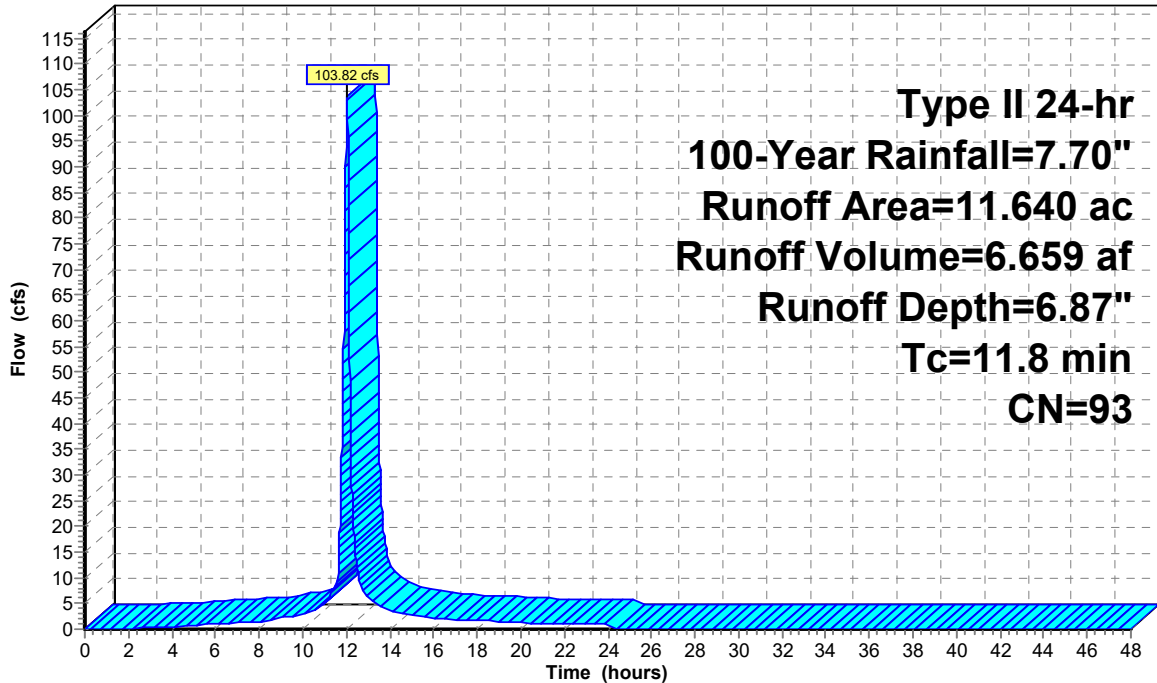

Runoff

Type II 24-hr
100-Year Rainfall=7.70"
Runoff Area=11.640 ac
Runoff Volume=6.659 af
Runoff Depth=6.87"
Tc=11.8 min
CN=93

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 52

Hydrograph for Subcatchment WC: South (Detained)

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	7.70	6.87	0.00
0.50	0.04	0.00	0.00	26.50	7.70	6.87	0.00
1.00	0.08	0.00	0.00	27.00	7.70	6.87	0.00
1.50	0.12	0.00	0.00	27.50	7.70	6.87	0.00
2.00	0.17	0.00	0.01	28.00	7.70	6.87	0.00
2.50	0.22	0.01	0.13	28.50	7.70	6.87	0.00
3.00	0.27	0.02	0.25	29.00	7.70	6.87	0.00
3.50	0.32	0.03	0.36	29.50	7.70	6.87	0.00
4.00	0.37	0.05	0.47	30.00	7.70	6.87	0.00
4.50	0.43	0.07	0.58	30.50	7.70	6.87	0.00
5.00	0.49	0.10	0.71	31.00	7.70	6.87	0.00
5.50	0.55	0.14	0.83	31.50	7.70	6.87	0.00
6.00	0.62	0.18	0.96	32.00	7.70	6.87	0.00
6.50	0.69	0.22	1.09	32.50	7.70	6.87	0.00
7.00	0.76	0.27	1.21	33.00	7.70	6.87	0.00
7.50	0.84	0.33	1.34	33.50	7.70	6.87	0.00
8.00	0.92	0.39	1.46	34.00	7.70	6.87	0.00
8.50	1.02	0.46	1.76	34.50	7.70	6.87	0.00
9.00	1.13	0.56	2.19	35.00	7.70	6.87	0.00
9.50	1.26	0.66	2.39	35.50	7.70	6.87	0.00
10.00	1.39	0.77	2.85	36.00	7.70	6.87	0.00
10.50	1.57	0.93	3.76	36.50	7.70	6.87	0.00
11.00	1.81	1.14	5.23	37.00	7.70	6.87	0.00
11.50	2.18	1.48	8.51	37.50	7.70	6.87	0.00
12.00	5.11	4.30	100.15	38.00	7.70	6.87	0.00
12.50	5.66	4.85	11.87	38.50	7.70	6.87	0.00
13.00	5.94	5.13	6.29	39.00	7.70	6.87	0.00
13.50	6.15	5.33	4.65	39.50	7.70	6.87	0.00
14.00	6.31	5.49	3.63	40.00	7.70	6.87	0.00
14.50	6.45	5.63	3.11	40.50	7.70	6.87	0.00
15.00	6.57	5.75	2.79	41.00	7.70	6.87	0.00
15.50	6.68	5.86	2.48	41.50	7.70	6.87	0.00
16.00	6.78	5.95	2.17	42.00	7.70	6.87	0.00
16.50	6.86	6.03	1.99	42.50	7.70	6.87	0.00
17.00	6.94	6.12	1.88	43.00	7.70	6.87	0.00
17.50	7.02	6.19	1.76	43.50	7.70	6.87	0.00
18.00	7.09	6.26	1.65	44.00	7.70	6.87	0.00
18.50	7.16	6.33	1.54	44.50	7.70	6.87	0.00
19.00	7.22	6.39	1.43	45.00	7.70	6.87	0.00
19.50	7.28	6.45	1.32	45.50	7.70	6.87	0.00
20.00	7.33	6.50	1.21	46.00	7.70	6.87	0.00
20.50	7.38	6.55	1.15	46.50	7.70	6.87	0.00
21.00	7.43	6.60	1.13	47.00	7.70	6.87	0.00
21.50	7.48	6.64	1.11	47.50	7.70	6.87	0.00
22.00	7.52	6.69	1.08	48.00	7.70	6.87	0.00
22.50	7.57	6.73	1.06				
23.00	7.61	6.78	1.04				
23.50	7.66	6.82	1.02				
24.00	7.70	6.87	0.99				
24.50	7.70	6.87	0.01				
25.00	7.70	6.87	0.00				
25.50	7.70	6.87	0.00				

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 53

Summary for Pond DET: South Basin

Inflow Area = 12.030 ac, 71.25% Impervious, Inflow Depth = 6.87" for 100-Year event
 Inflow = 107.26 cfs @ 12.03 hrs, Volume= 6.882 af
 Outflow = 21.67 cfs @ 12.31 hrs, Volume= 6.550 af, Atten= 80%, Lag= 16.7 min
 Primary = 21.67 cfs @ 12.31 hrs, Volume= 6.550 af
 Routed to Link NE : South

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs
 Peak Elev= 1,007.25' @ 12.31 hrs Surf.Area= 20,226 sf Storage= 150,808 cf

Plug-Flow detention time= 363.8 min calculated for 6.549 af (95% of inflow)
 Center-of-Mass det. time= 335.2 min (1,103.2 - 768.0)

Volume	Invert	Avail.Storage	Storage Description
#1	999.00'	130,500 cf	Custom Stage Data (Prismatic) Listed below (Recalc) ADS_StormTech MC-4500 b +Cap @ 6.95' Lx 252 Effective Size= 90.4"W x 60.0"H => 26.46 sf x 6.95'L = 183.9 cf Overall Size= 100.0"W x 60.0"H x 4.33'L with 0.31' Overlap 252 Chambers in 10 Rows Cap Storage= 39.5 cf x 2 x 10 rows = 790.0 cf
#2	1,000.00'	47,127 cf	
		177,627 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
999.00	25	0	0
1,000.00	4,312	2,169	2,169
1,001.00	10,308	7,310	9,479
1,002.00	11,717	11,013	20,491
1,003.00	13,236	12,477	32,968
1,004.00	14,778	14,007	46,975
1,005.00	16,386	15,582	62,557
1,006.00	18,050	17,218	79,775
1,007.00	19,771	18,911	98,685
1,008.00	21,548	20,660	119,345
1,008.50	23,072	11,155	130,500

Device	Routing	Invert	Outlet Devices
#1	Primary	996.00'	16.0" Round Culvert L= 90.0' Ke= 0.500 Inlet / Outlet Invert= 996.00' / 993.10' S= 0.0322 '/' Cc= 0.900 n= 0.013, Flow Area= 1.40 sf
#2	Device 1	999.00'	4.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#3	Device 1	1,003.10'	60.0" W x 9.0" H Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads

Primary OutFlow Max=21.67 cfs @ 12.31 hrs HW=1,007.25' (Free Discharge)

- 1=Culvert (Barrel Controls 21.67 cfs @ 15.52 fps)
- 2=Orifice/Grate (Passes < 1.19 cfs potential flow)
- 3=Orifice/Grate (Passes < 35.07 cfs potential flow)

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 54


Pond DET: South Basin

Hydrograph

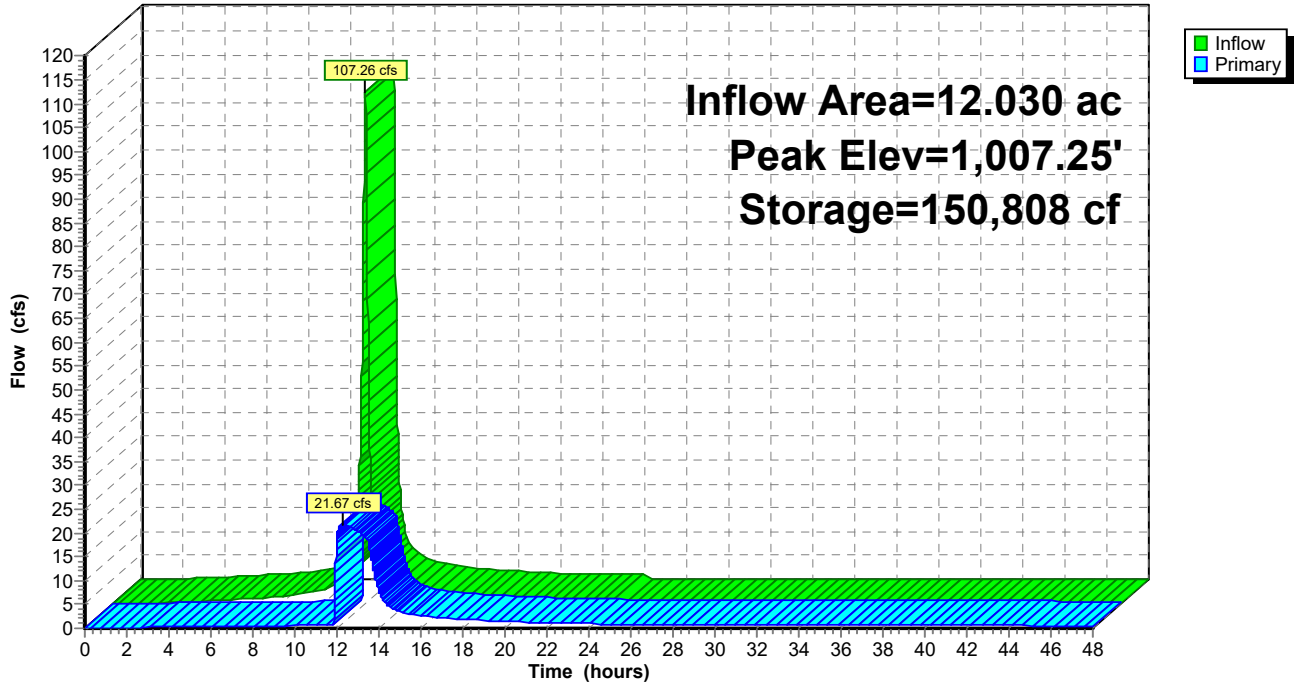

Pond DET: South Basin

Stage-Discharge

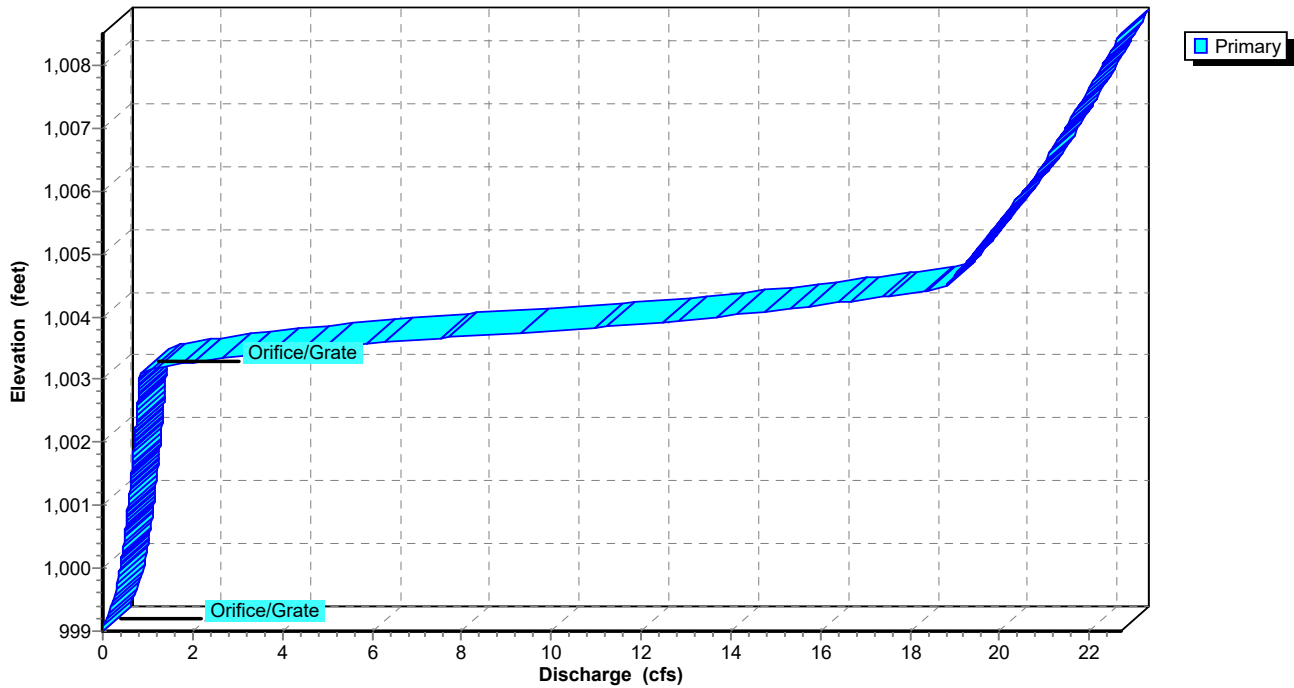

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC


Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 55

Pond DET: South Basin

Stage-Area-Storage

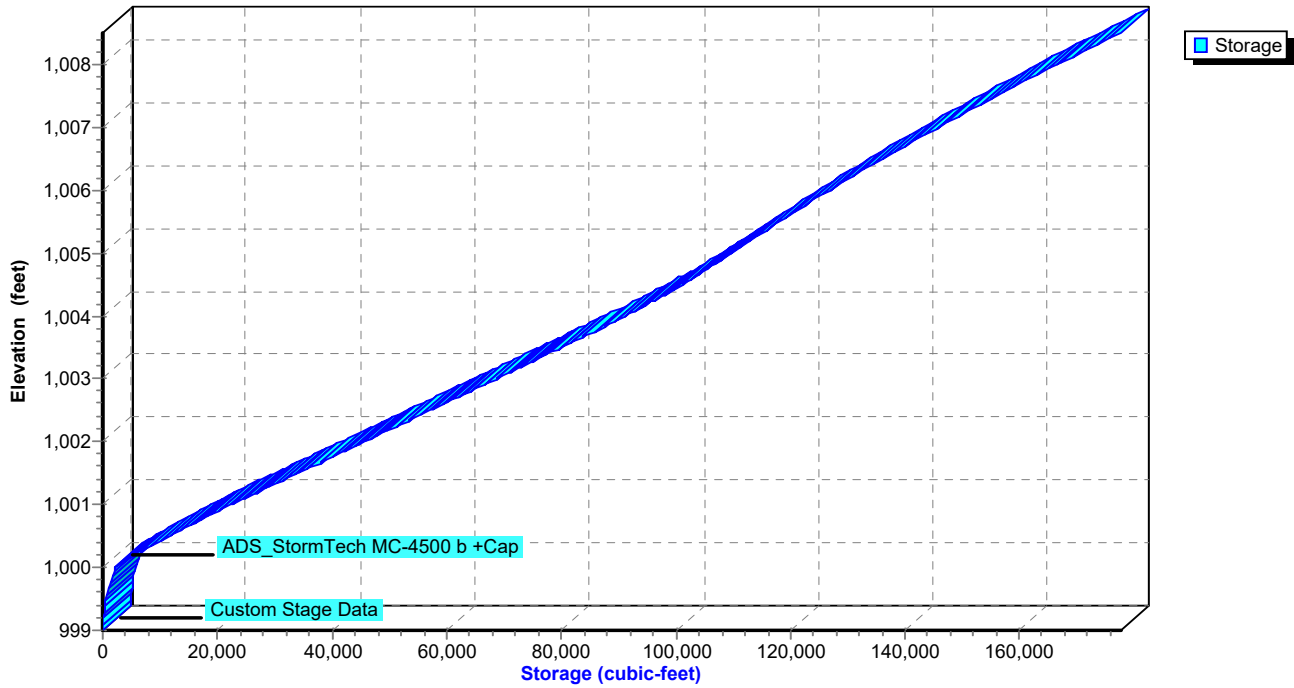

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 56

Hydrograph for Pond DET: South Basin

Time (hours)	Inflow (cfs)	Storage (cubic-feet)	Elevation (feet)	Primary (cfs)
0.00	0.00	0	999.00	0.00
1.00	0.00	0	999.00	0.00
2.00	0.01	2	999.01	0.00
3.00	0.26	220	999.31	0.16
4.00	0.48	769	999.59	0.27
5.00	0.73	1,797	999.91	0.36
6.00	0.99	3,505	1,000.07	0.40
7.00	1.25	6,053	1,000.21	0.43
8.00	1.51	9,418	1,000.39	0.46
9.00	2.26	14,287	1,000.62	0.51
10.00	2.94	21,452	1,000.95	0.56
11.00	5.41	33,607	1,001.48	0.64
12.00	103.45	104,821	1,004.71	19.07
13.00	6.50	124,177	1,005.85	20.37
14.00	3.75	83,991	1,003.67	7.84
15.00	2.89	77,981	1,003.40	3.52
16.00	2.24	76,356	1,003.33	2.62
17.00	1.94	75,351	1,003.28	2.13
18.00	1.71	74,763	1,003.26	1.86
19.00	1.48	74,198	1,003.23	1.64
20.00	1.25	73,585	1,003.21	1.42
21.00	1.17	73,118	1,003.19	1.25
22.00	1.12	72,889	1,003.18	1.17
23.00	1.07	72,709	1,003.17	1.12
24.00	1.03	72,522	1,003.16	1.08
25.00	0.00	69,884	1,003.04	0.83
26.00	0.00	66,931	1,002.91	0.81
27.00	0.00	64,028	1,002.79	0.80
28.00	0.00	61,174	1,002.66	0.79
29.00	0.00	58,370	1,002.54	0.77
30.00	0.00	55,616	1,002.42	0.76
31.00	0.00	52,911	1,002.31	0.74
32.00	0.00	50,255	1,002.19	0.73
33.00	0.00	47,648	1,002.08	0.72
34.00	0.00	45,091	1,001.97	0.70
35.00	0.00	42,583	1,001.86	0.69
36.00	0.00	40,124	1,001.76	0.68
37.00	0.00	37,714	1,001.65	0.66
38.00	0.00	35,354	1,001.55	0.65
39.00	0.00	33,043	1,001.45	0.64
40.00	0.00	30,781	1,001.35	0.62
41.00	0.00	28,568	1,001.26	0.61
42.00	0.00	26,405	1,001.17	0.59
43.00	0.00	24,292	1,001.07	0.58
44.00	0.00	22,228	1,000.98	0.57
45.00	0.00	20,213	1,000.90	0.55
46.00	0.00	18,250	1,000.81	0.54
47.00	0.00	16,339	1,000.72	0.52
48.00	0.00	14,480	1,000.63	0.51

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 57


Summary for Link E: North

Inflow Area = 0.510 ac, 0.00% Impervious, Inflow Depth = 5.34" for 100-Year event
Inflow = 4.55 cfs @ 11.98 hrs, Volume= 0.227 af
Primary = 4.55 cfs @ 11.98 hrs, Volume= 0.227 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link E: North

Hydrograph

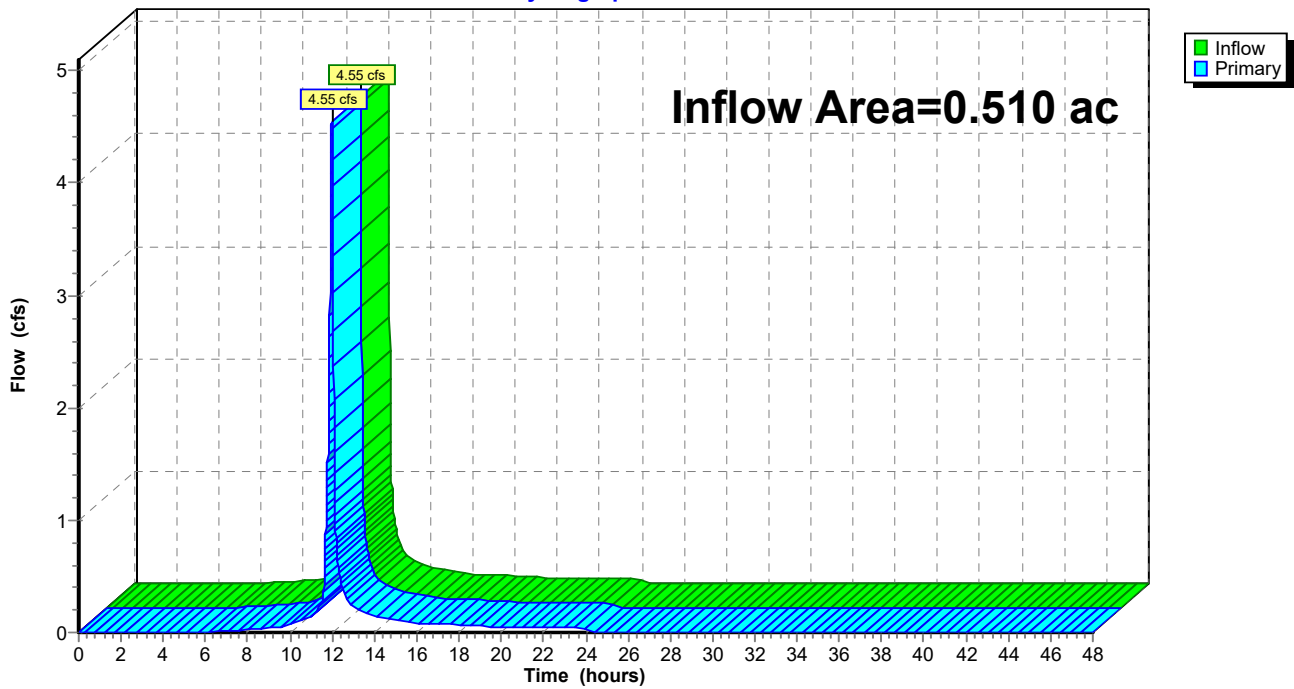

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 58

Hydrograph for Link E: North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.00	0.00	0.00	28.00	0.00	0.00	0.00
2.50	0.00	0.00	0.00	28.50	0.00	0.00	0.00
3.00	0.00	0.00	0.00	29.00	0.00	0.00	0.00
3.50	0.00	0.00	0.00	29.50	0.00	0.00	0.00
4.00	0.00	0.00	0.00	30.00	0.00	0.00	0.00
4.50	0.00	0.00	0.00	30.50	0.00	0.00	0.00
5.00	0.00	0.00	0.00	31.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	31.50	0.00	0.00	0.00
6.00	0.01	0.00	0.01	32.00	0.00	0.00	0.00
6.50	0.01	0.00	0.01	32.50	0.00	0.00	0.00
7.00	0.01	0.00	0.01	33.00	0.00	0.00	0.00
7.50	0.02	0.00	0.02	33.50	0.00	0.00	0.00
8.00	0.02	0.00	0.02	34.00	0.00	0.00	0.00
8.50	0.03	0.00	0.03	34.50	0.00	0.00	0.00
9.00	0.04	0.00	0.04	35.00	0.00	0.00	0.00
9.50	0.05	0.00	0.05	35.50	0.00	0.00	0.00
10.00	0.07	0.00	0.07	36.00	0.00	0.00	0.00
10.50	0.10	0.00	0.10	36.50	0.00	0.00	0.00
11.00	0.15	0.00	0.15	37.00	0.00	0.00	0.00
11.50	0.27	0.00	0.27	37.50	0.00	0.00	0.00
12.00	4.39	0.00	4.39	38.00	0.00	0.00	0.00
12.50	0.39	0.00	0.39	38.50	0.00	0.00	0.00
13.00	0.24	0.00	0.24	39.00	0.00	0.00	0.00
13.50	0.18	0.00	0.18	39.50	0.00	0.00	0.00
14.00	0.14	0.00	0.14	40.00	0.00	0.00	0.00
14.50	0.12	0.00	0.12	40.50	0.00	0.00	0.00
15.00	0.11	0.00	0.11	41.00	0.00	0.00	0.00
15.50	0.10	0.00	0.10	41.50	0.00	0.00	0.00
16.00	0.09	0.00	0.09	42.00	0.00	0.00	0.00
16.50	0.08	0.00	0.08	42.50	0.00	0.00	0.00
17.00	0.08	0.00	0.08	43.00	0.00	0.00	0.00
17.50	0.07	0.00	0.07	43.50	0.00	0.00	0.00
18.00	0.07	0.00	0.07	44.00	0.00	0.00	0.00
18.50	0.06	0.00	0.06	44.50	0.00	0.00	0.00
19.00	0.06	0.00	0.06	45.00	0.00	0.00	0.00
19.50	0.05	0.00	0.05	45.50	0.00	0.00	0.00
20.00	0.05	0.00	0.05	46.00	0.00	0.00	0.00
20.50	0.05	0.00	0.05	46.50	0.00	0.00	0.00
21.00	0.05	0.00	0.05	47.00	0.00	0.00	0.00
21.50	0.05	0.00	0.05	47.50	0.00	0.00	0.00
22.00	0.04	0.00	0.04	48.00	0.00	0.00	0.00
22.50	0.04	0.00	0.04				
23.00	0.04	0.00	0.04				
23.50	0.04	0.00	0.04				
24.00	0.04	0.00	0.04				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 59


Summary for Link NE: South

Inflow Area = 12.950 ac, 71.05% Impervious, Inflow Depth > 6.55" for 100-Year event
Inflow = 28.29 cfs @ 11.99 hrs, Volume= 7.067 af
Primary = 28.29 cfs @ 11.99 hrs, Volume= 7.067 af, Atten= 0%, Lag= 0.0 min
Routed to Link TOT : Total Site Watershed

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link NE: South

Hydrograph

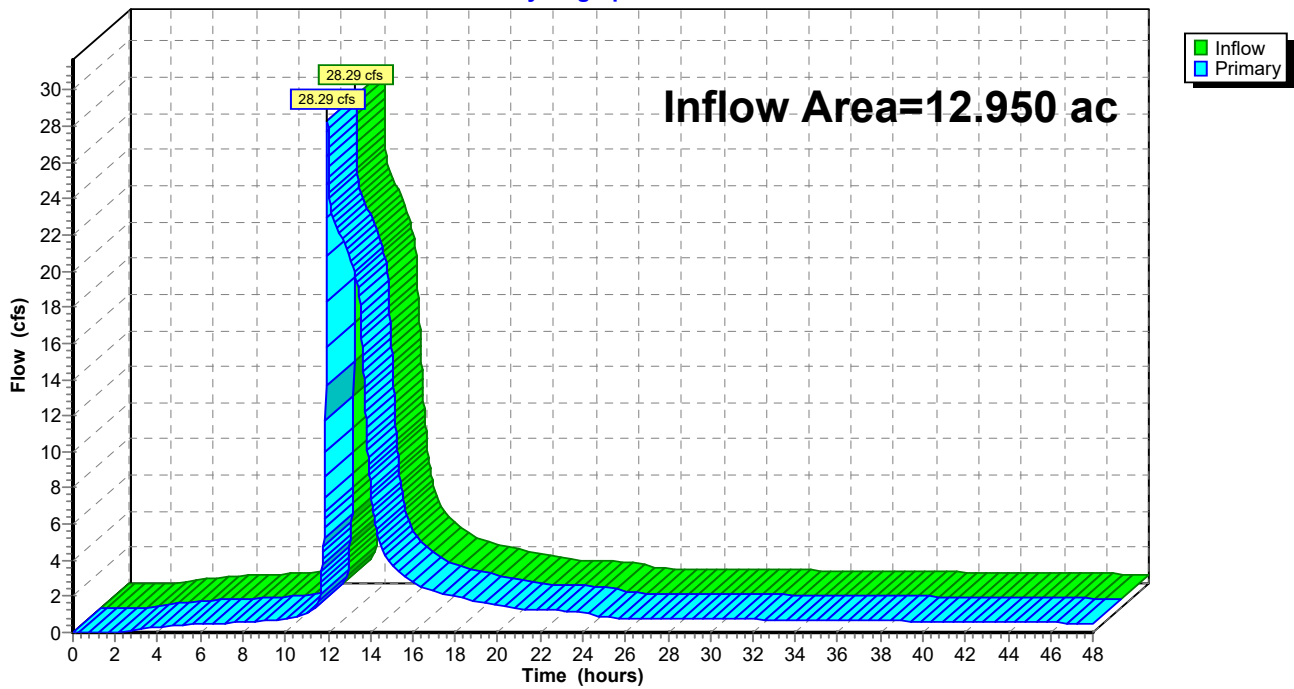

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 60

Hydrograph for Link NE: South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.81	0.00	0.81
0.50	0.00	0.00	0.00	26.50	0.81	0.00	0.81
1.00	0.00	0.00	0.00	27.00	0.80	0.00	0.80
1.50	0.00	0.00	0.00	27.50	0.79	0.00	0.79
2.00	0.00	0.00	0.00	28.00	0.79	0.00	0.79
2.50	0.08	0.00	0.08	28.50	0.78	0.00	0.78
3.00	0.17	0.00	0.17	29.00	0.77	0.00	0.77
3.50	0.25	0.00	0.25	29.50	0.77	0.00	0.77
4.00	0.31	0.00	0.31	30.00	0.76	0.00	0.76
4.50	0.36	0.00	0.36	30.50	0.75	0.00	0.75
5.00	0.41	0.00	0.41	31.00	0.74	0.00	0.74
5.50	0.45	0.00	0.45	31.50	0.74	0.00	0.74
6.00	0.47	0.00	0.47	32.00	0.73	0.00	0.73
6.50	0.49	0.00	0.49	32.50	0.72	0.00	0.72
7.00	0.52	0.00	0.52	33.00	0.72	0.00	0.72
7.50	0.55	0.00	0.55	33.50	0.71	0.00	0.71
8.00	0.57	0.00	0.57	34.00	0.70	0.00	0.70
8.50	0.62	0.00	0.62	34.50	0.70	0.00	0.70
9.00	0.68	0.00	0.68	35.00	0.69	0.00	0.69
9.50	0.72	0.00	0.72	35.50	0.68	0.00	0.68
10.00	0.79	0.00	0.79	36.00	0.68	0.00	0.68
10.50	0.90	0.00	0.90	36.50	0.67	0.00	0.67
11.00	1.06	0.00	1.06	37.00	0.66	0.00	0.66
11.50	1.42	0.00	1.42	37.50	0.66	0.00	0.66
12.00	28.08	0.00	28.08	38.00	0.65	0.00	0.65
12.50	22.27	0.00	22.27	38.50	0.64	0.00	0.64
13.00	20.83	0.00	20.83	39.00	0.64	0.00	0.64
13.50	18.46	0.00	18.46	39.50	0.63	0.00	0.63
14.00	8.12	0.00	8.12	40.00	0.62	0.00	0.62
14.50	4.80	0.00	4.80	40.50	0.61	0.00	0.61
15.00	3.74	0.00	3.74	41.00	0.61	0.00	0.61
15.50	3.19	0.00	3.19	41.50	0.60	0.00	0.60
16.00	2.78	0.00	2.78	42.00	0.59	0.00	0.59
16.50	2.48	0.00	2.48	42.50	0.59	0.00	0.59
17.00	2.27	0.00	2.27	43.00	0.58	0.00	0.58
17.50	2.12	0.00	2.12	43.50	0.57	0.00	0.57
18.00	1.99	0.00	1.99	44.00	0.57	0.00	0.57
18.50	1.87	0.00	1.87	44.50	0.56	0.00	0.56
19.00	1.75	0.00	1.75	45.00	0.55	0.00	0.55
19.50	1.63	0.00	1.63	45.50	0.55	0.00	0.55
20.00	1.51	0.00	1.51	46.00	0.54	0.00	0.54
20.50	1.41	0.00	1.41	46.50	0.53	0.00	0.53
21.00	1.34	0.00	1.34	47.00	0.52	0.00	0.52
21.50	1.29	0.00	1.29	47.50	0.52	0.00	0.52
22.00	1.26	0.00	1.26	48.00	0.51	0.00	0.51
22.50	1.23	0.00	1.23				
23.00	1.20	0.00	1.20				
23.50	1.18	0.00	1.18				
24.00	1.16	0.00	1.16				
24.50	0.87	0.00	0.87				
25.00	0.83	0.00	0.83				
25.50	0.82	0.00	0.82				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Type II 24-hr 100-Year Rainfall=7.70"

Printed 8/9/2022

Page 61


Summary for Link TOT: Total Site Watershed

Inflow Area = 13.460 ac, 68.36% Impervious, Inflow Depth > 6.50" for 100-Year event
Inflow = 32.79 cfs @ 11.99 hrs, Volume= 7.294 af
Primary = 32.79 cfs @ 11.99 hrs, Volume= 7.294 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.01 hrs

Link TOT: Total Site Watershed

Hydrograph

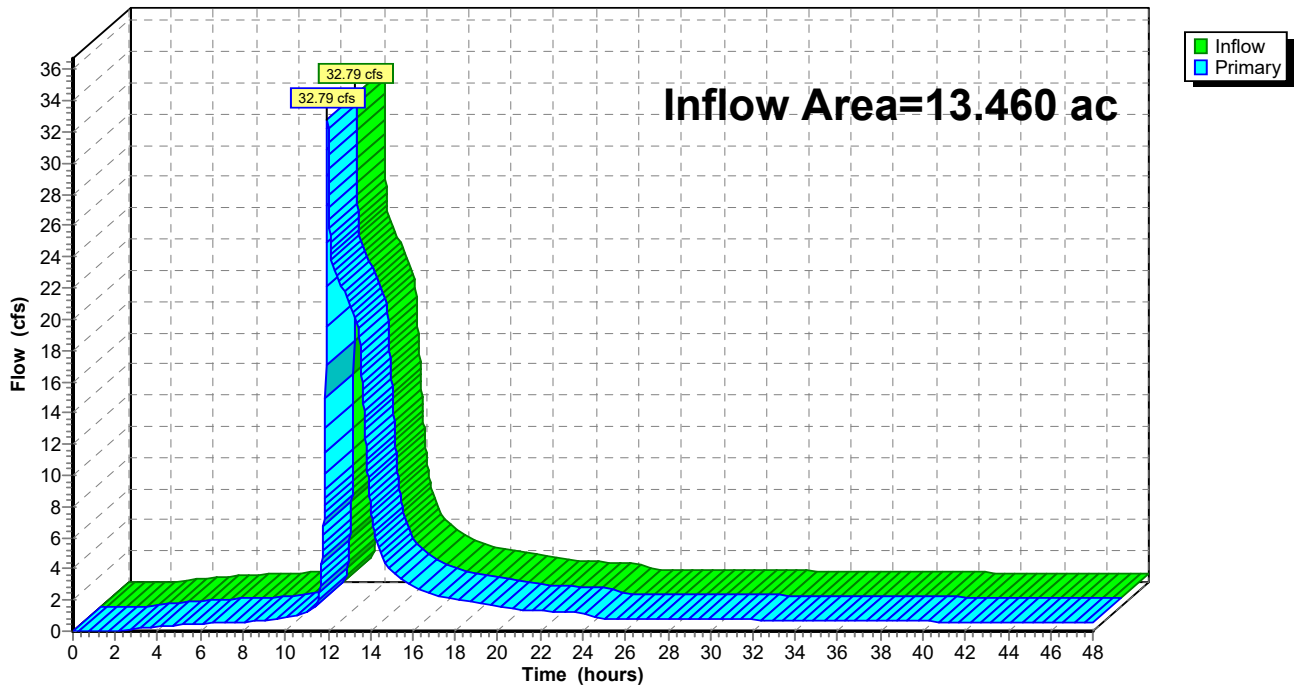

Proposed

Type II 24-hr 100-Year Rainfall=7.70"

Prepared by {enter your company name here}

Printed 8/9/2022

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Page 62

Hydrograph for Link TOT: Total Site Watershed

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.81	0.00	0.81
0.50	0.00	0.00	0.00	26.50	0.81	0.00	0.81
1.00	0.00	0.00	0.00	27.00	0.80	0.00	0.80
1.50	0.00	0.00	0.00	27.50	0.79	0.00	0.79
2.00	0.00	0.00	0.00	28.00	0.79	0.00	0.79
2.50	0.08	0.00	0.08	28.50	0.78	0.00	0.78
3.00	0.17	0.00	0.17	29.00	0.77	0.00	0.77
3.50	0.25	0.00	0.25	29.50	0.77	0.00	0.77
4.00	0.31	0.00	0.31	30.00	0.76	0.00	0.76
4.50	0.36	0.00	0.36	30.50	0.75	0.00	0.75
5.00	0.41	0.00	0.41	31.00	0.74	0.00	0.74
5.50	0.45	0.00	0.45	31.50	0.74	0.00	0.74
6.00	0.48	0.00	0.48	32.00	0.73	0.00	0.73
6.50	0.50	0.00	0.50	32.50	0.72	0.00	0.72
7.00	0.53	0.00	0.53	33.00	0.72	0.00	0.72
7.50	0.56	0.00	0.56	33.50	0.71	0.00	0.71
8.00	0.60	0.00	0.60	34.00	0.70	0.00	0.70
8.50	0.65	0.00	0.65	34.50	0.70	0.00	0.70
9.00	0.72	0.00	0.72	35.00	0.69	0.00	0.69
9.50	0.77	0.00	0.77	35.50	0.68	0.00	0.68
10.00	0.85	0.00	0.85	36.00	0.68	0.00	0.68
10.50	0.99	0.00	0.99	36.50	0.67	0.00	0.67
11.00	1.21	0.00	1.21	37.00	0.66	0.00	0.66
11.50	1.69	0.00	1.69	37.50	0.66	0.00	0.66
12.00	32.47	0.00	32.47	38.00	0.65	0.00	0.65
12.50	22.66	0.00	22.66	38.50	0.64	0.00	0.64
13.00	21.07	0.00	21.07	39.00	0.64	0.00	0.64
13.50	18.63	0.00	18.63	39.50	0.63	0.00	0.63
14.00	8.26	0.00	8.26	40.00	0.62	0.00	0.62
14.50	4.92	0.00	4.92	40.50	0.61	0.00	0.61
15.00	3.85	0.00	3.85	41.00	0.61	0.00	0.61
15.50	3.28	0.00	3.28	41.50	0.60	0.00	0.60
16.00	2.87	0.00	2.87	42.00	0.59	0.00	0.59
16.50	2.56	0.00	2.56	42.50	0.59	0.00	0.59
17.00	2.35	0.00	2.35	43.00	0.58	0.00	0.58
17.50	2.19	0.00	2.19	43.50	0.57	0.00	0.57
18.00	2.06	0.00	2.06	44.00	0.57	0.00	0.57
18.50	1.93	0.00	1.93	44.50	0.56	0.00	0.56
19.00	1.81	0.00	1.81	45.00	0.55	0.00	0.55
19.50	1.69	0.00	1.69	45.50	0.55	0.00	0.55
20.00	1.56	0.00	1.56	46.00	0.54	0.00	0.54
20.50	1.45	0.00	1.45	46.50	0.53	0.00	0.53
21.00	1.38	0.00	1.38	47.00	0.52	0.00	0.52
21.50	1.34	0.00	1.34	47.50	0.52	0.00	0.52
22.00	1.30	0.00	1.30	48.00	0.51	0.00	0.51
22.50	1.27	0.00	1.27				
23.00	1.25	0.00	1.25				
23.50	1.22	0.00	1.22				
24.00	1.20	0.00	1.20				
24.50	0.87	0.00	0.87				
25.00	0.83	0.00	0.83				
25.50	0.82	0.00	0.82				

Proposed

Prepared by {enter your company name here}

HydroCAD® 10.10-6a s/n 09856 © 2020 HydroCAD Software Solutions LLC

Table of Contents

Printed 8/9/2022

TABLE OF CONTENTS

Project Reports

- 1 Routing Diagram
- 2 Rainfall Events Listing (selected events)
- 3 Area Listing (all nodes)
- 4 Soil Listing (all nodes)
- 5 Ground Covers (all nodes)

2-Year Event

- 6 Node Listing
- 7 Subcat 1S: South (Bypass)
- 9 Subcat 2S: South to Detention (Off-Site)
- 11 Subcat N-BYP: North
- 13 Subcat WC: South (Detained)
- 15 Pond DET: South Basin
- 19 Link E: North
- 21 Link NE: South
- 23 Link TOT: Total Site Watershed

10-Year Event

- 25 Node Listing
- 26 Subcat 1S: South (Bypass)
- 28 Subcat 2S: South to Detention (Off-Site)
- 30 Subcat N-BYP: North
- 32 Subcat WC: South (Detained)
- 34 Pond DET: South Basin
- 38 Link E: North
- 40 Link NE: South
- 42 Link TOT: Total Site Watershed

100-Year Event


- 44 Node Listing
- 45 Subcat 1S: South (Bypass)
- 47 Subcat 2S: South to Detention (Off-Site)
- 49 Subcat N-BYP: North
- 51 Subcat WC: South (Detained)
- 53 Pond DET: South Basin
- 57 Link E: North
- 59 Link NE: South
- 61 Link TOT: Total Site Watershed

Appendix E

National Flood Hazard Layer FIRMMette



94°23'7"W 38°56'2"N

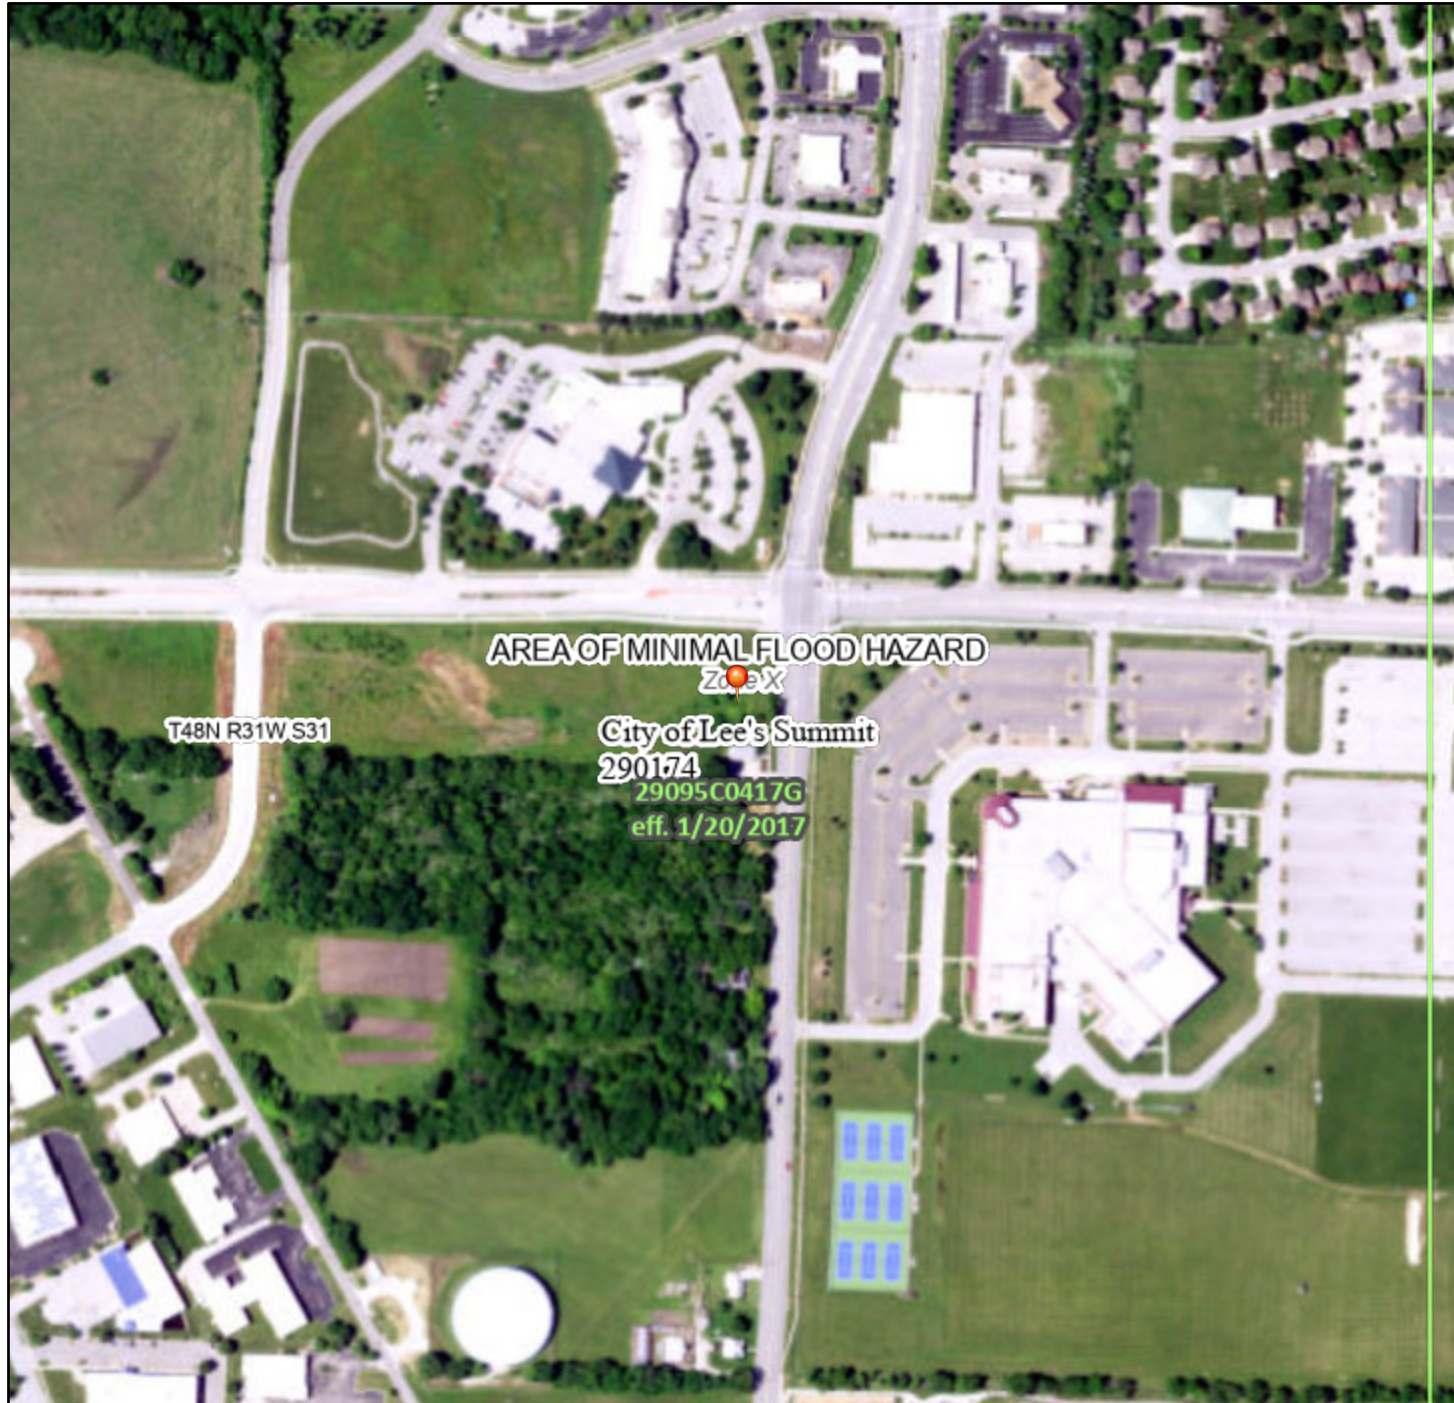

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone D
		Channel, Culvert, or Storm Sewer
OTHER FEATURES		Levee, Dike, or Floodwall
		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation 17.5
MAP PANELS		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
		Digital Data Available
		No Digital Data Available
		Unmapped

The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **6/23/2022 at 12:47 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



94°22'29"W 38°55'34"N

Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020